
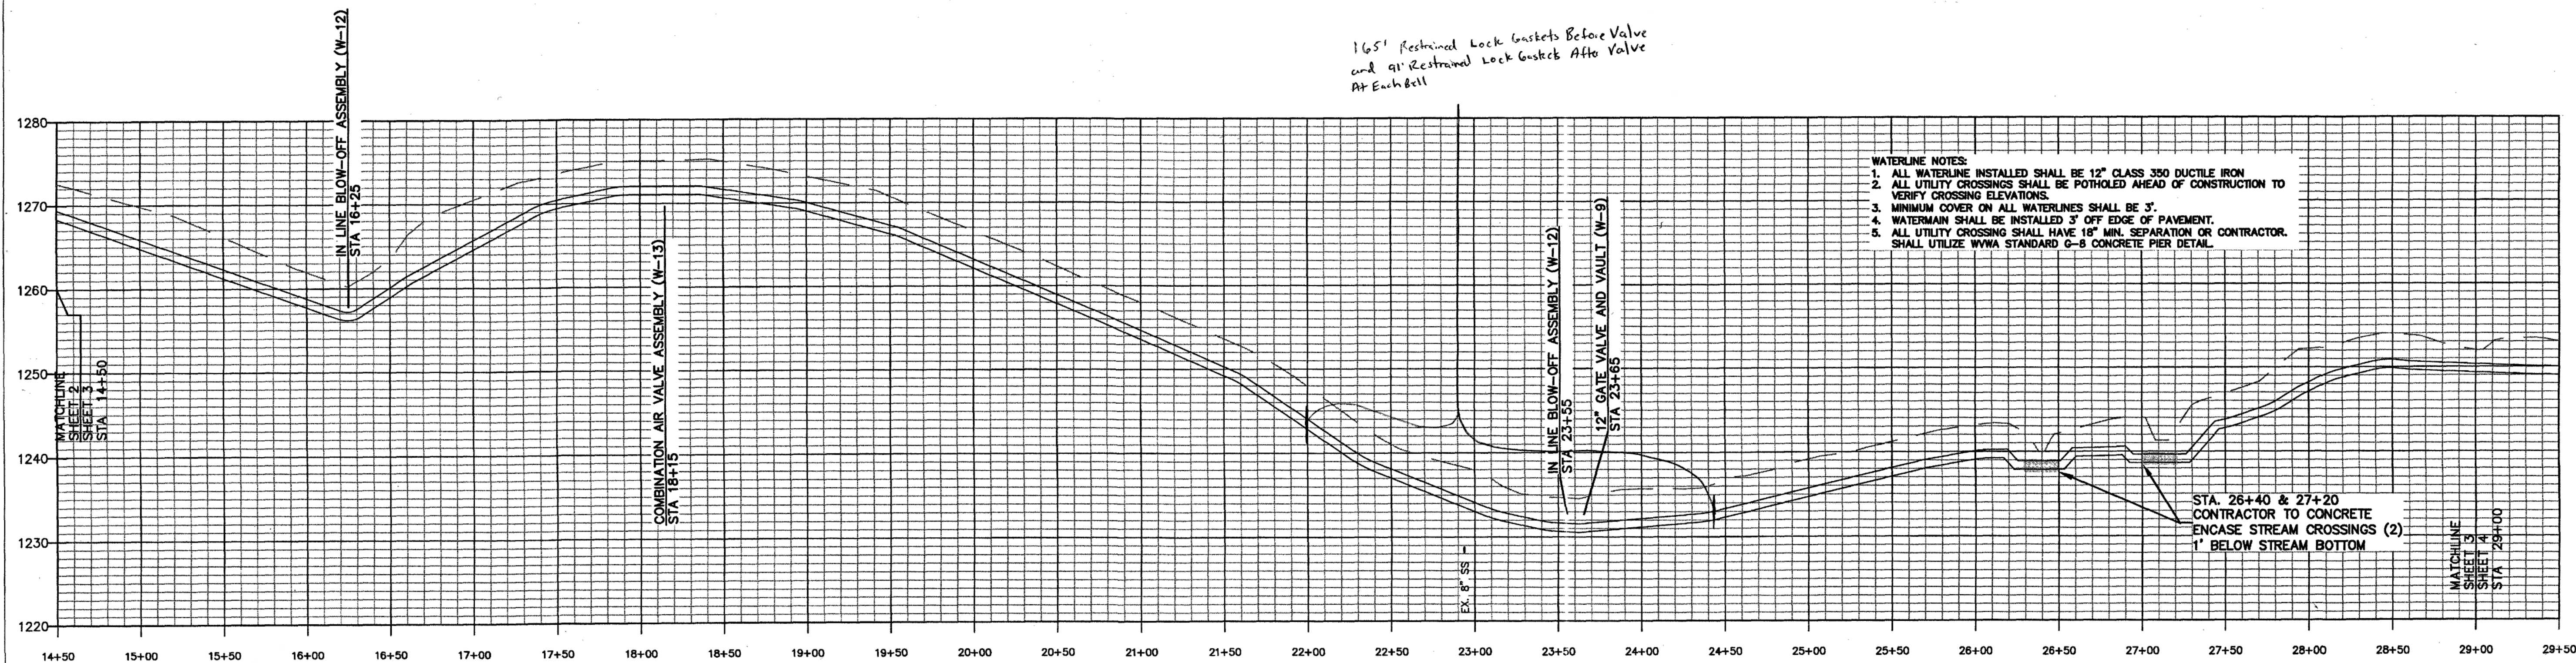


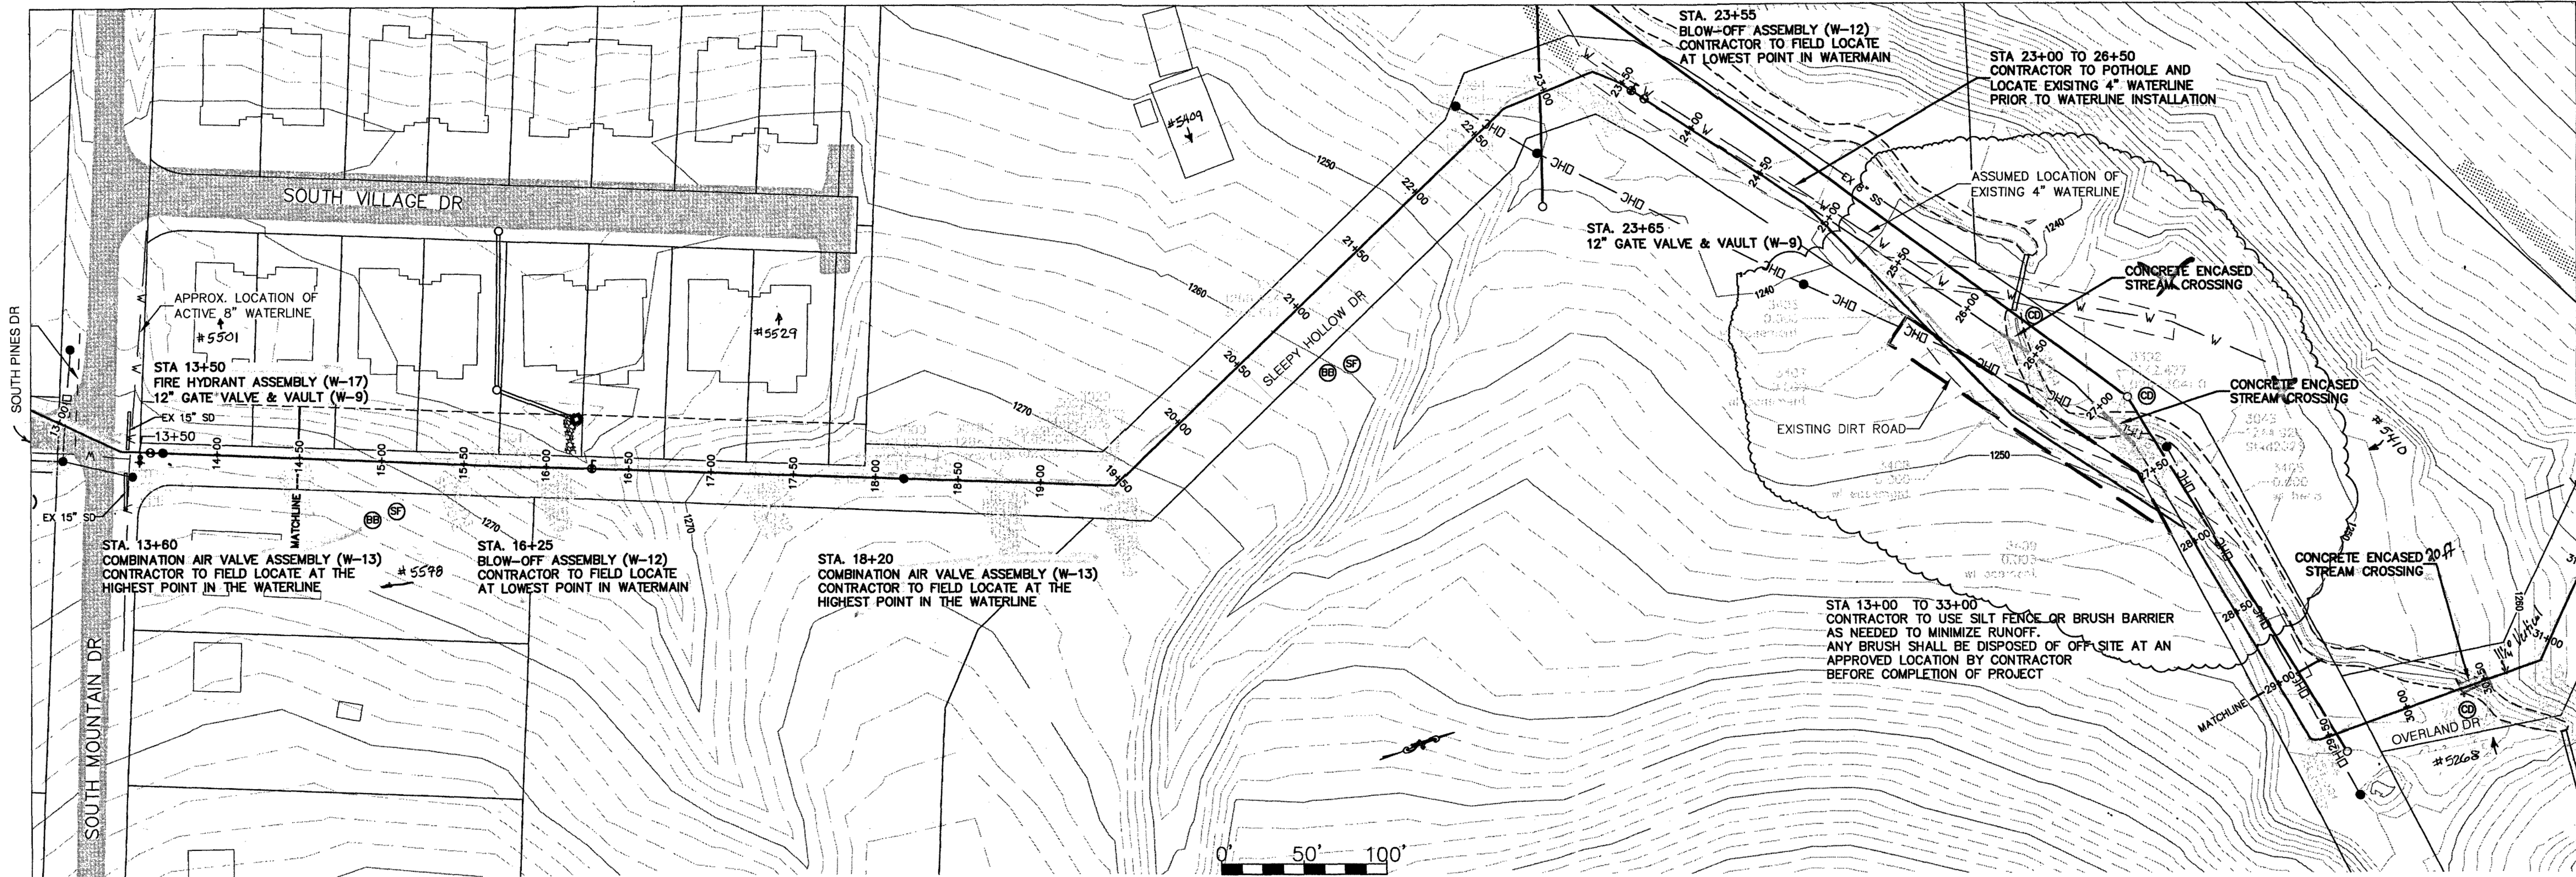

WATERLINE PROFILE
 SCALE
 VERTICAL: 1" = 10'
 HORIZONTAL: 1" = 50'

- WATERLINE NOTES:**
1. ALL WATERLINE INSTALLED SHALL BE 12" CLASS 350 DUCTILE IRON
 2. ALL UTILITY CROSSINGS SHALL BE POTHOLED AHEAD OF CONSTRUCTION TO VERIFY CROSSING ELEVATIONS.
 3. MINIMUM COVER ON ALL WATERLINES SHALL BE 3'.
 4. WATERMAIN SHALL BE INSTALLED 3' OFF EDGE OF PAVEMENT.
 5. ALL UTILITY CROSSING SHALL HAVE 18" MIN. SEPARATION OR CONTRACTOR SHALL UTILIZE WYMA STANDARD G-8 CONCRETE PIER DETAIL.

STA. 26+40 & 27+20
 CONTRACTOR TO CONCRETE
 ENCASE STREAM CROSSINGS (2)
 1' BELOW STREAM BOTTOM

WESTERN VIRGINIA
WATER AUTHORITY
 ENGINEERING SERVICES
 601 S JEFFERSON ST, SUITE 300
 ROANOKE, VA 24011
 540-853-5641 or 540-853-5770



1550 ZONE CONNECTION
PROJECT-PHASE 2

PLAN & PROFILE

Rev	Description	Date	By

Designed: DRJ
 Drawn: DRJ
 Checked: RWB
 Approved:
 Date: 1/24/16
 Project:

3