



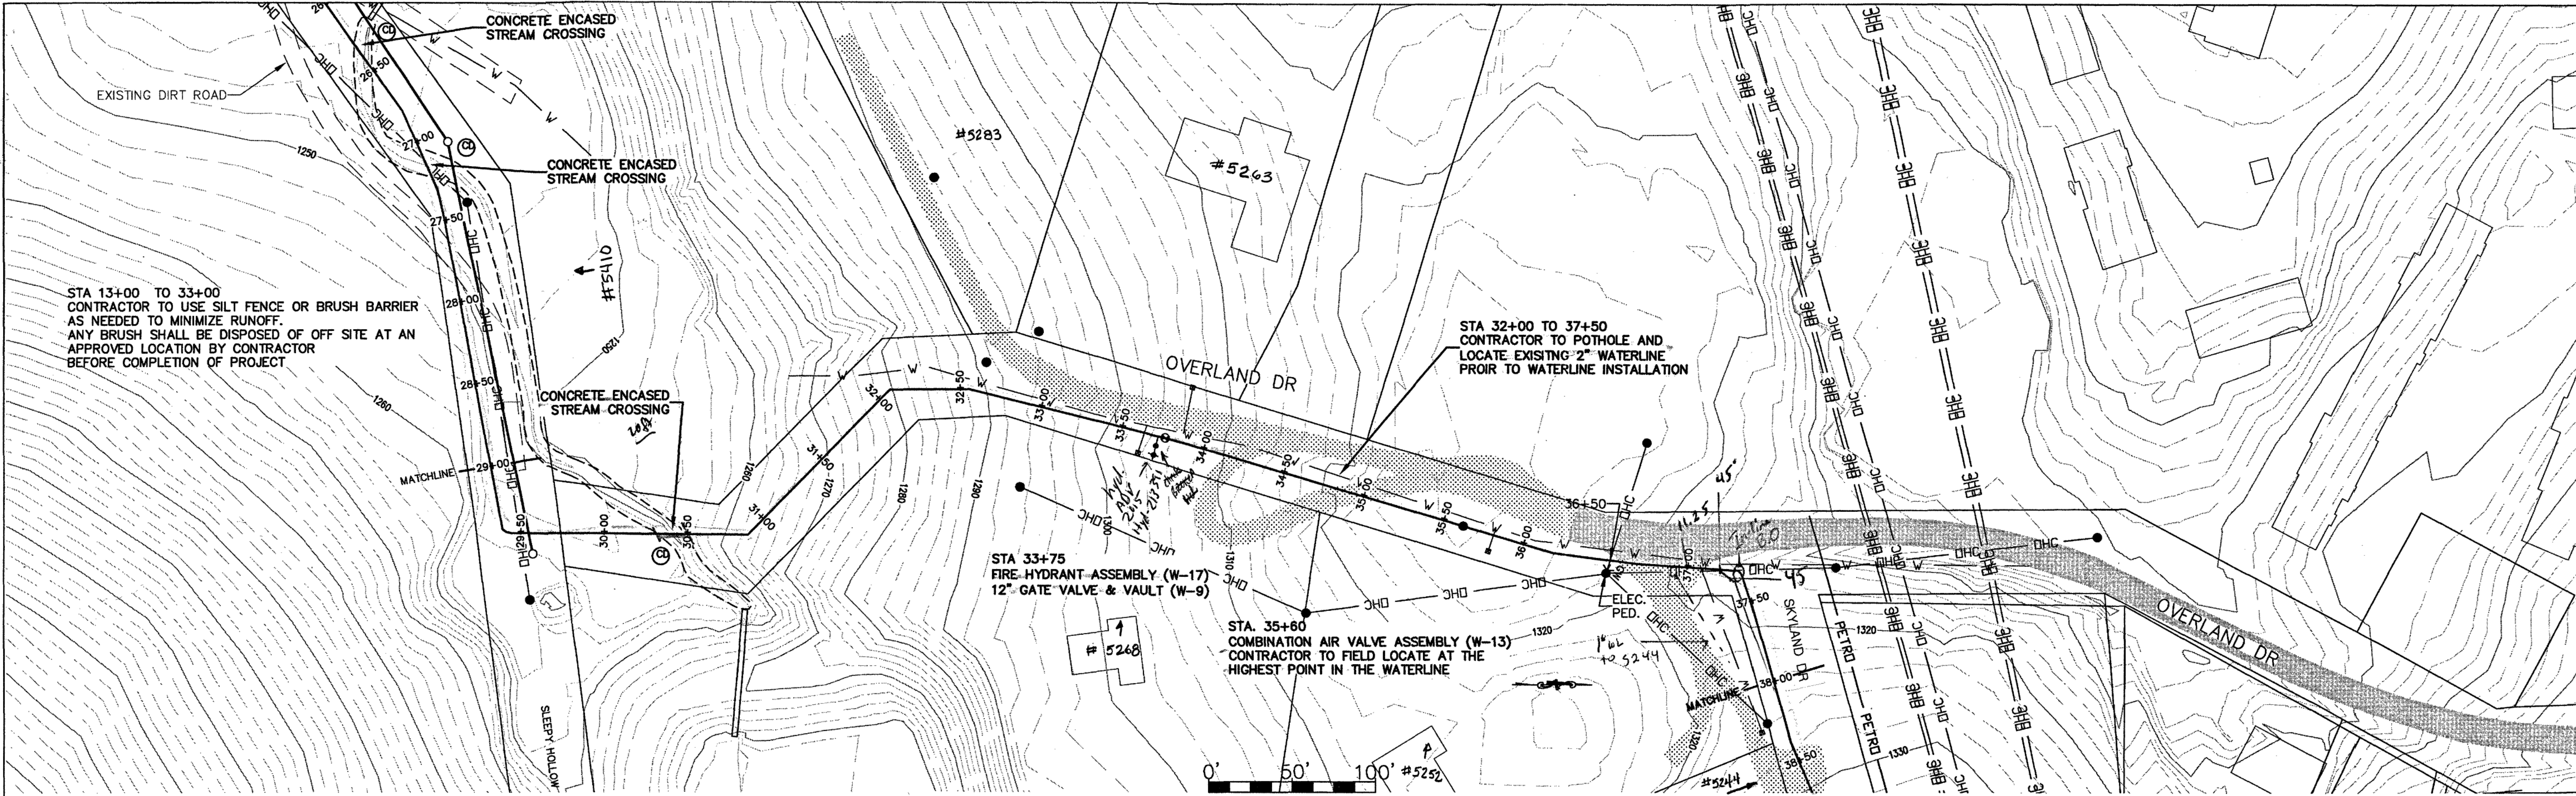

Restored Lock Gaskets 91' Before & After Valve

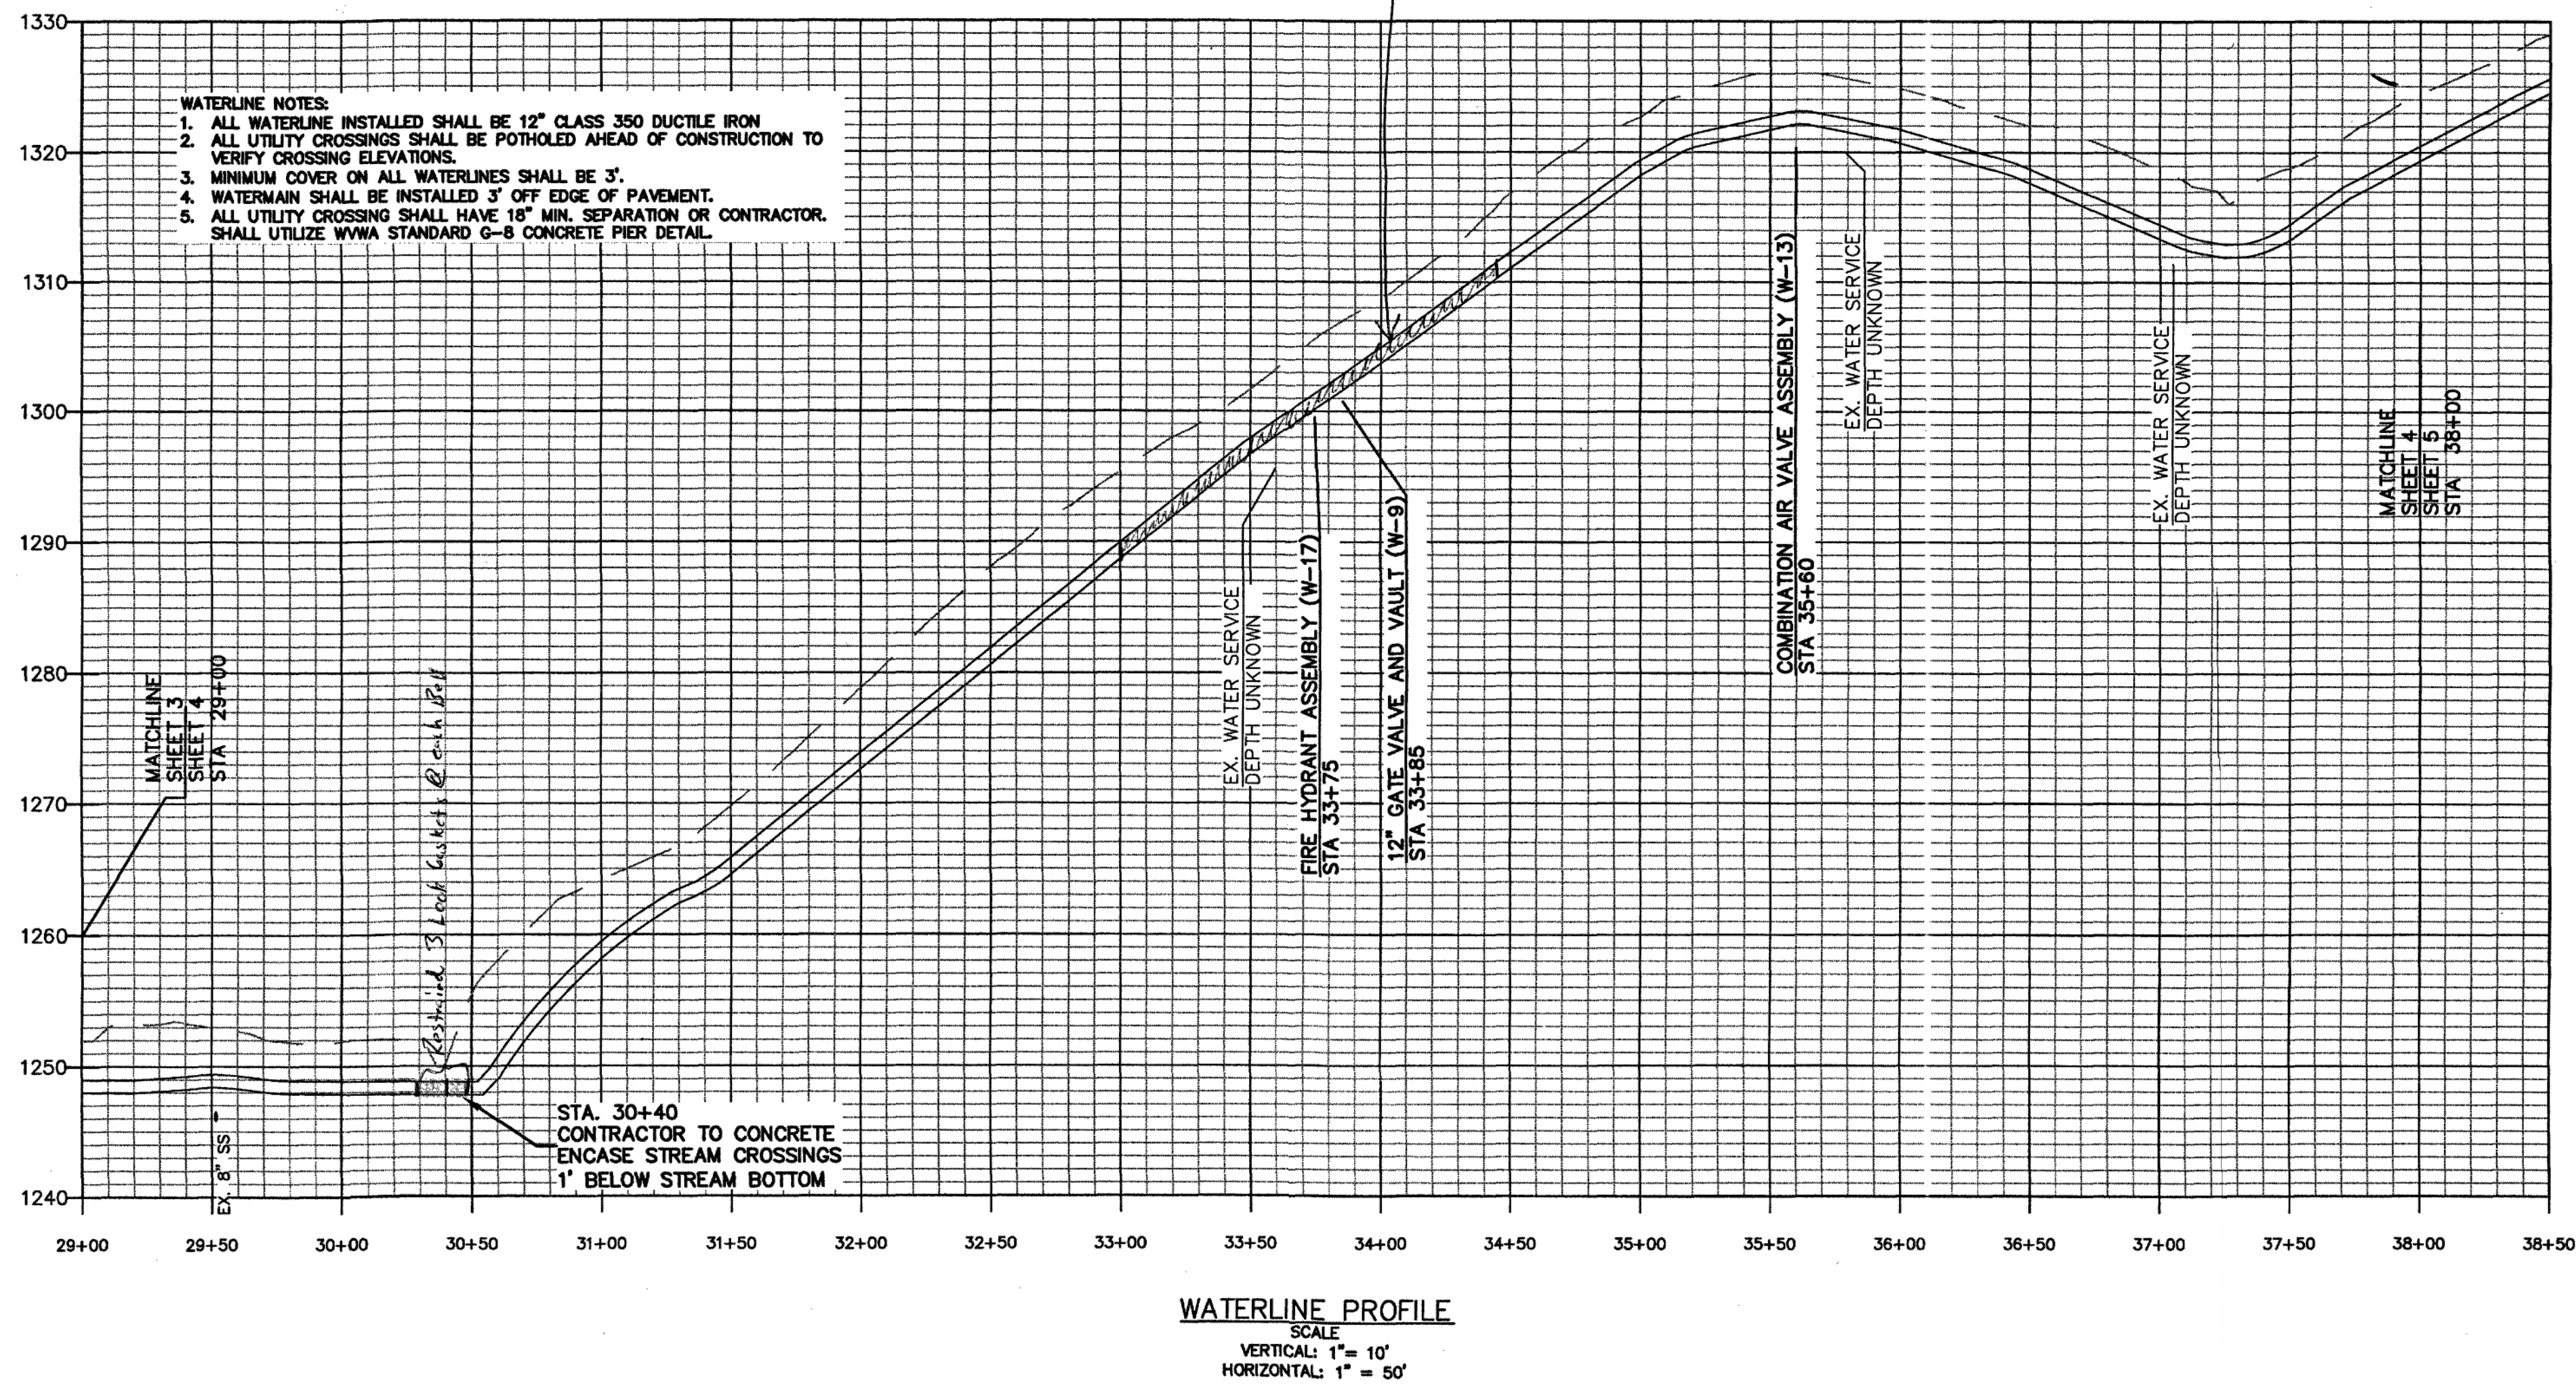

WESTERN VIRGINIA

WATER AUTHORITY

ENGINEERING SERVICES
601 S JEFFERSON ST, SUITE 300
ROANOKE, VA 24011
540-853-5641 or 540-853-5770

ROBERT W. BENNINGER
Lic. No. 10252
1-24-2016
PROFESSIONAL ENGINEER

1550 ZONE CONNECTION
PROJECT-PHASE 2

PLAN & PROFILE

Rev	Description	Date	By

Designed: DRJ

Drawn: DRJ

Checked: RWB

Approved:
Date: 1/24/16

Project:
4

Sheet 4 of 13