



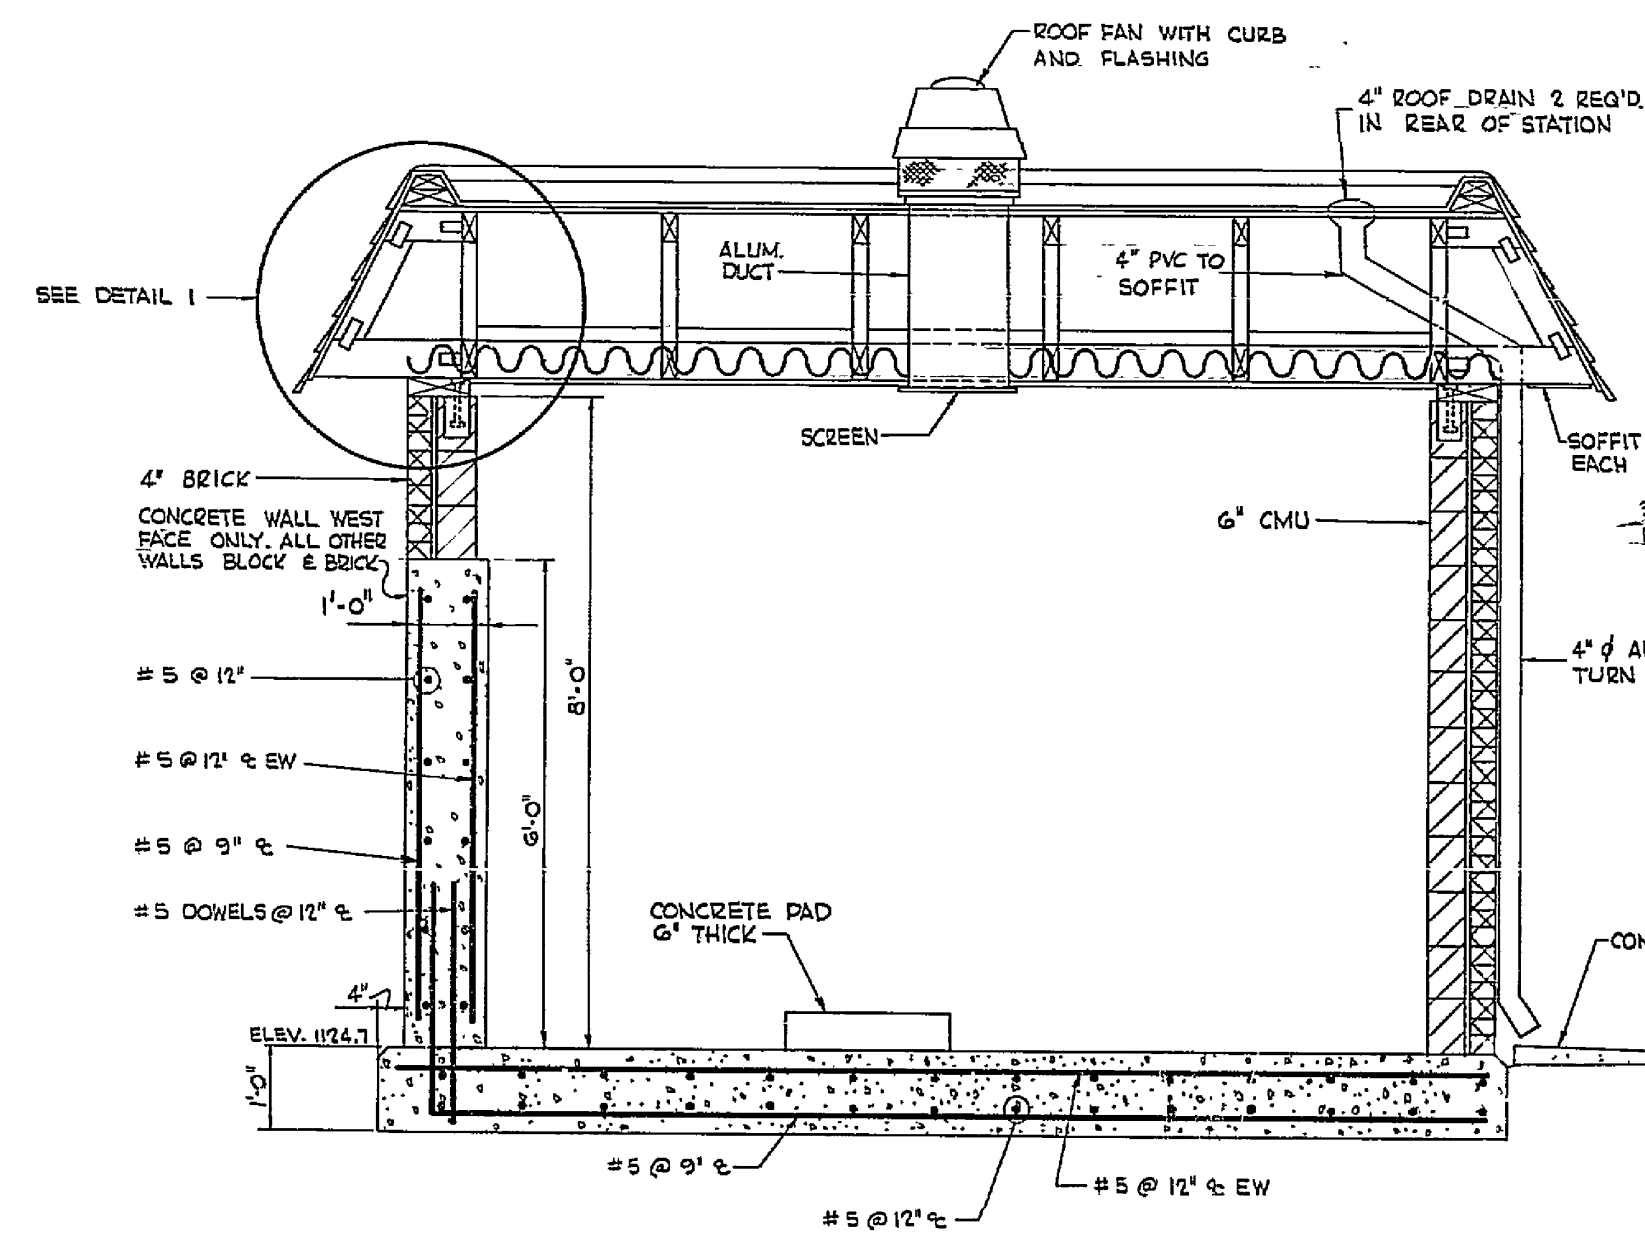


SECTION A-A
SCALE: 1/4"=1'-0"

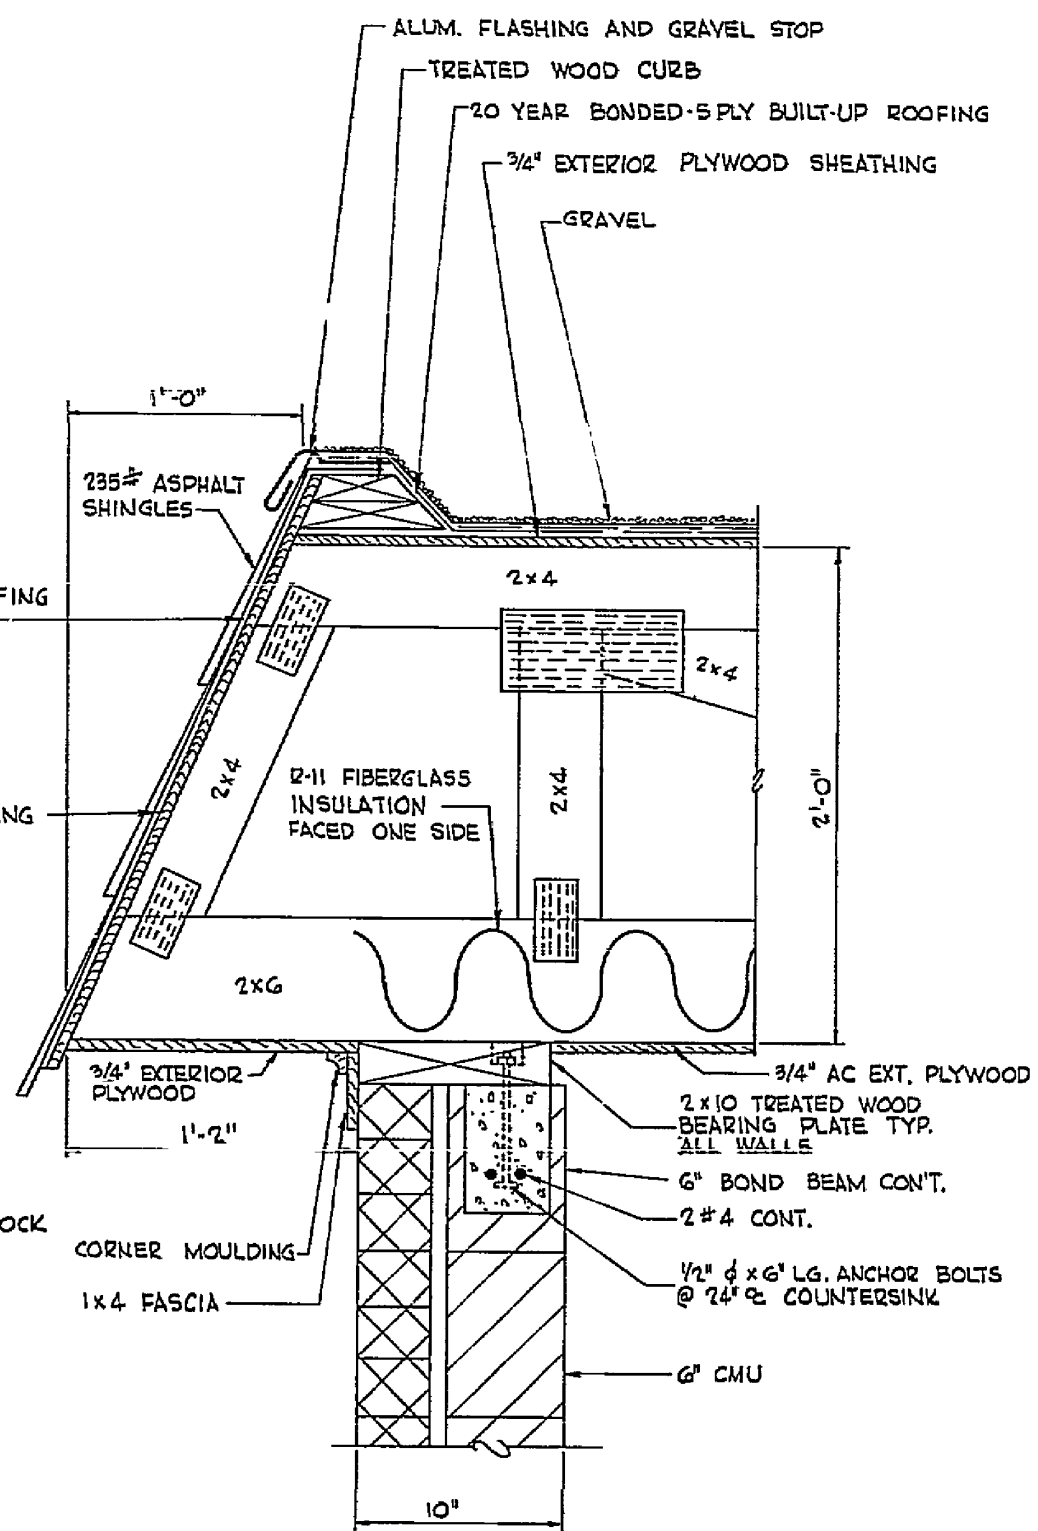


DETAIL 1
SCALE: 1 1/2"=1'-0"

- GENERAL NOTES**
1. CONTRACTOR SHALL NOTIFY "UNDERGROUND CABLE LOCATION" 1-703-982-2400 AT LEAST 48 HOURS IN ADVANCE OF EXCAVATION IN ORDER TO VERIFY LOCATION OF ALL UNDERGROUND UTILITIES.
 2. EROSION CONTROL FABRIC SHALL BE UTILIZED IN ALL DISTURBED AREAS AND SHALL CONSIST OF A UNITED CONSTRUCTION OF KAPAL WITH UNIFORM OPENINGS INTERWOVEN WITH STRIPS OF BIODEGRADABLE PAPER FURNISHED IN ROLLS WITH SUITABLE PROTECTION FOR OUTDOOR STORAGE AT CONSTRUCTION SITE. THE AREA TO BE COVERED SHALL BE PREPARED AS A FINE MEDIUM BED, FERTILIZED, LIMED AND SEEDING PRIOR TO INSTALLATION OF EROSION CONTROL FABRIC. IF THE SLOPE IS GREATER THAN 3:1, FABRIC SHALL BE APPLIED VERTICALLY WITH PAPER STRIPS ORIENTED PARALLEL TO THE SLOPE. FABRIC SHALL BE 5' IN WIDTH WITH A WEIGHT OF 2 LBS. PER SQUARE FOOT. STAPLES FOR SECURING FABRIC SHALL BE 11 GAUGE VISE 1/2" SHAPED WITH 1" CROWN AND LESS 6" IN LENGTH. THE CONTRACTOR SHALL INSTALL IN ACCORDANCE WITH THE MANUFACTURERS RECOMMENDATIONS. EROSION CONTROL FABRIC SHALL BE HOD/GRD OR APPROVED EQUAL PRODUCT.

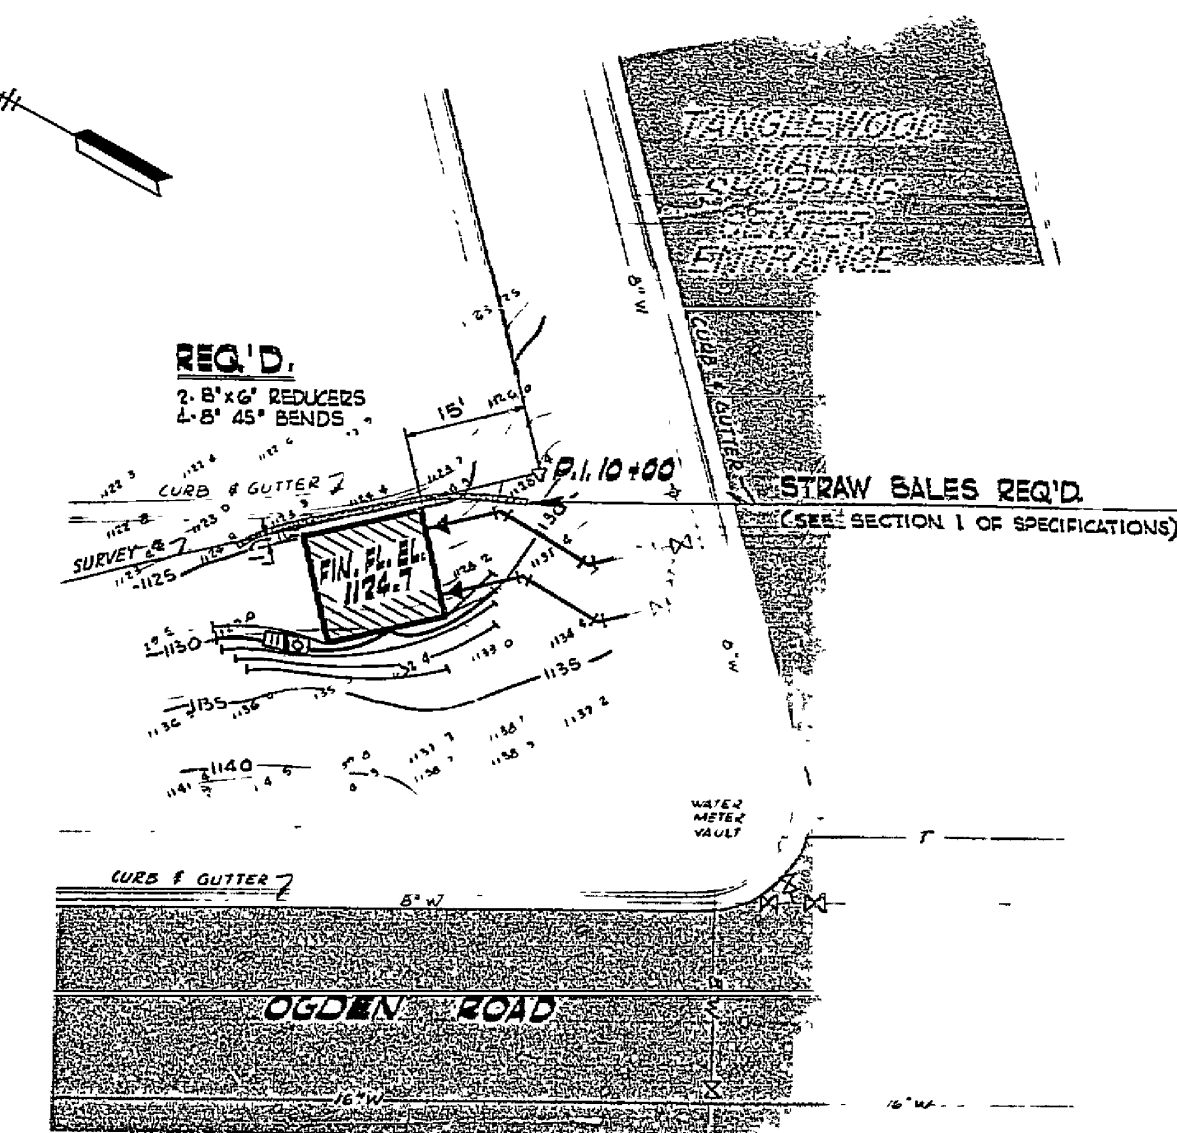


SITE PLAN
SCALE: 1 IN. = 20 FT.

NOTE
PRESSURE GAUGES SHALL BE INSTALLED ON BOTH THE SUCTION AND DISCHARGE PIPING. A COMPOUND GAUGE SHALL BE INSTALLED ON SUCTION PIPING WITH A VACUUM RANGE OF 0 TO 50 INCHES OF MERCURY AND 0 TO 100 PSI FOR PRESSURE. A STANDARD GAUGE SHALL BE INSTALLED ON THE DISCHARGE PIPING WITH A RANGE OF 0 TO 200 PSI. THE CASE AND RING SHALL BE 4 1/4 INCHES STYLE 312 AS MANUFACTURED BY ROBERTSHAW CONTROLS COMPANY OR APPROVED EQUAL.

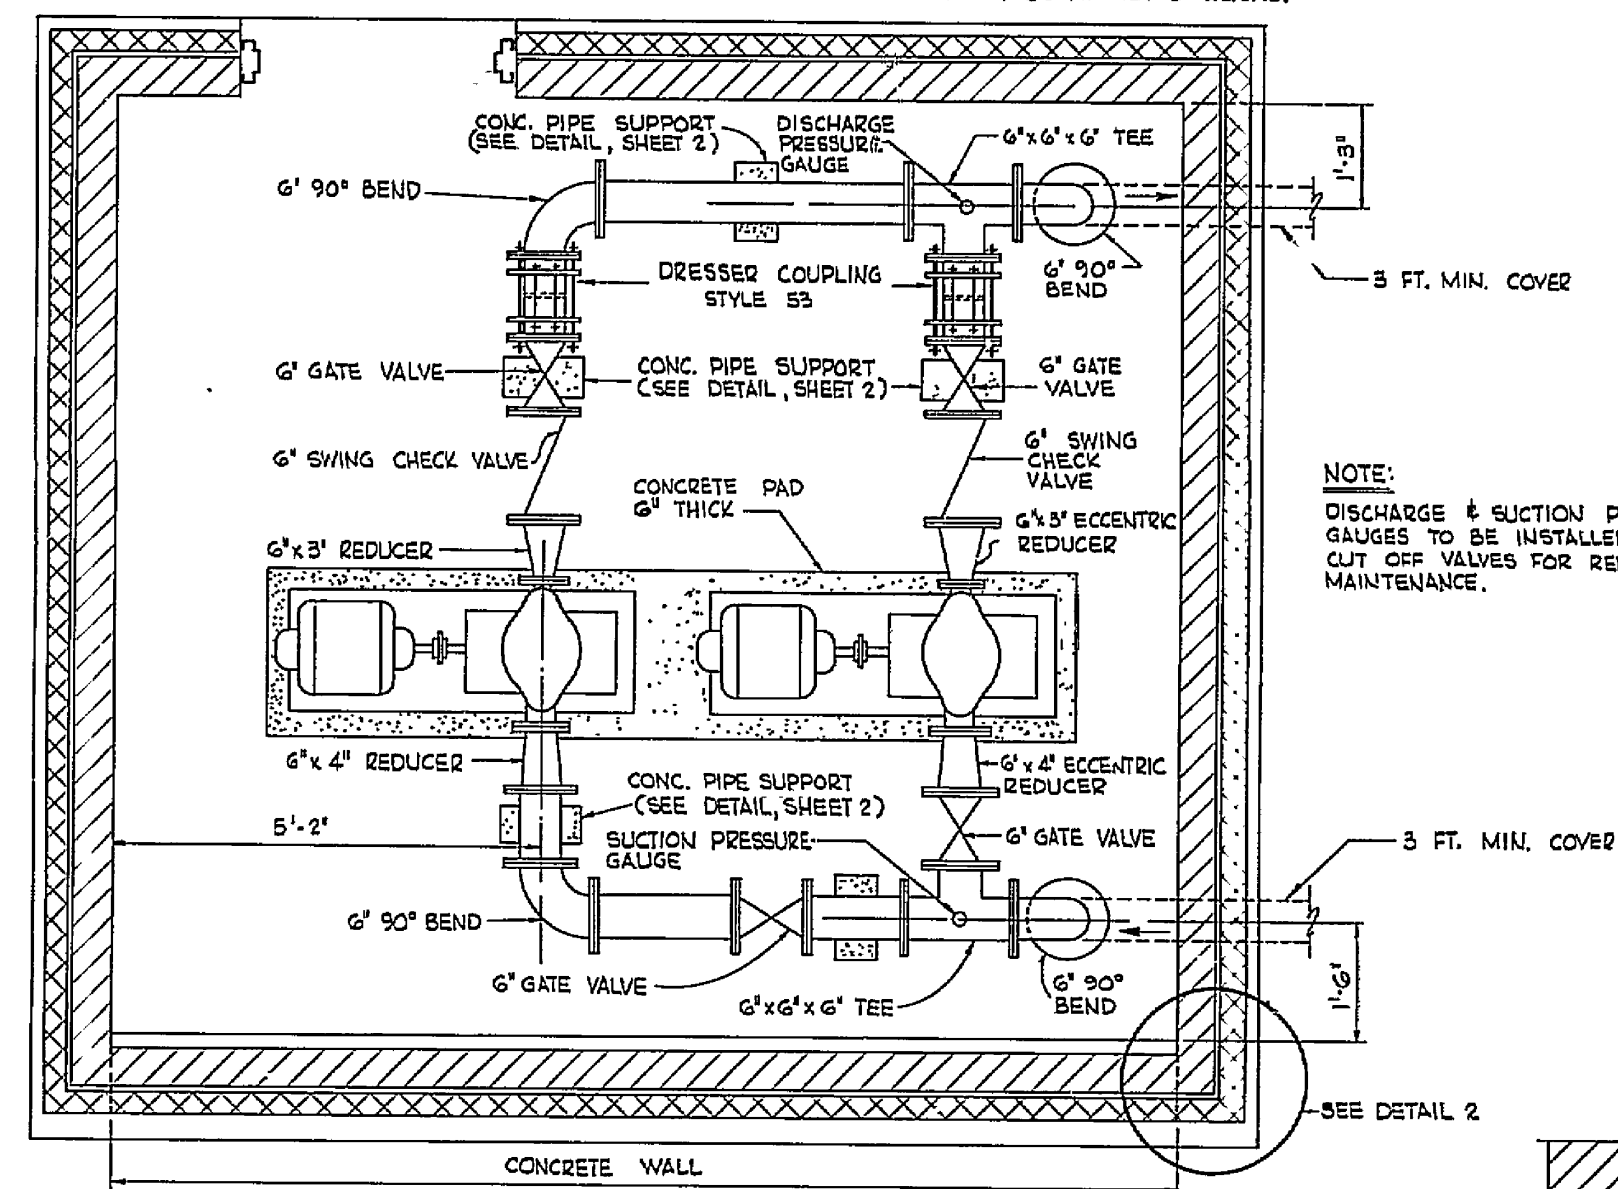


PLAN
SCALE: 1/2"=1'-0"


DETAIL 2
NOT TO SCALE

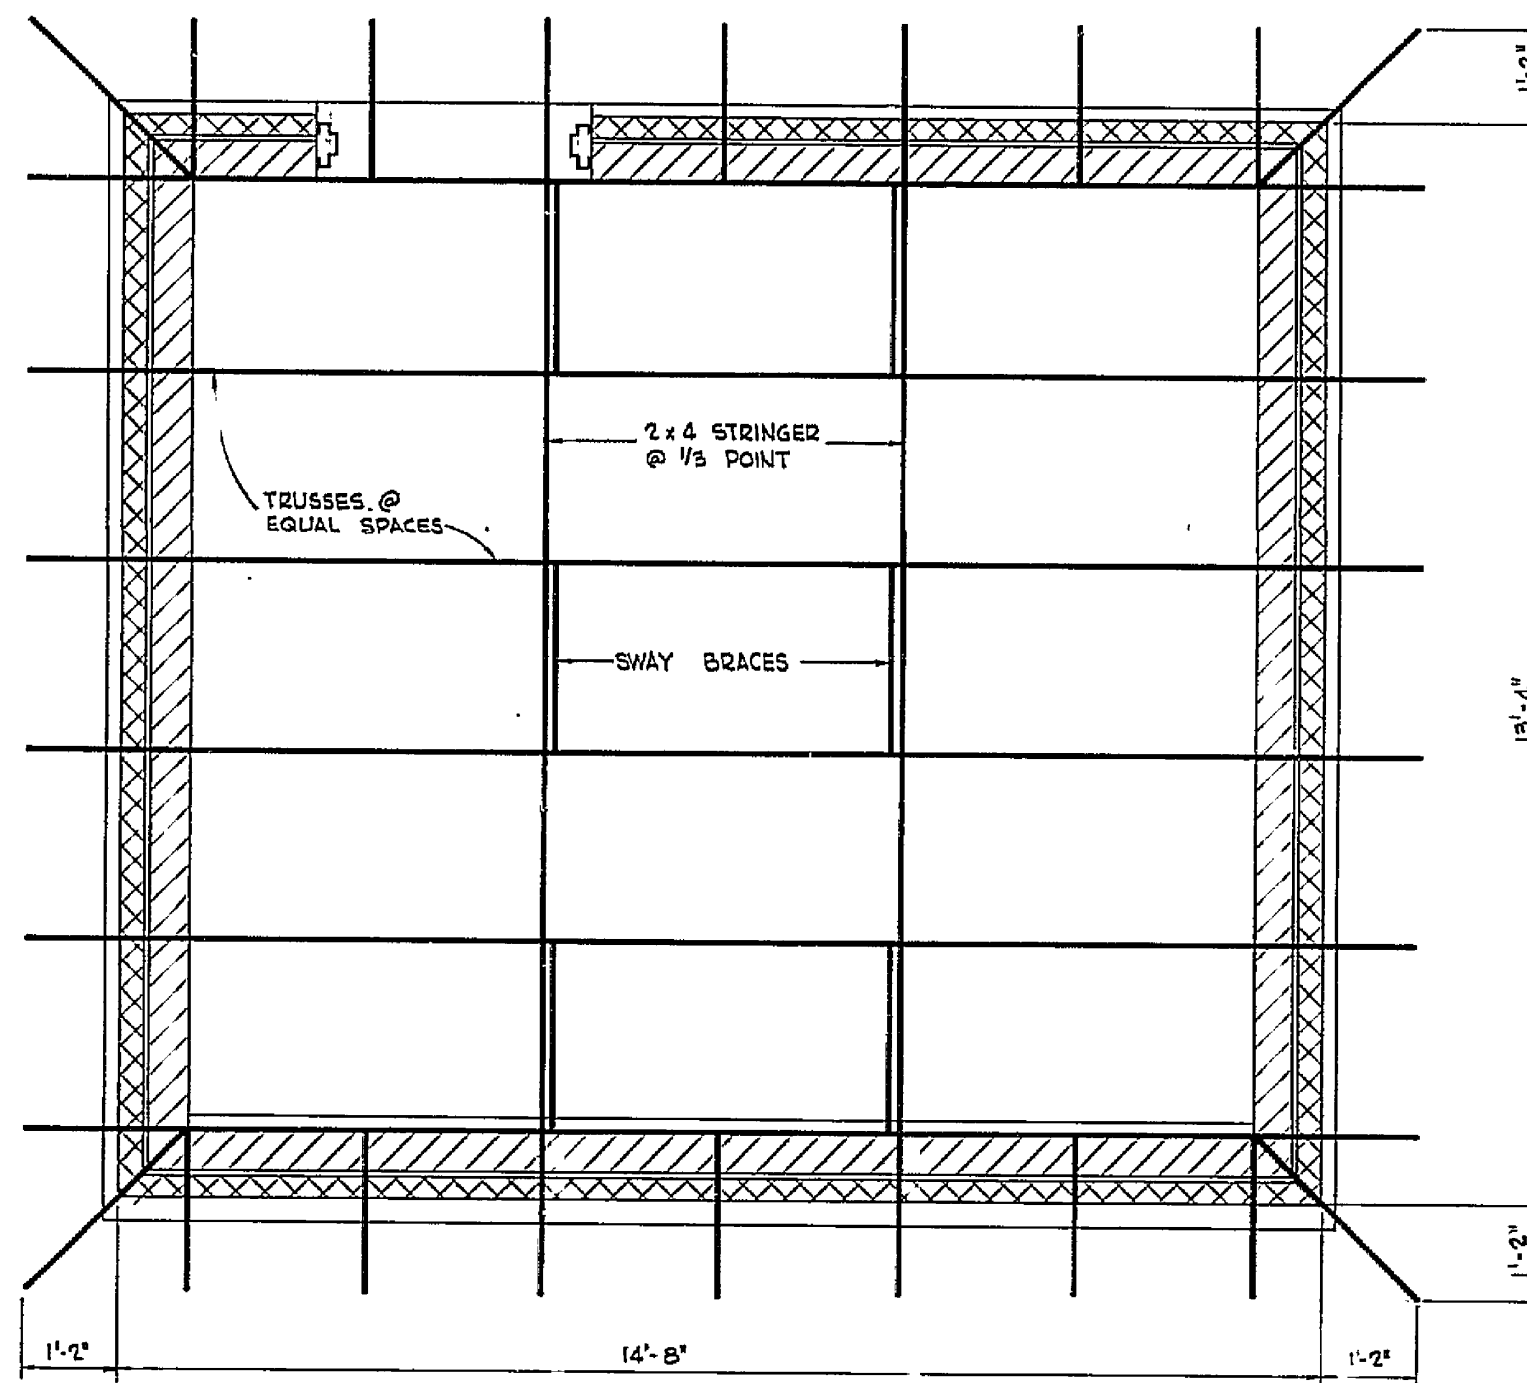

ROOF FRAMING PLAN
SCALE: 1/2"=1'-0"

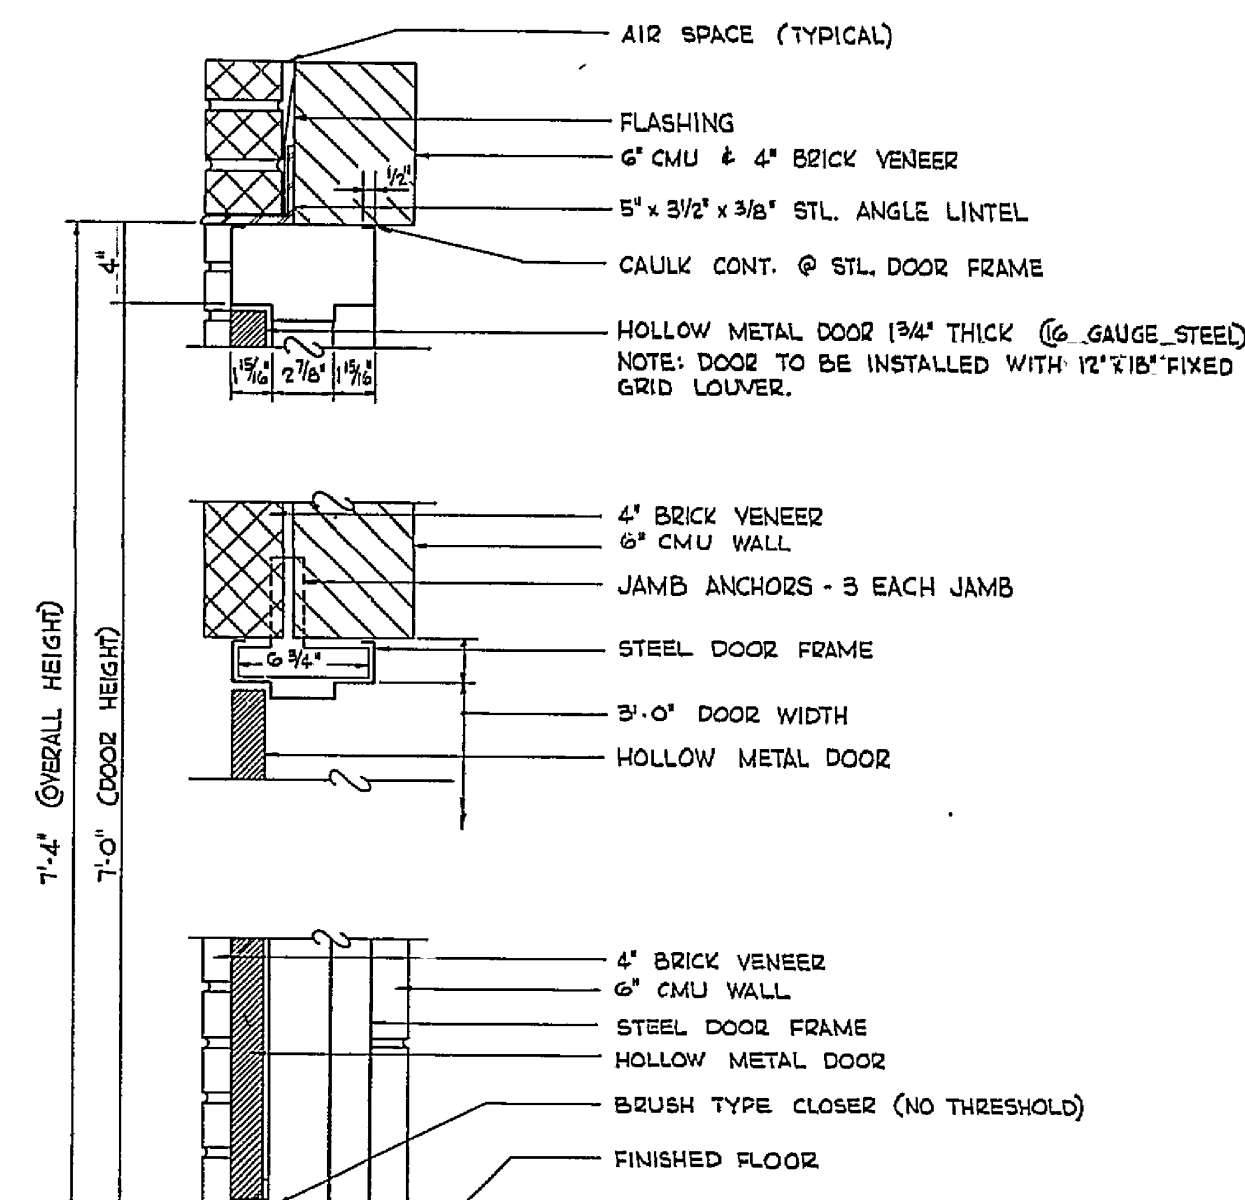

DOOR DETAIL
NOT TO SCALE

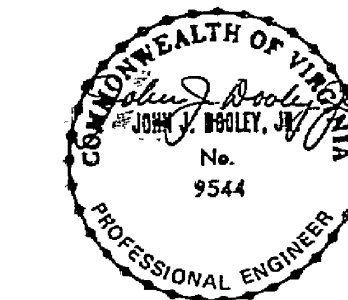

REV. I	GENERAL ARCH. REVISIONS	10-29-80
BOARD OF COUNTY SUPERVISORS ROANOKE COUNTY, VIRGINIA		
WILLIAM C. OVERMAN ASSOCIATES, P.C.	TANGLEWOOD BOOSTER STATION	PROJECT NO. 80-3-W DATE: FEBRUARY 1980 SHEET 11 OF 2
DWS. NO. 8111		WM-0089