


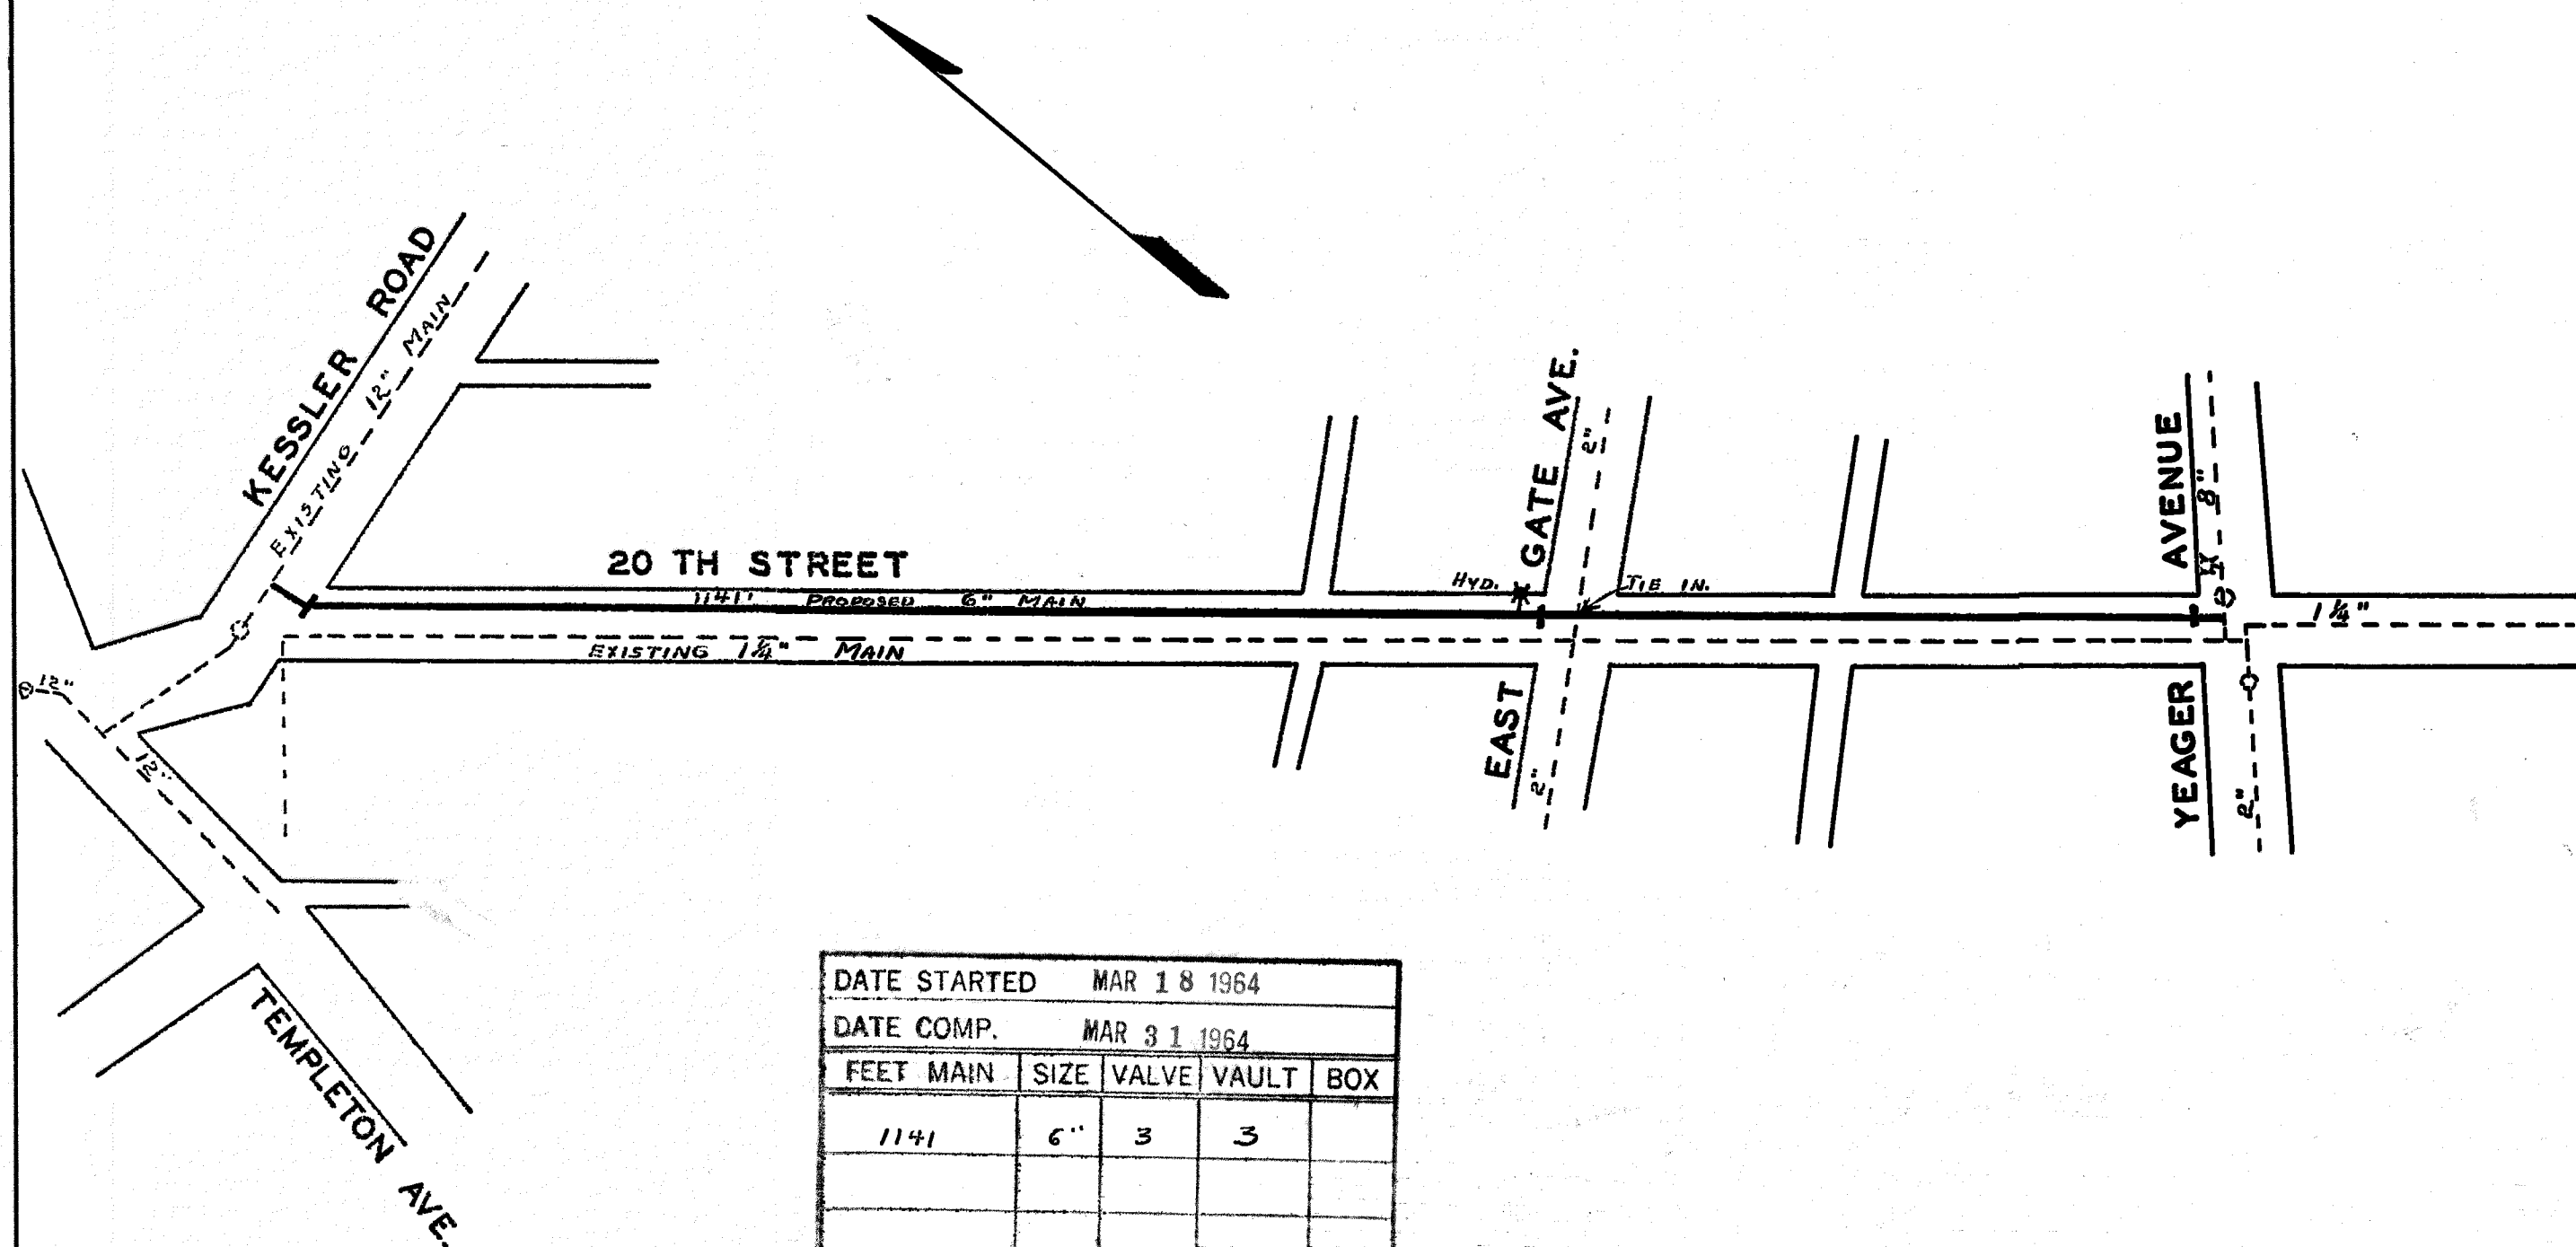

DATE STARTED					MAR 18 1964	
DATE COMP.					MAR 31 1964	
FEET MAIN	SIZE	VALVE	VAULT	BOX		
1141	6"	3	3			
F.H. CORR. 1	6"	1	1			
F.H. STUBS ONLY						
SERV. INS. BY: 1						
MAINS INS. BY: R.M.D.						
NO. 3/4" SERV. INS.						
CITY OR CO.		CITY				
DEPT. INSP.		B.R.H.				

WATER DEPARTMENT
CITY OF ROANOKE, VA.

20TH STREET N.E.
SCALE - 1" = 100'
DRAWN BY E.L.A. MARCH, 13, 1964