

EXIST. 8" W



ST.

INSTALL 6" TAPPING VALVE - MUELLER
& SLEEVE.

ST.



MELROSE AVENUE

EXIST. 12" SAN. SEWER



EXIST. 6" W

EXIST. SAN. SEWER

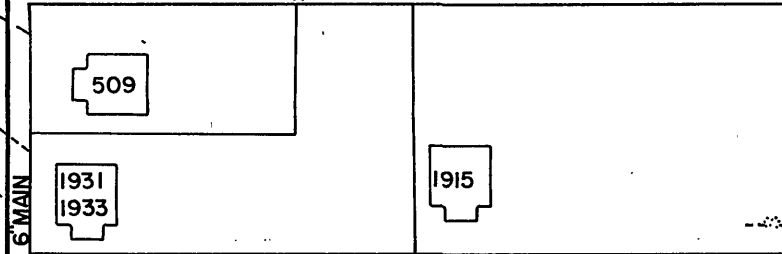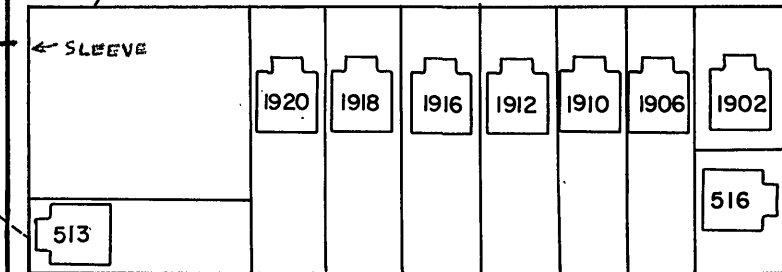

EXIST. SAN. SEWER

ESSEX

EXIST. SAN. SEWER


DATE STARTED		4-22-93		
DATE COMP.		5-5-93		
FEET MAIN	SIZE	VALVE	VAULT	BOX
545'	6"	3	3	
F.H. COMP.		⊕		
F.H. STUB ONLY		⊕		
SERV. INS. BY:				
MAIN INS. BY: C.O. DAME				
NO. 1/2" SERV. INS.				
CITY OR CO.		CITY		
DEPT. INSP.		U.L.S.		

MOORMAN

20TH

INSTALL 6" TAPPING VALVE
& SLEEVE.
MUELLER.

EXIST. 8" WATER AVENUE

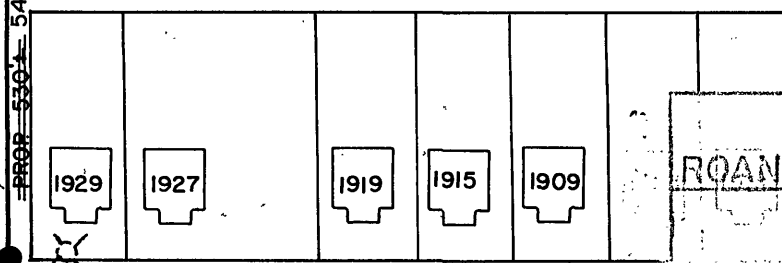

19TH

WATER DEPARTMENT
ROANOKE VIRGINIA

20TH STREET, N.W.
500 BLOCK

James H. ...
MANAGER UTILITY LINE SERVICES

SCALE: 1"=100'
DATE: 1/26/93
DIST. MAP: 232
PLAN NO.: 93-02

<i>W. D. ...</i> 2/18/93	DATE
DIRECTOR UTILITIES & OPERATIONS	
<i>William F. Clark</i> 2/18/93	DATE
DIRECTOR OF PUBLIC WORKS	