


Cut and capped ext. 2" main
plugged valve with 2" megalyz cap. valve is turned off

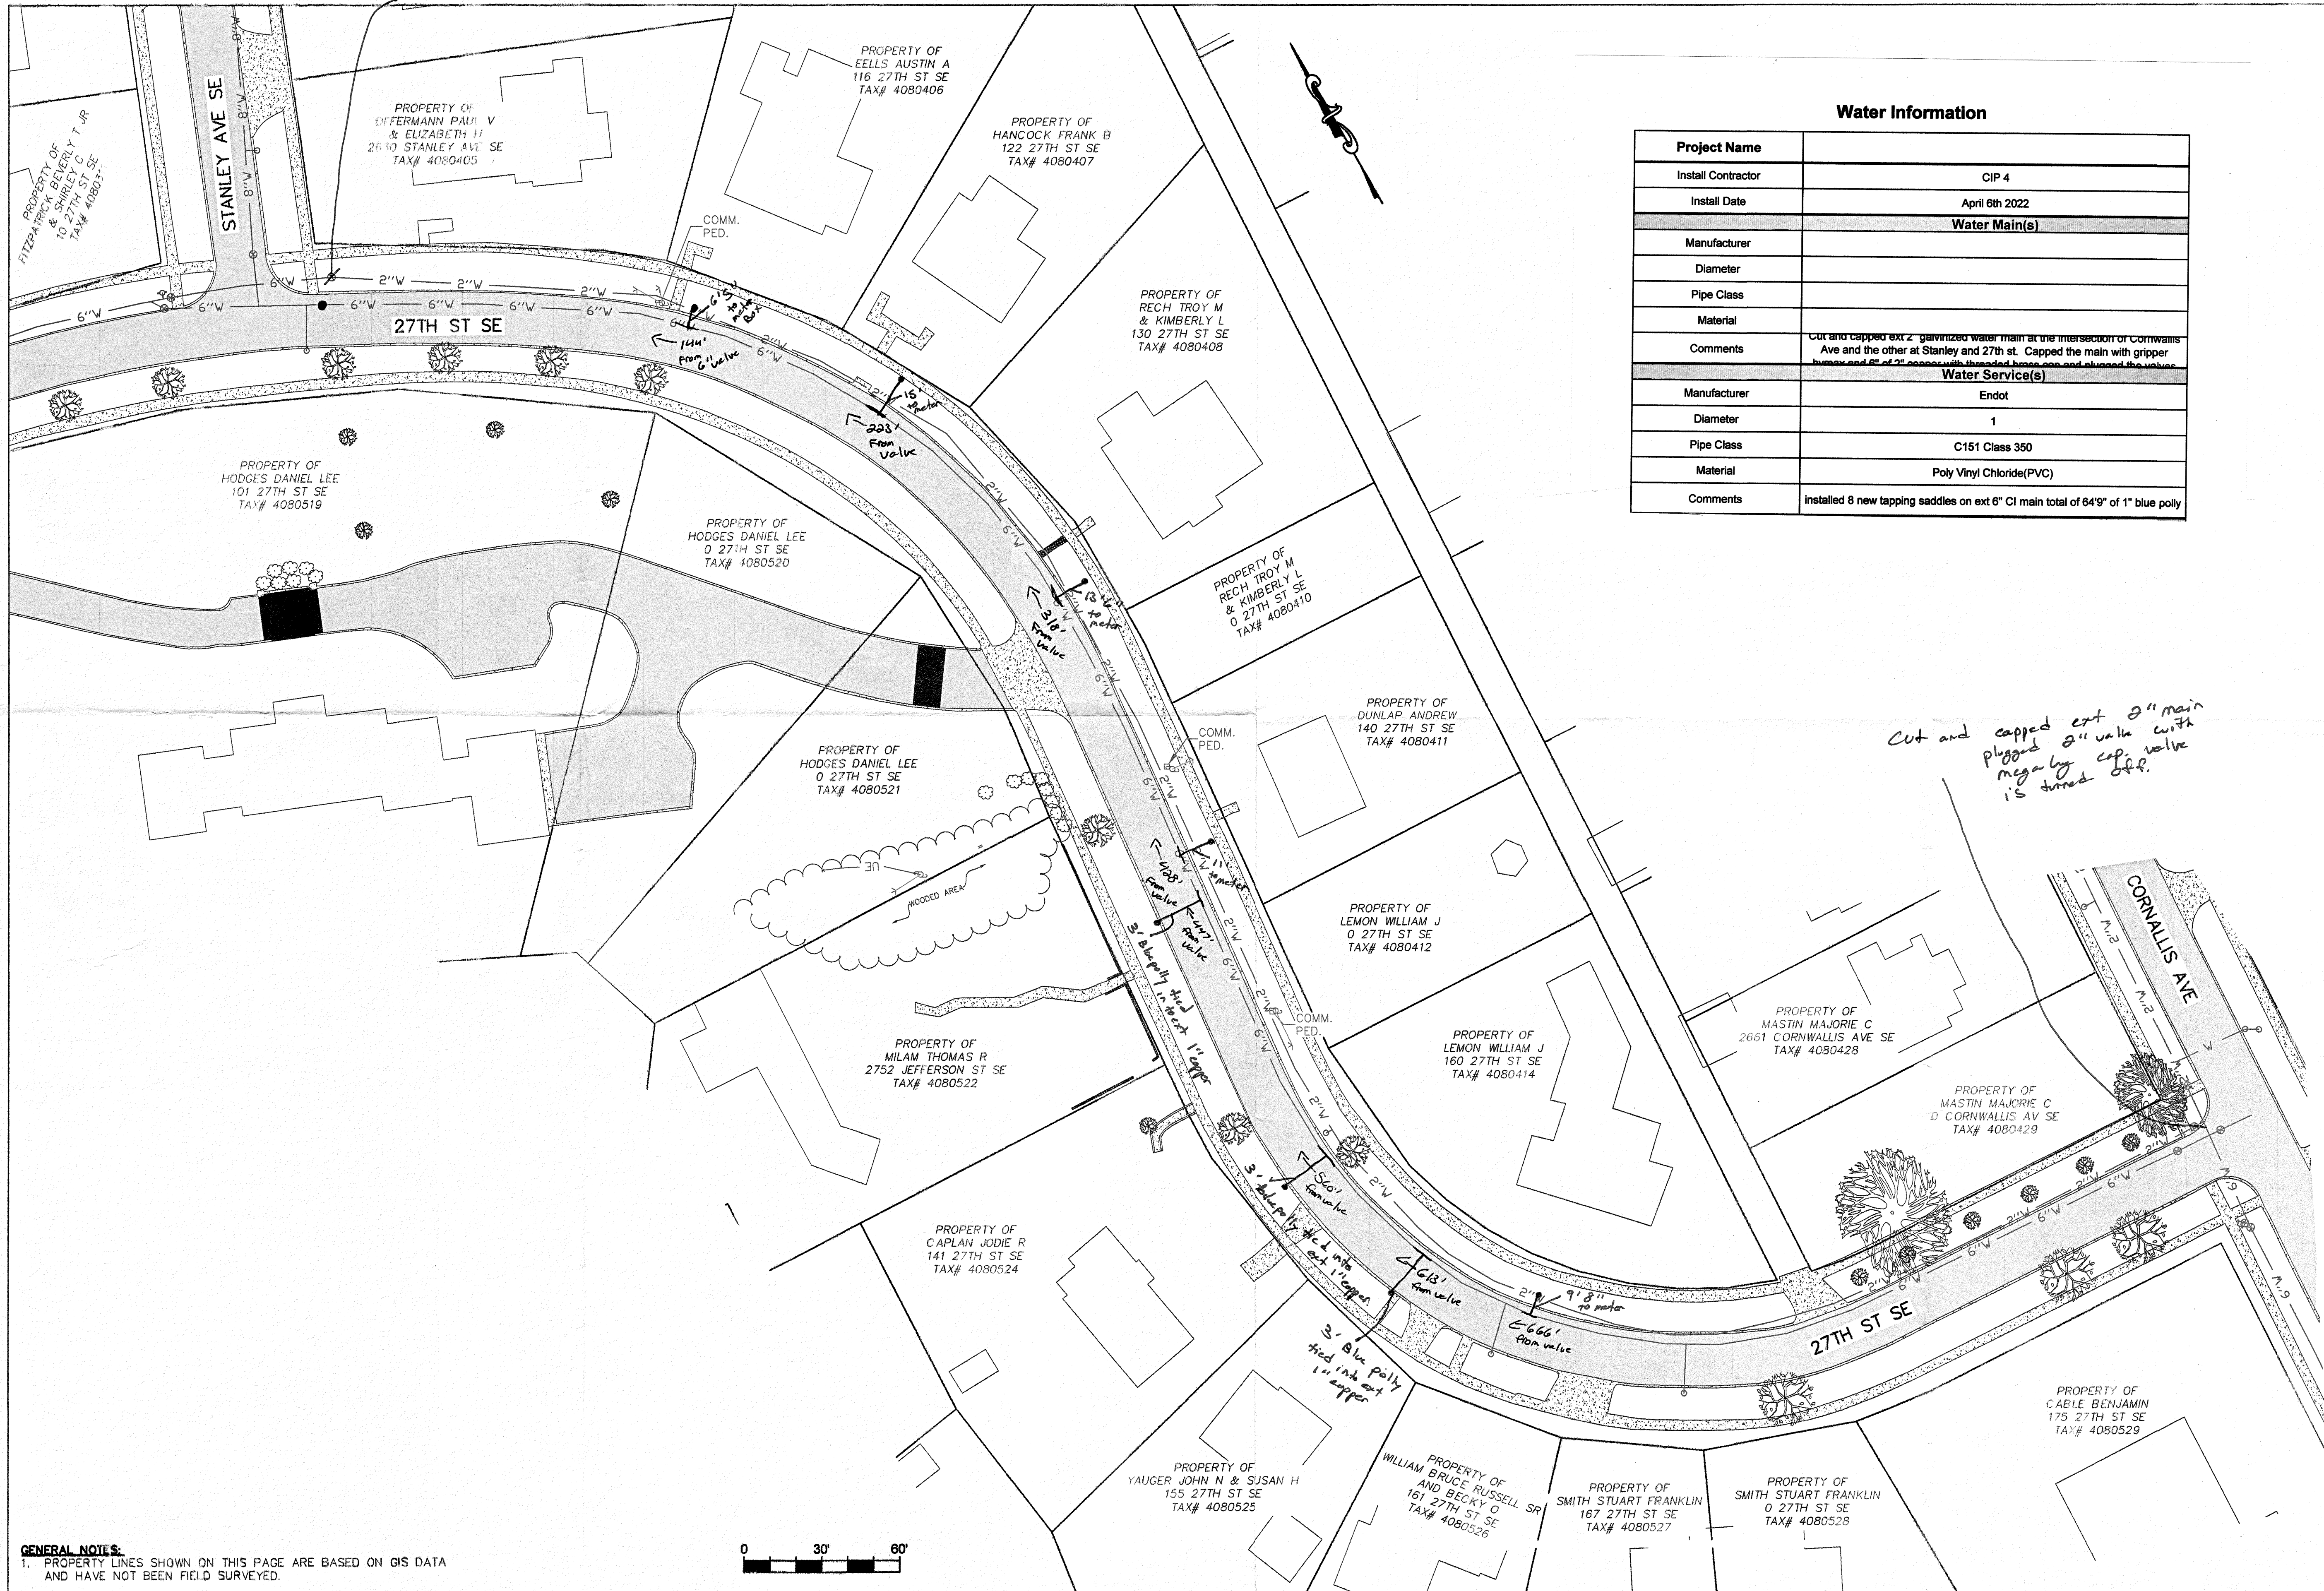

Water Information	
Project Name	
Install Contractor	CIP 4
Install Date	April 6th 2022
Water Main(s)	
Manufacturer	
Diameter	
Pipe Class	
Material	
Comments	Cut and capped ext 2" galvanized water main at the intersection of Cornwallis Ave and the other at Stanley and 27th st. Capped the main with gripper hump and 8" of 2" concrete with threaded hump cap and plugged the valve.
Water Service(s)	
Manufacturer	Endot
Diameter	1
Pipe Class	C151 Class 350
Material	Poly Vinyl Chloride(PVC)
Comments	installed 8 new tapping saddles on ext 8" CI main total of 64'9" of 1" blue poly

Cut and capped ext 2" main
plugged 2" valve with
megalyz cap. valve
is turned off.

GENERAL NOTES:
1. PROPERTY LINES SHOWN ON THIS PAGE ARE BASED ON GIS DATA AND HAVE NOT BEEN FIELD SURVEYED.

WESTERN VIRGINIA
WATER AUTHORITY
ENGINEERING SERVICES
601 S JEFFERSON ST, SUITE 300
ROANOKE, VA 24011
540-853-5700

BASEMAP

27th ST SE 2" WATERLINE
ABANDONMENT

BASEMAP

Rev	Description	Date	By

Designed: N/A
Drawn: AJC, NSS
Checked: NSS
Approved:
Date: April 2022
Project:
1
Sheet 1 of 1