


SECTION - ELEVATION

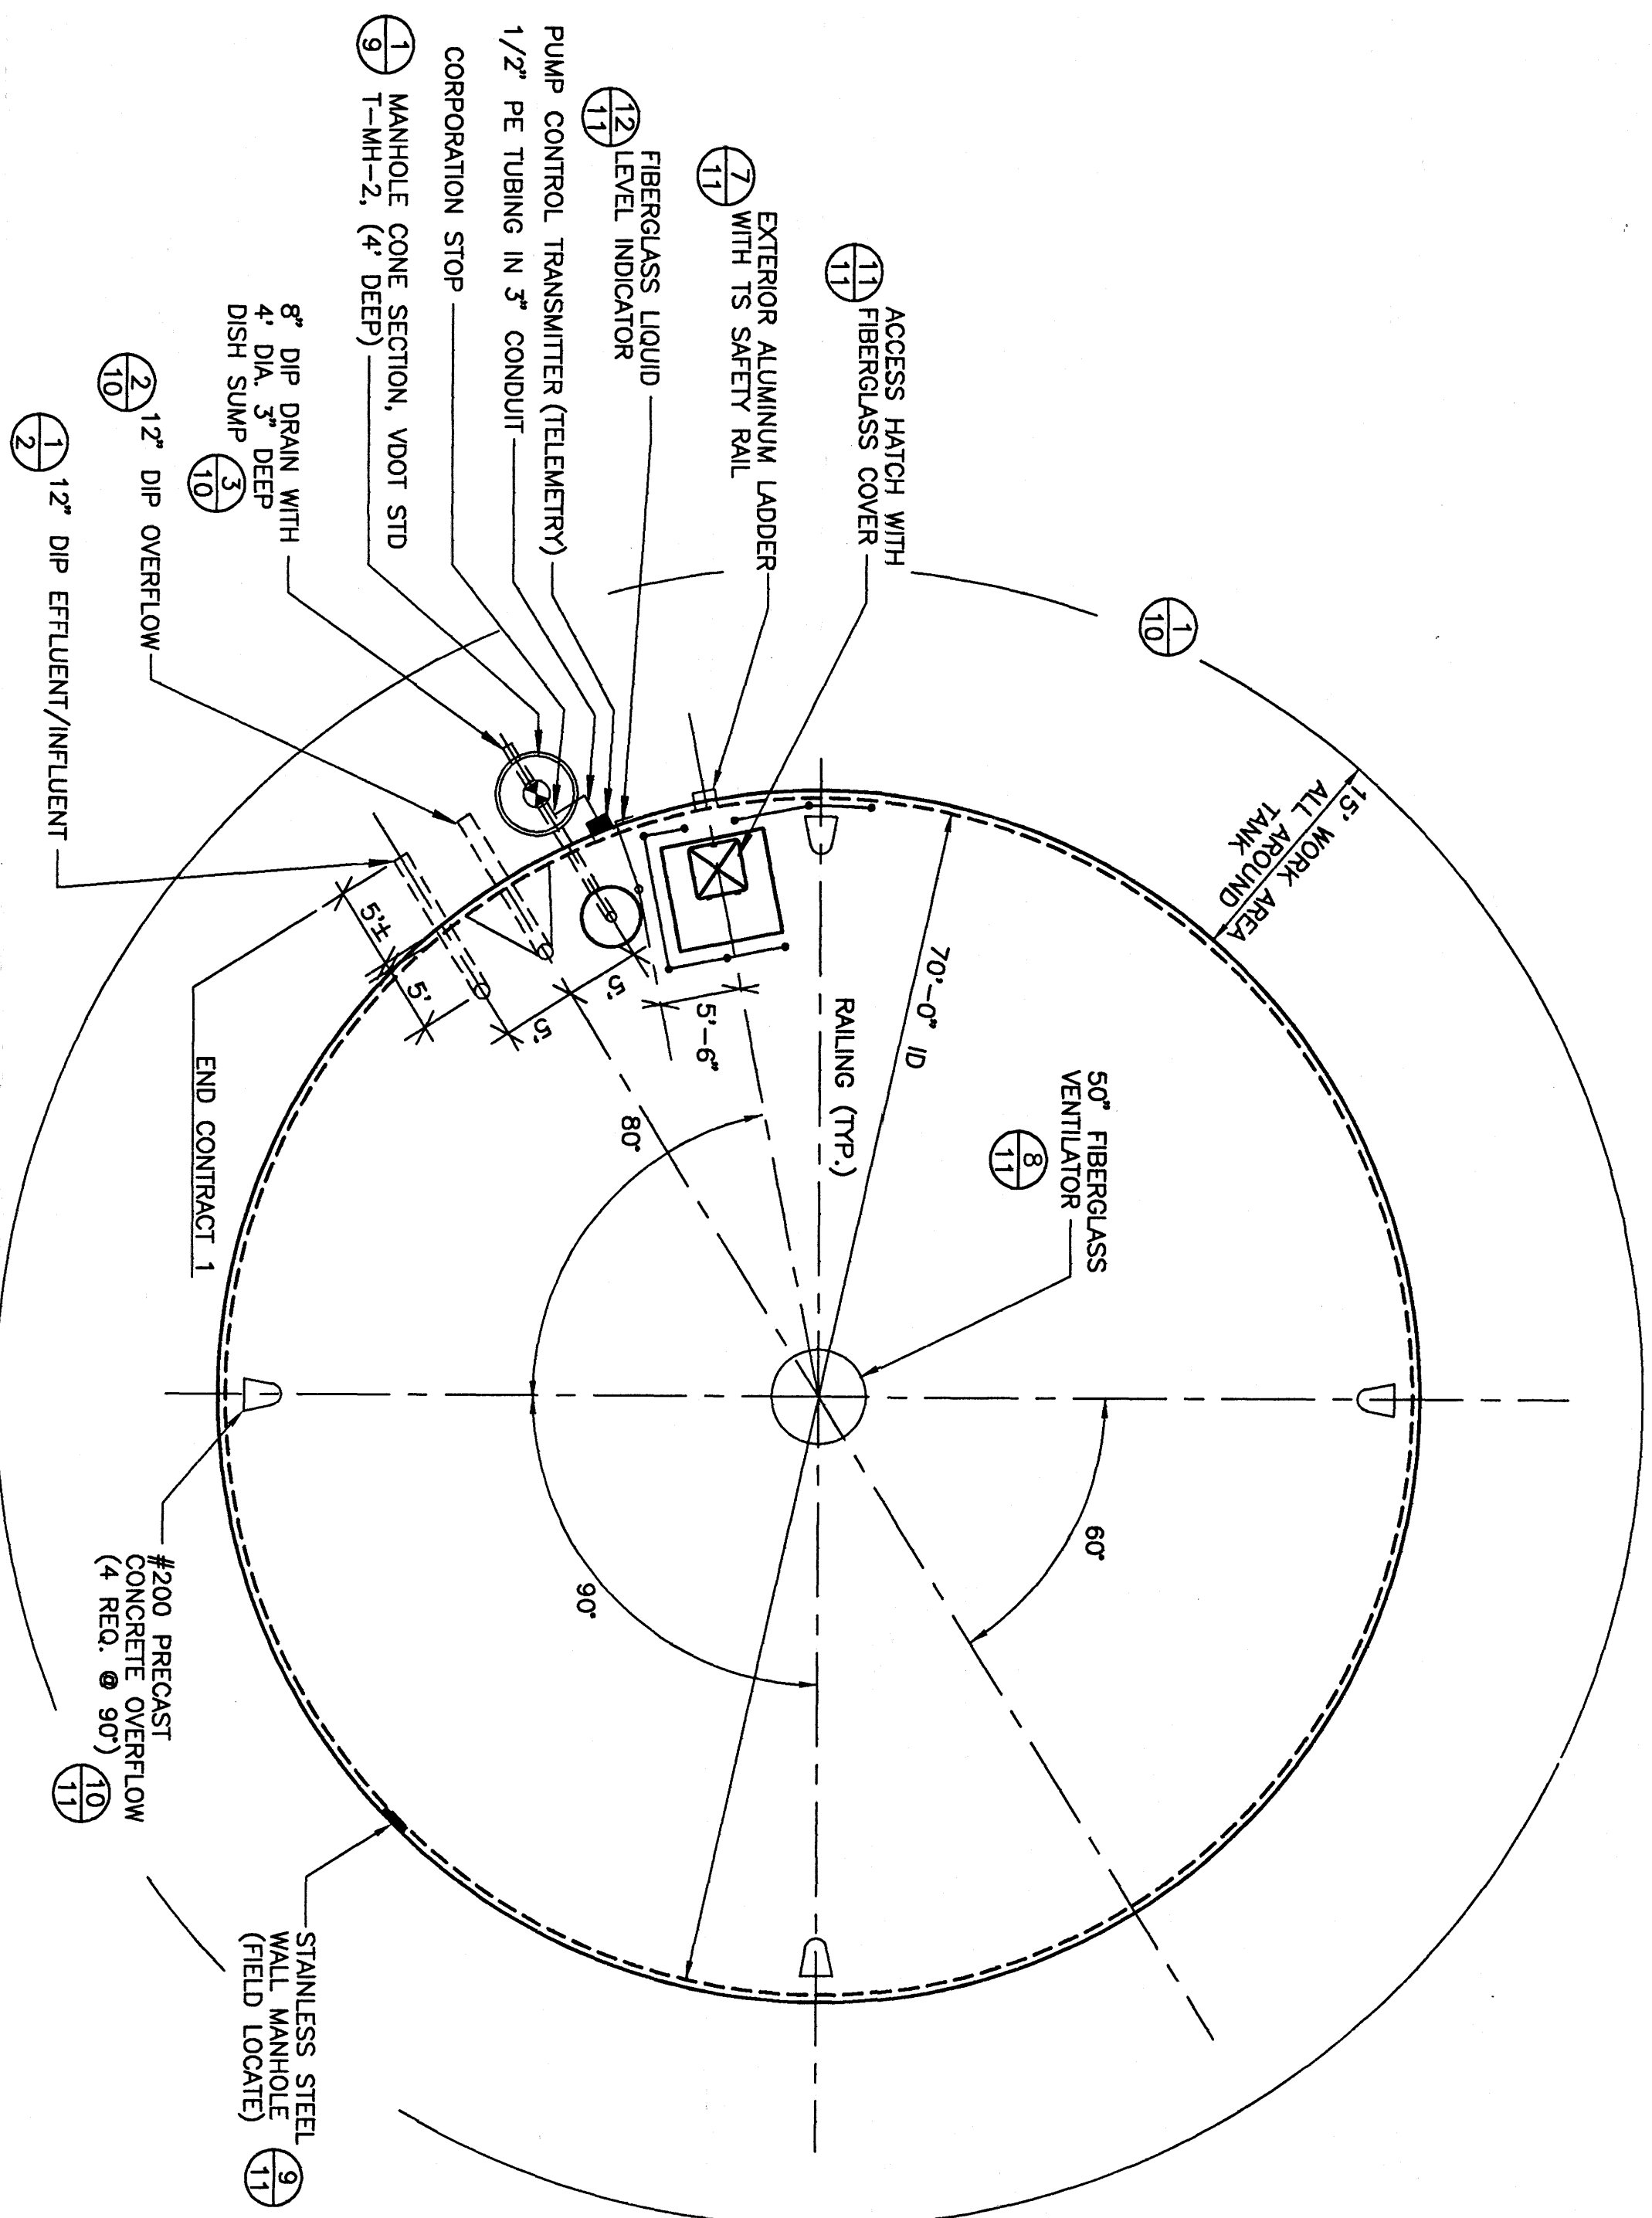


NOTE: FIELD VERIFY ALL ACCESSORY & PIPE LOCATIONS WITH ENGINEER PRIOR TO PLACEMENT.

PLAN


N.T.S.

- NOTES:
1. SHOTCRETE SHALL BE APPLIED BY OR UNDER DIRECT SUPERVISION OF AN INSPECTOR CERTIFIED IN ACCORDANCE WITH A.C.I. 308.1R-90.
 2. TENSION IN PRESTRESSING WIRE SHALL BE MEASURED BY AN ELECTRONIC DIRECT-READING STRESSMETER ACCURATE TO WITHIN 1%.

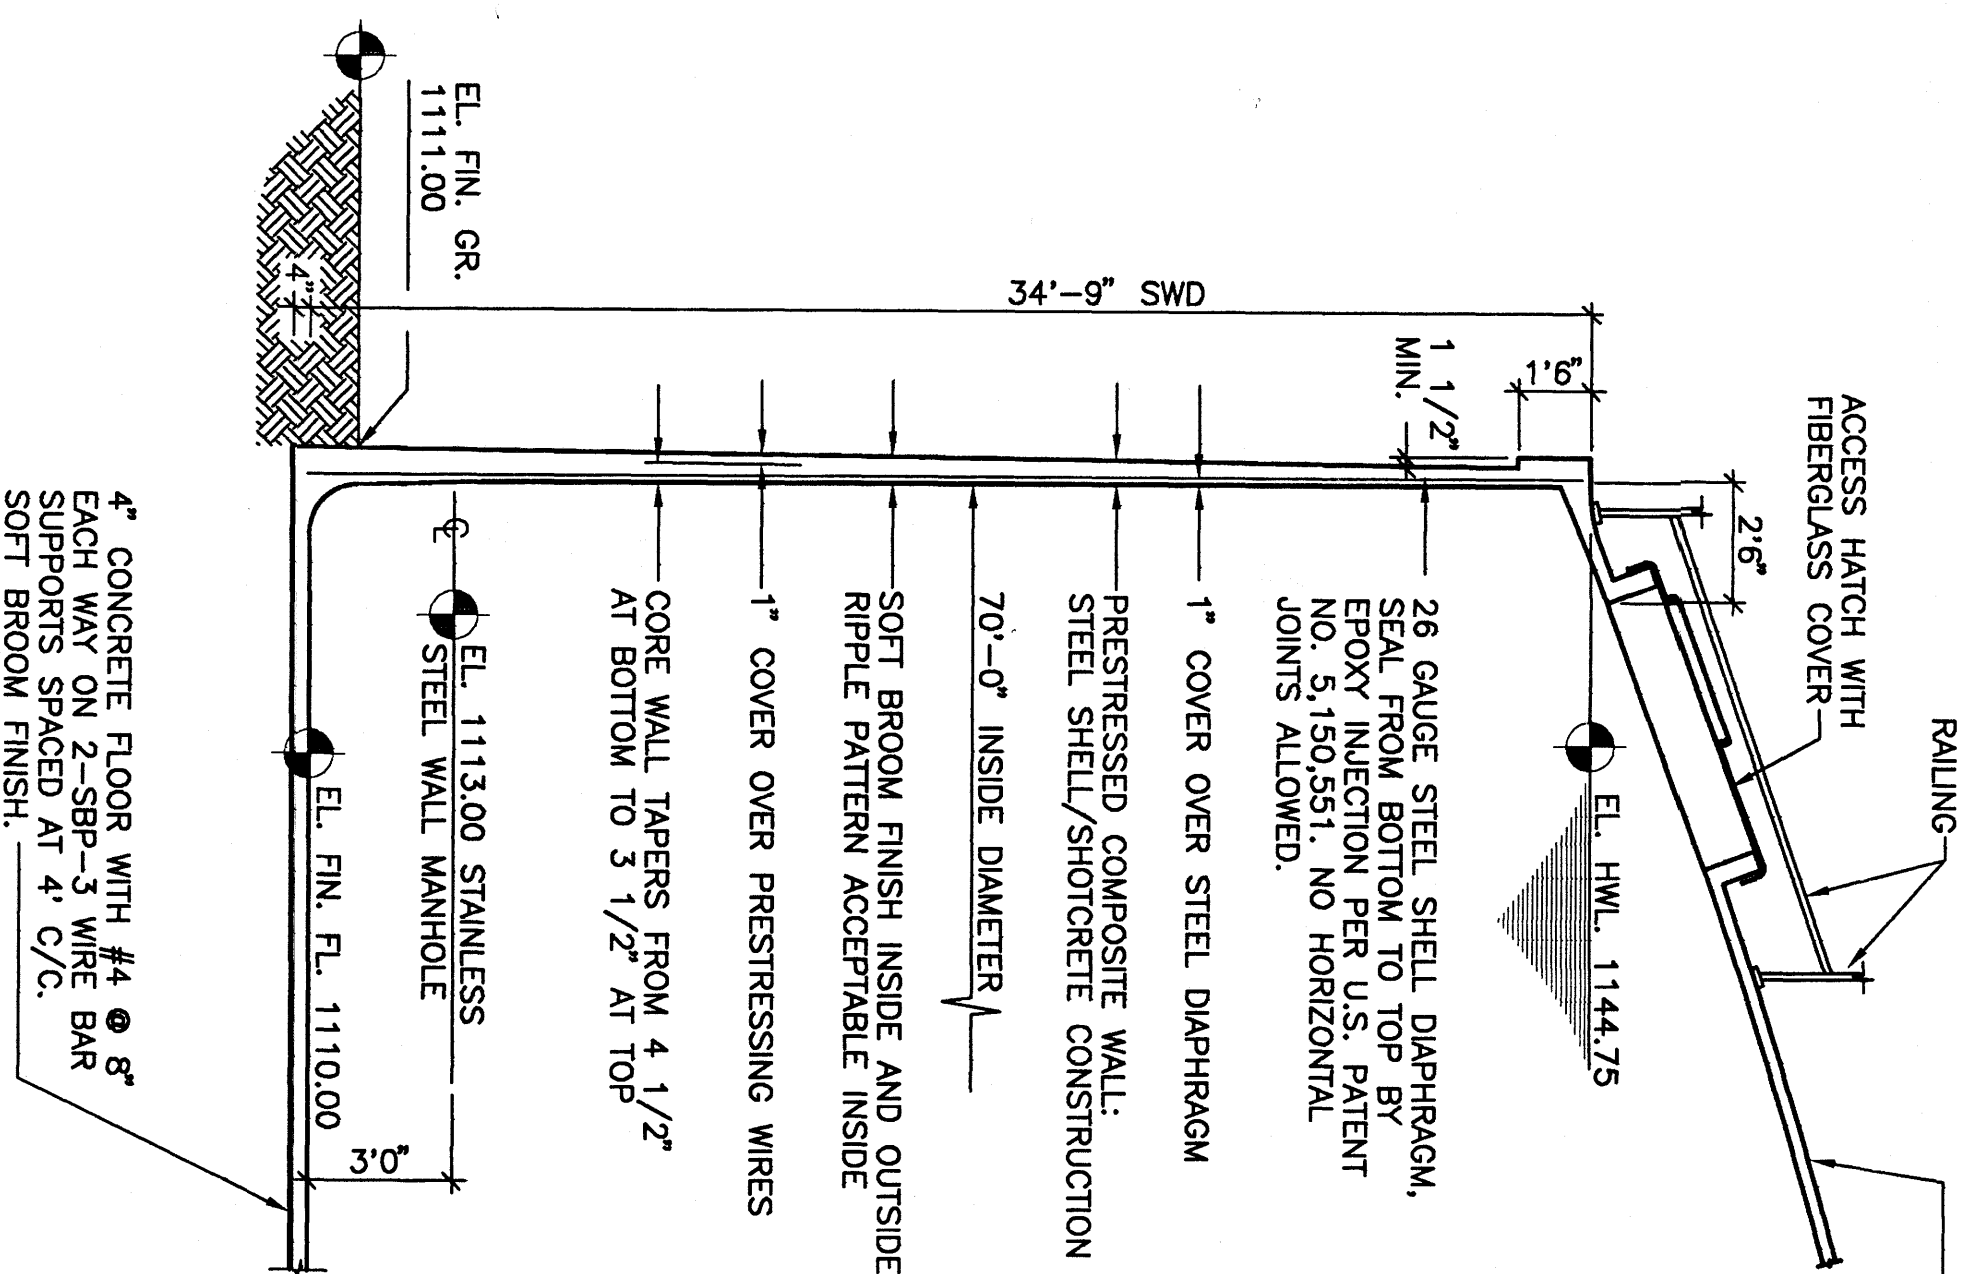

TYPICAL WALL DETAIL

N.T.S.

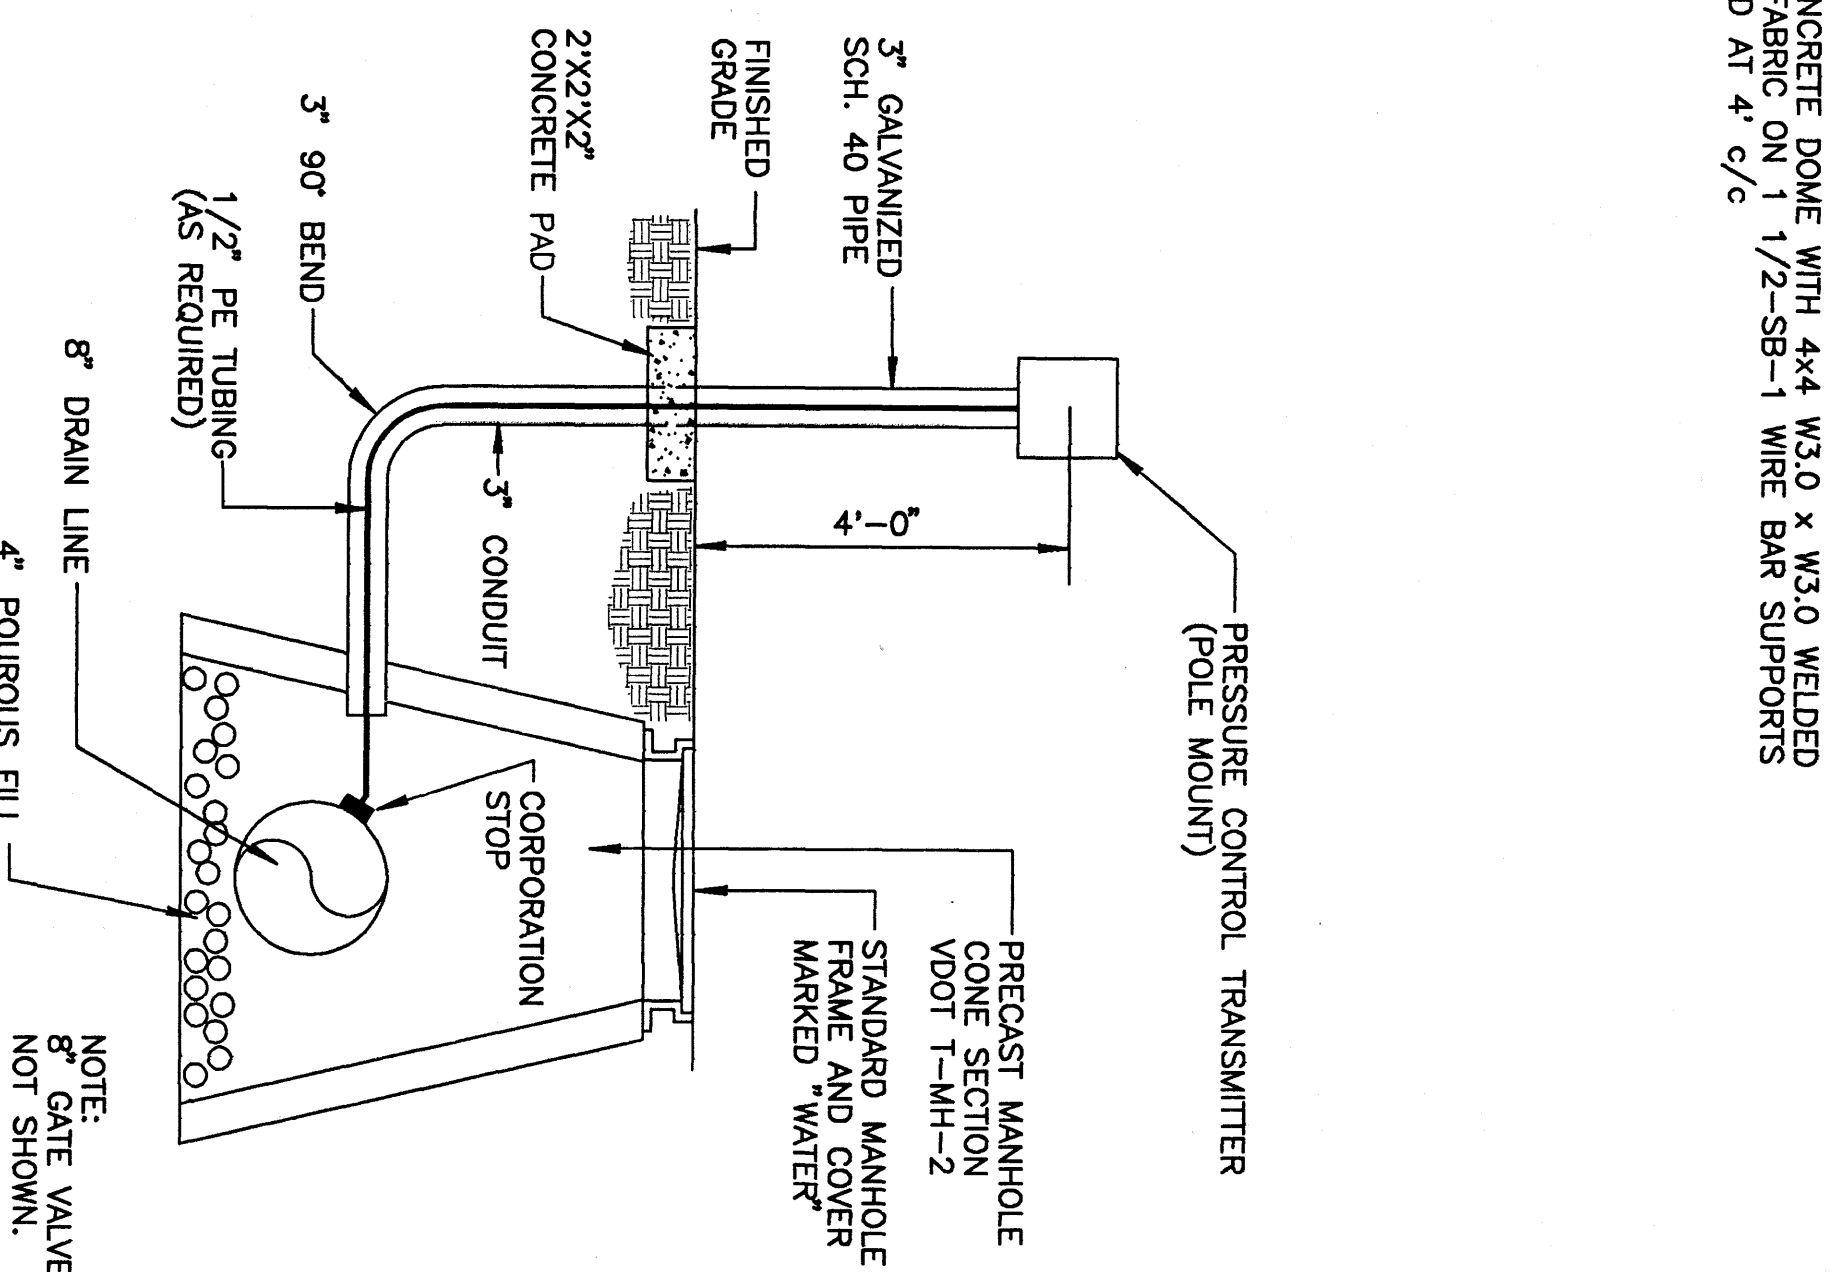

PRESSURE CONNECTION DETAIL

N.T.S.



REV	DATE	TELEMETRY	TAM	SWH
Δ	5/30/96			

DSGN	DATE	TELEMETRY	TAM	SWH
NNW/TAM				

DRAWN	DATE	TELEMETRY	TAM	SWH
TAM				

CHKD	DATE	TELEMETRY	TAM	SWH
SMH				

TANK DETAILS

TOWN OF VINTON, VIRGINIA



SCALE: AS SHOWN

DATE: MAY, 1996

SHEET 9

COMM. NO. 1485B

ISSUED 1/14/85/8