
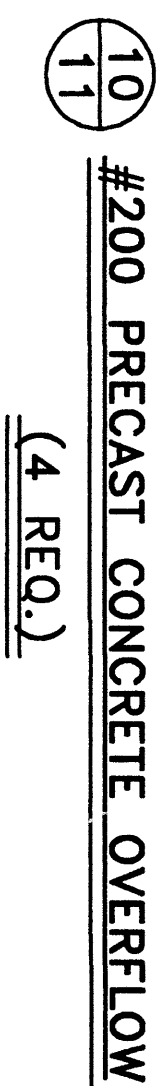


STAINLESS STEEL WALL MANHOLE

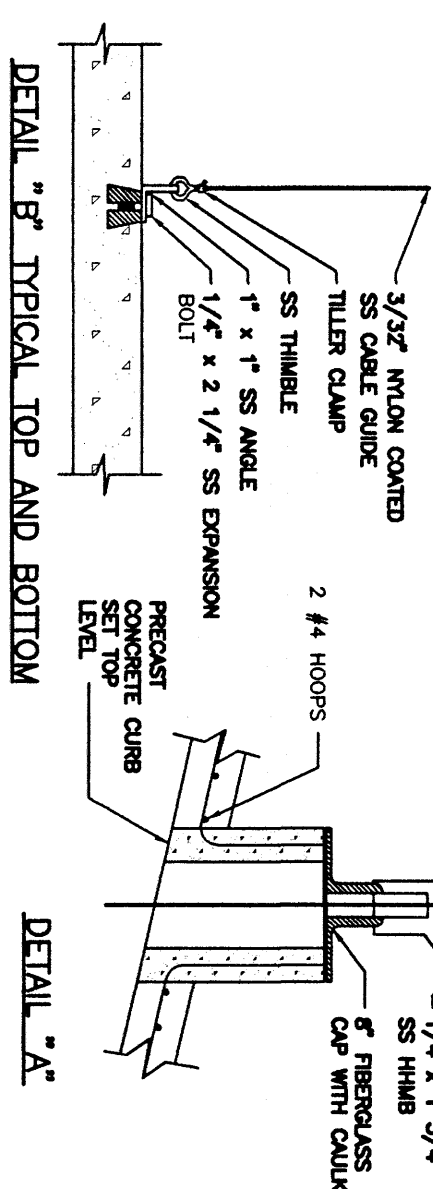

NOTES: 1. ALL TUBULAR MATERIAL TO BE NOMINAL DIAMETER SCHEDULE 40 ALUMINUM PIPE 6061-T6.

2. PLATES AND GUSSETS TO BE STRUCTURAL GRADE ALUMINUM 6061-T6.

3. PROVIDE CLAMP PREVENTION SHIELD AS DETERMINED ON SHEET 12

(12)
11

FIBERGLASS LIQUID LEVEL INDICATOR

REV	DATE	DESCRIPTION	BY	APP

TANK DETAILS

TOWN OF VINTON, VIRGINIA

SCALE: AS SHOWN	1485B
NO.	

DATE: MAY, 1996 SHEET 11

DRAWING # 1485B/11