




NOTES:

1. ALL ELECTRICAL WORK IN THIS AREA SHALL CONFORM TO NFPA 70 (NEC) CLASS 1, DIVISION 2, GROUP D EXPLOSIVE ATMOSPHERE. PROVIDE SEALS AND EQUIPMENT RATED FOR AREA.
2. ELECTRICAL SIZING FOR ALL PUMPS ARE BASED ON 10 HORSEPOWER. CONTRACTOR TO COORDINATE WITH AKZO NOBEL FOR FINAL HORSEPOWER.

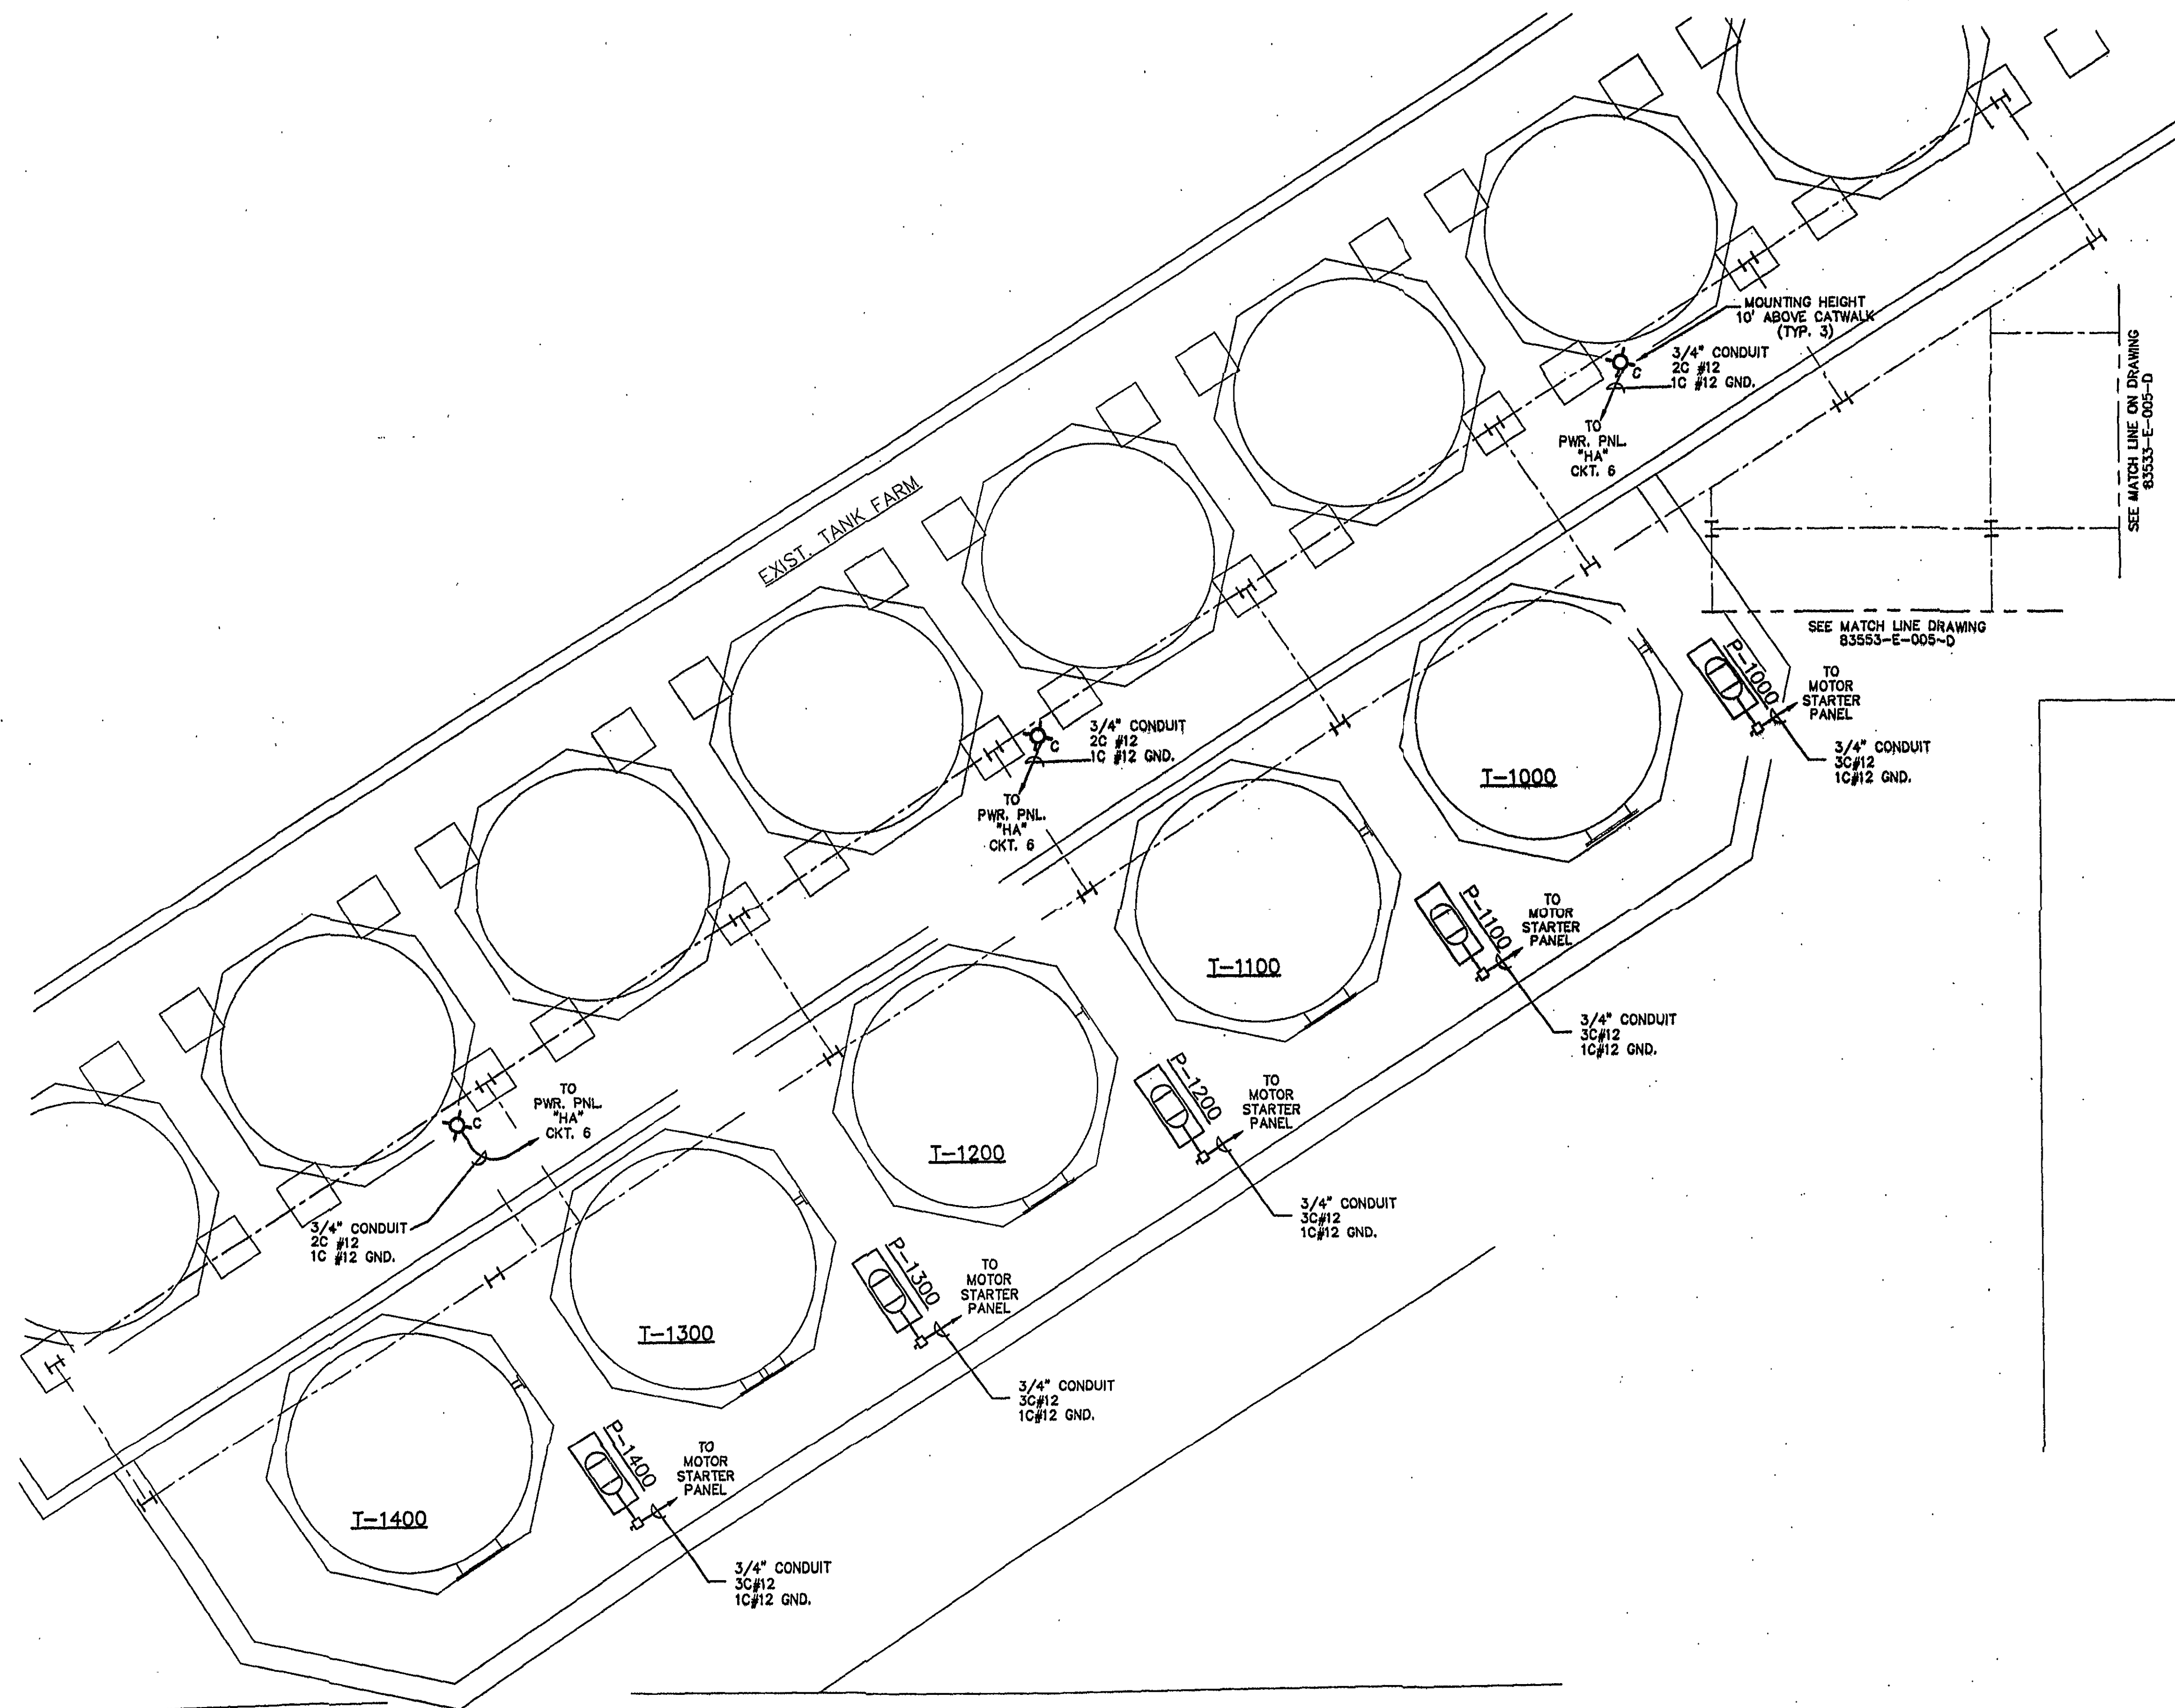

BUILDING 10



O ISSUED FOR CONSTRUCTION		DCD	5/01/03	
REV	DESCRIPTION	BY	DATE	APPROVAL
THIS DRAWING IS THE PROPERTY OF PENTA, INC. THE INFORMATION CONTAINED HEREON MAY NOT BE USED OR COPIED IN ANY MANNER WITHOUT THE WRITTEN PERMISSION OF THE OWNER.				
SCALE	1/4" = 1'-0"	DATE	4/04/03	
DESIGNED BY	D.C. DOBROWSKI	DATE	4/04/03	
DRAWN BY	J.D. HELMS	DATE	4/11/03	
CHECKED BY	K.G. LEPPERT	DATE		
APPROVAL	M.G. MOTT	PROJECT NO.	83533	
CAD FILE NUMBER	533E007D.dwg	CLIENT NO.	83533-E-007-D	0