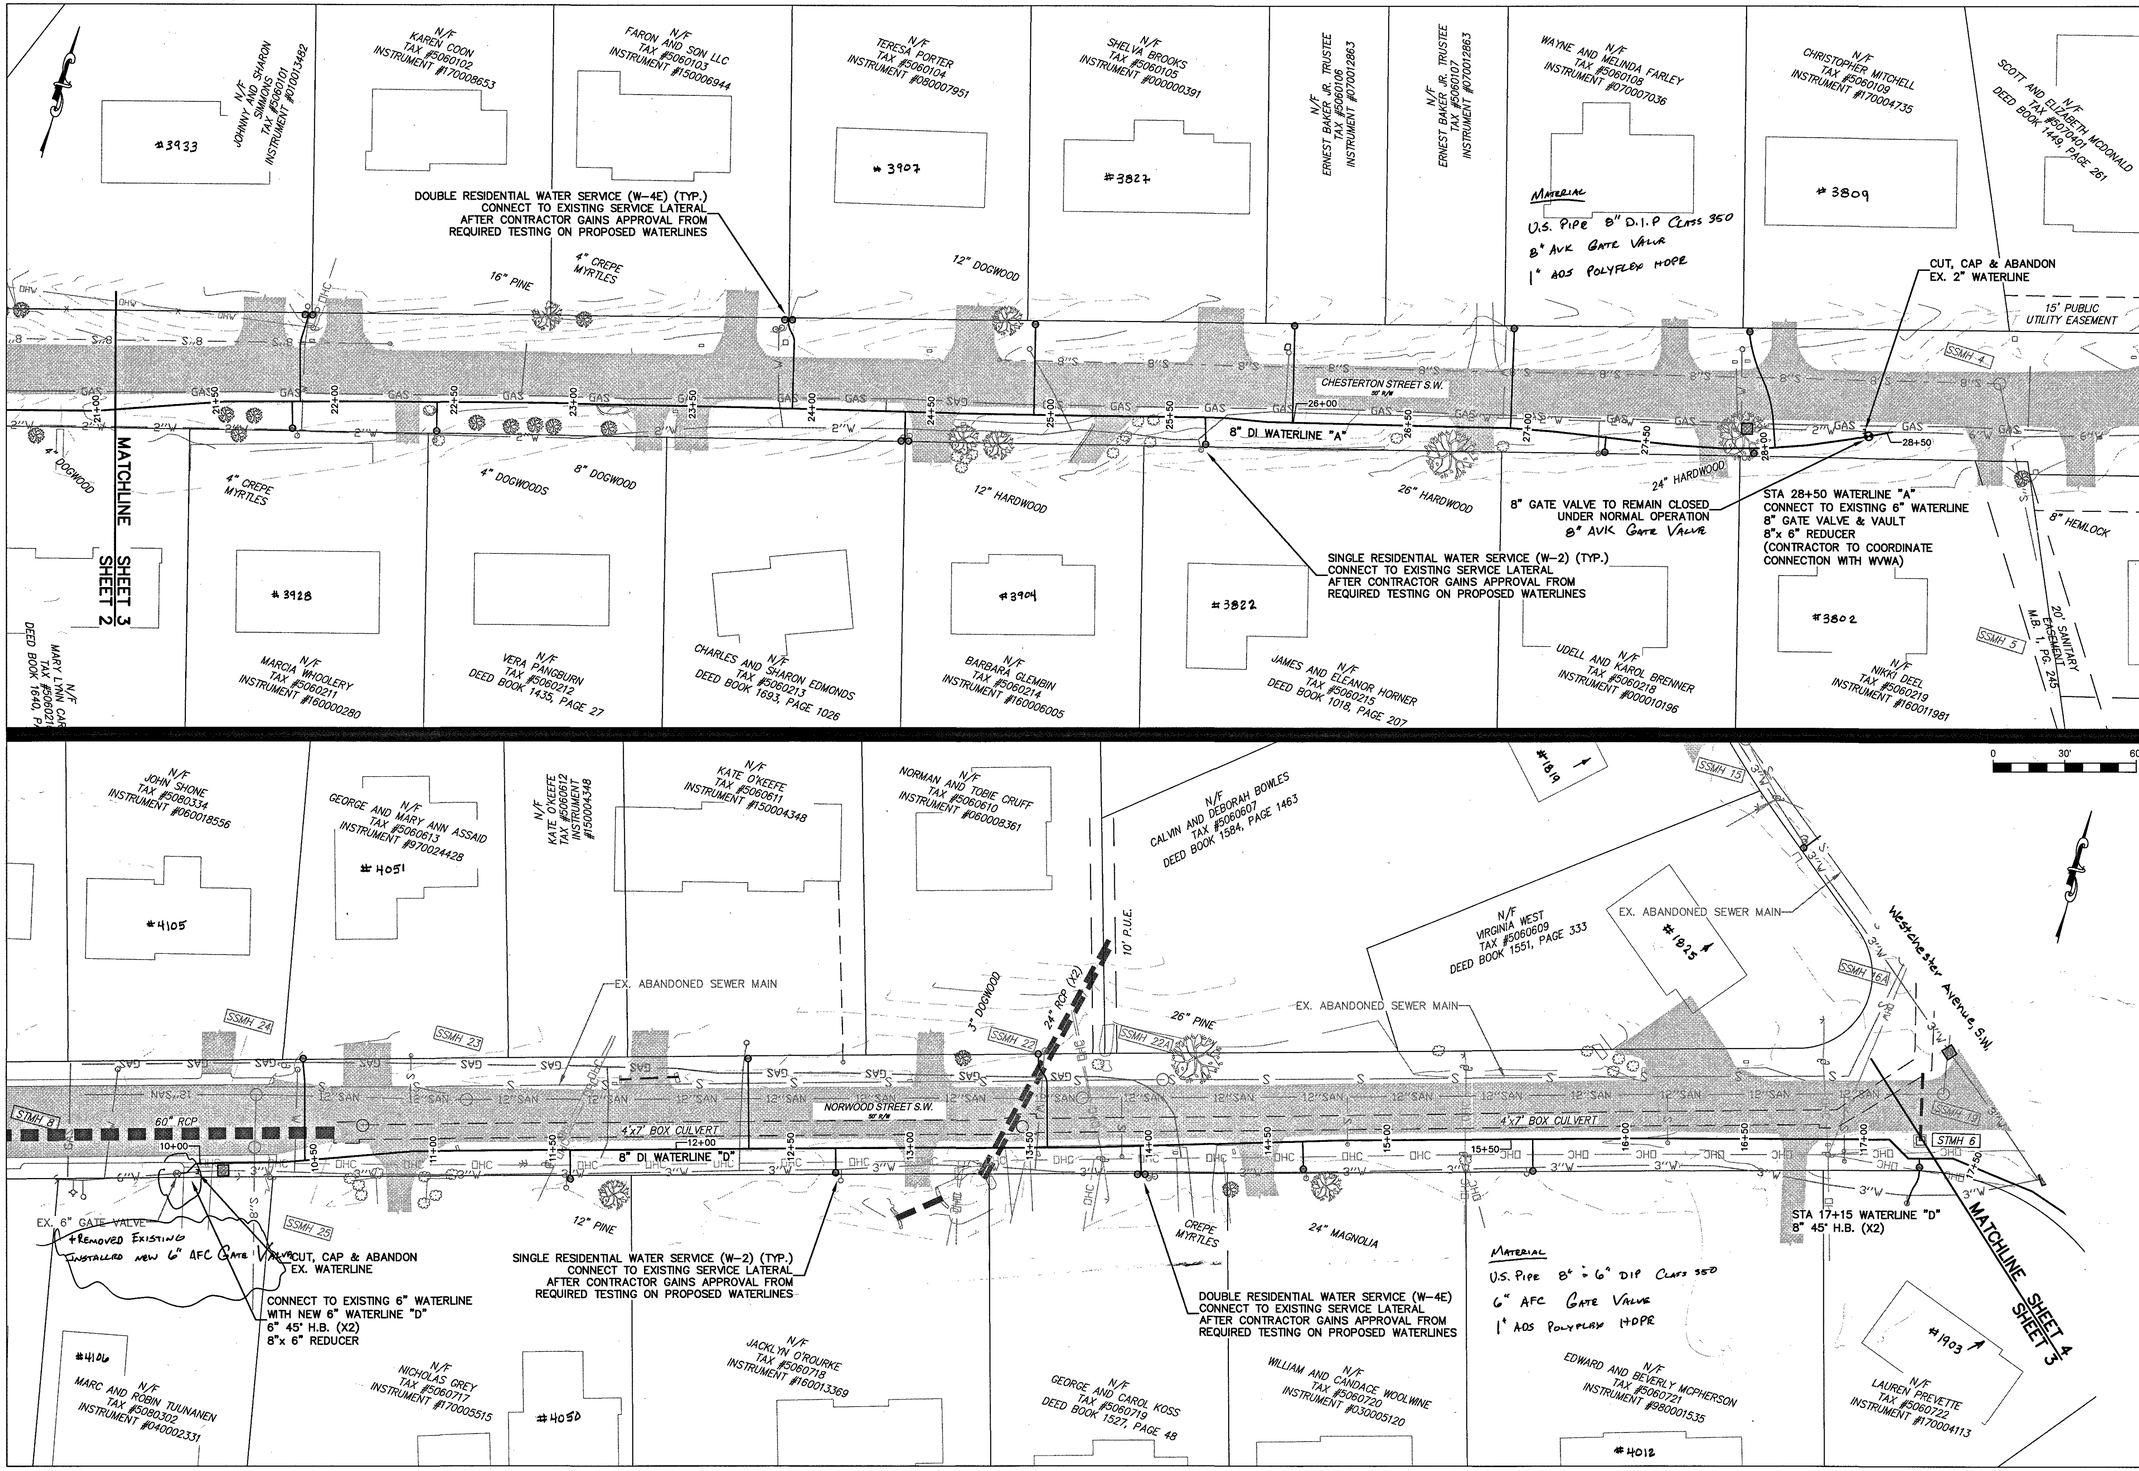

Material
U.S. Pipe 8" D.I.P Class 350
8" AVK Gate Valve
1" AOS Polyflex HDPE

Material
U.S. Pipe 8" & 6" DIP Class 350
6" AFC Gate Valve
1" AOS Polyflex HDPE

WESTERN VIRGINIA
WATER AUTHORITY
ENGINEERING SERVICES
601 S JEFFERSON ST, SUITE 300
ROANOKE, VA 24011
540-853-5700

COMMONWEALTH OF VIRGINIA
W. NICHOLAS SORRENTSO
Lic. No. 040205204
4/10/18
PROFESSIONAL ENGINEER

AMBER WAY WATERLINE REPLACEMENT

PLAN

Rev	Description	Date	By

Designed: DRJ
Drawn: DRJ
Checked: WNR, NSS
Approved: WNR
Date: 4/10/18
Project: CIP-016/199

3
Sheet 3 of 8