


VALVE.

-CONTROLS-

HOSE HOUSE

- LOCATION -

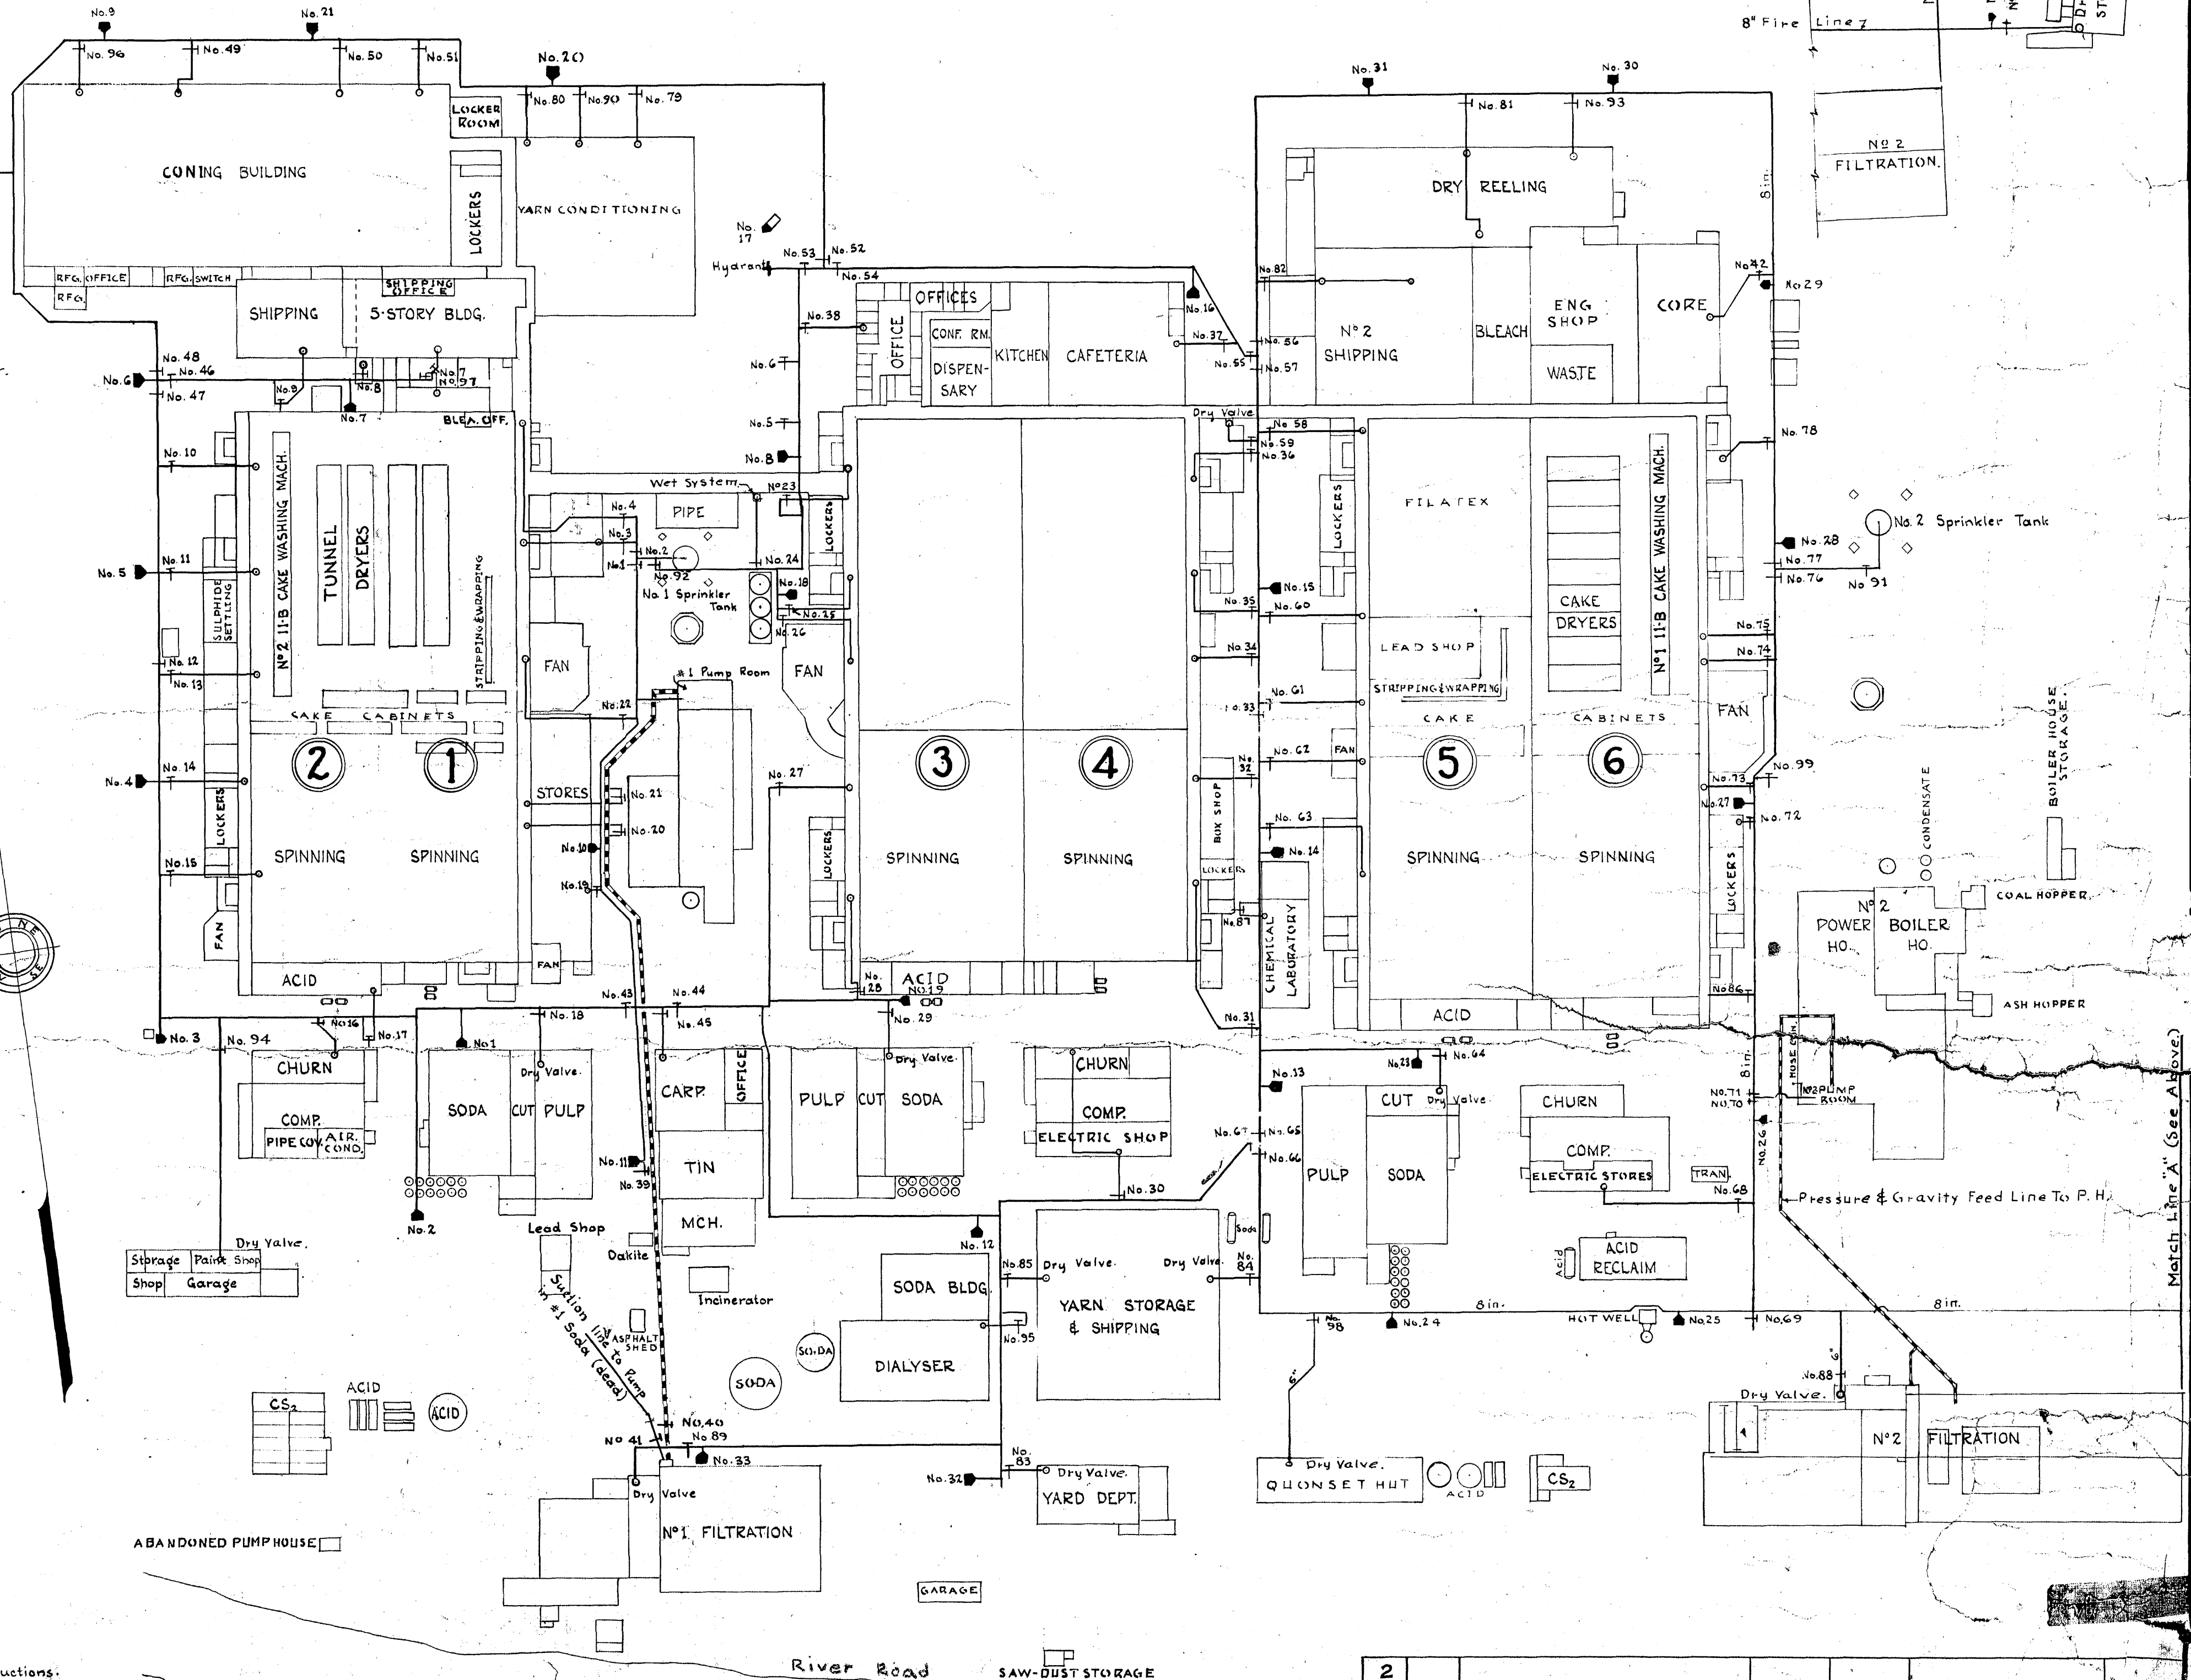

五、

-  Underground Fire Lines.
-  Underground Fire Pump Suctions.
-  Post Indicator Valves.
-  Hose Houses.
-  Hydrants.
-  Risers.
-  4" Domestic Water Line (Abandoned).
-  Gravity Feed Line To Power House.

ALL P.I.V.'S EXCEPT THOSE MARKED G.V., WHICH ARE GATE VALVES. THE VALVES MARKED WITH AN ASTERISK (*) ARE TO BE KEPT OPEN IN SUMMER AND CLOSED IN WINTER.

ROANOKE RIVER

River Road SAW-DUST STORAGE

REVISIONS

2							
1							
ITEM NO.	NO. REQ'D	ITEM	MAT'L	PATT. NO.	REMARKS	MAT'L ORIGIN	
STARTED	W. R. Bishop	6-1-42	AMERICAN VISCOSE CORPORATION PLANT ENG'R OFFICE ROANOKE, VIRGINIA UNDERGROUND FIRE SYSTEM				
FINISHED	W. R. Bishop	6-10-42					
CHECKED	Chas. M. Perkins	7-6-42					
APP'D	Geo. A. Weaver	7-6-42					
APP'D	J. P. McNeill	7-6-42					
APP'D							
SUPERSEDES	R-586-B-5		DEPT. GENERAL PLANT ROANOKE				
SUPERSEDED BY			SCALE 1"=100 FT. DATE 7-2-42 NO. 2				

2. BY

BY APPD.

6 BROUGHT UP TO DATE &
VALVE NOS. REGROUPED.
BY W. Bishop 4-27-56 APPD. [Signature]

5 BROUGHT UP TO DATE.

BY W.B. 11-24-54 APPD. 11/24/54

4 BROUGHT UP TO DATE.

BY W. B. 11-21-51 APPD *CD*

3 ADDED 6" LINE TO QUONSET HU
& P.I.V. N^o 160
BY JAMISON 8-3-51 APPD *cmc* 8/4

2 BROUGHT UP TO DATE
BY W.B. 3-8-50 APPD *Mc* 2-3-9-5

1 Brought Up To Date.

SUPERSEDES *R*
SUPERSEDED BY