
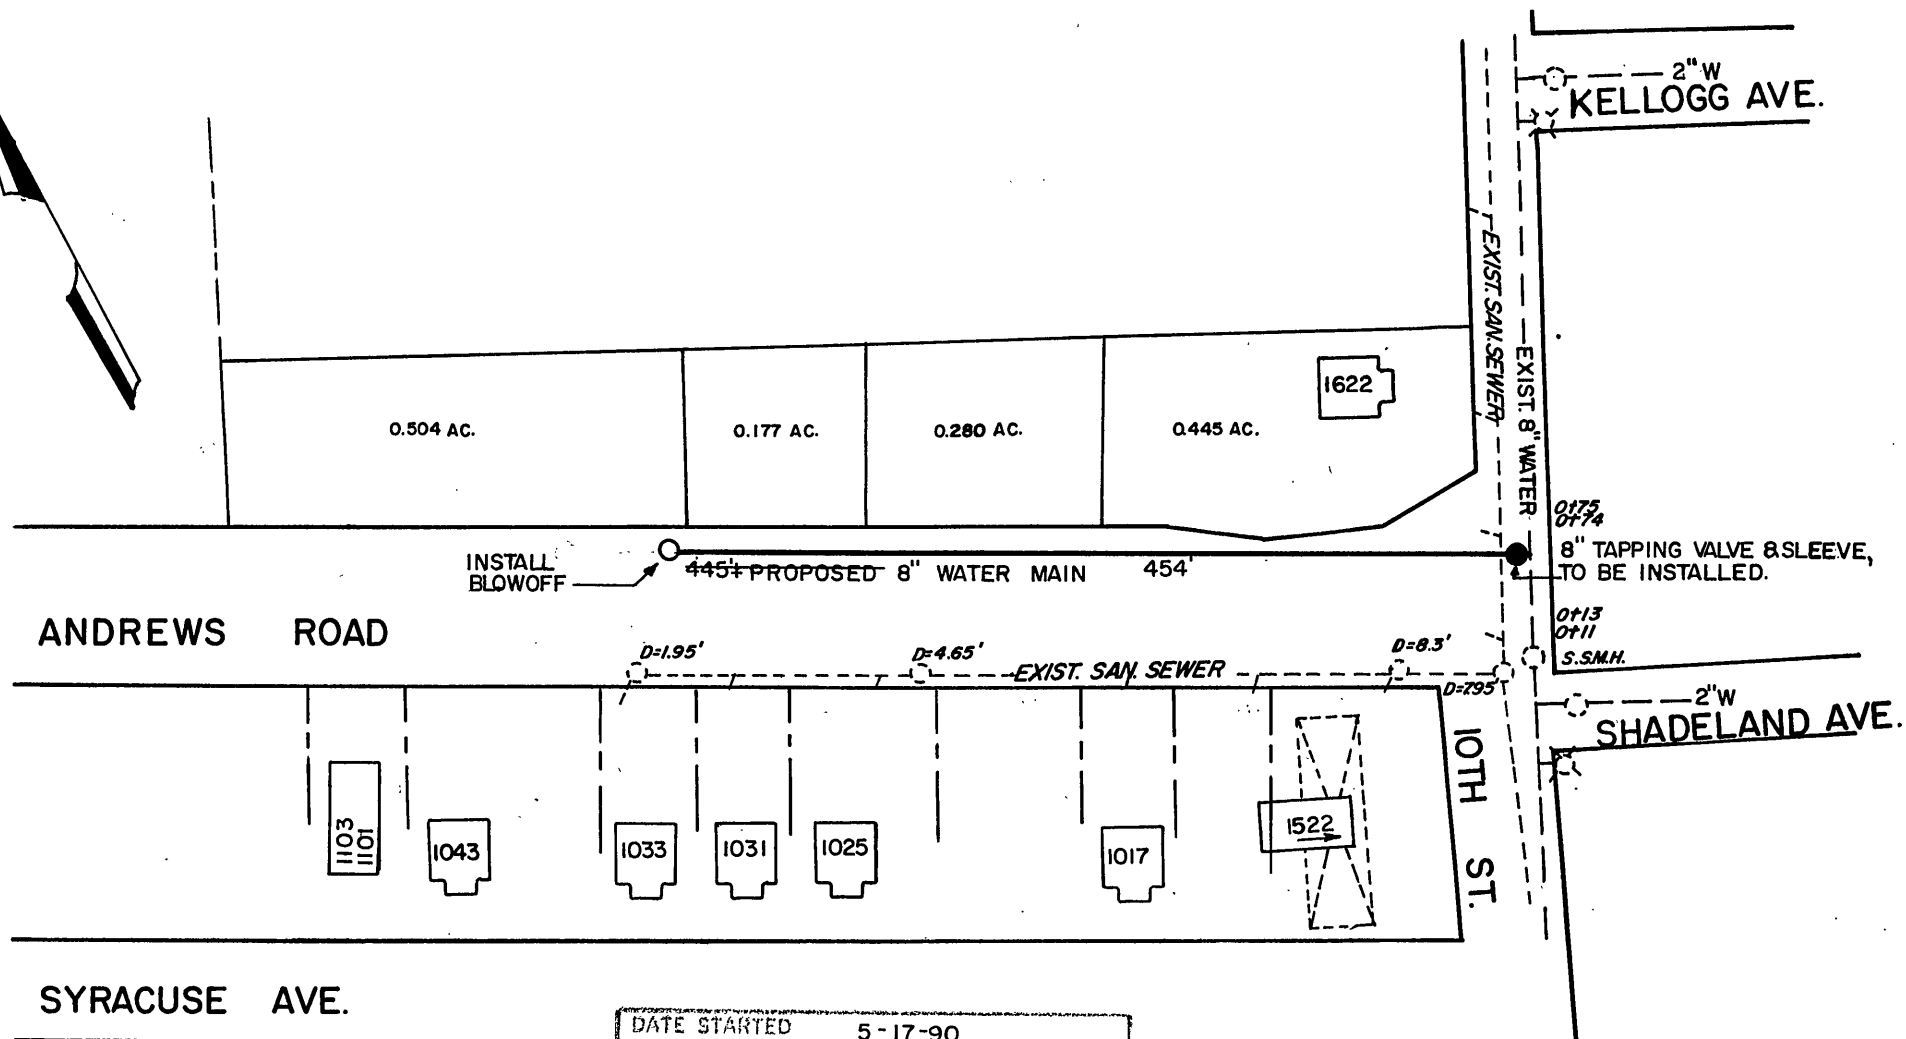


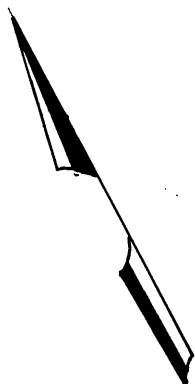

NOTE: ALL EXIST. UTILITIES SHALL BE ASCERTAINED IN THE FIELD PRIOR TO CONSTRUCTION.

John H. Palmer
MANAGER UTILITY LINE SERVICES

DATE STARTED	5-17-90				
DATE COMP.	5-24-90				
FEET MAIN	SIZE	VALVE	VAULT	BOX	
454'	8"	1		1	
BLOWOFF	2"	1			
F.H. COMP.	⊕				
F.H. STUB ONLY	⊕				
SERV. INS. BY:	⊕				
MAIN INS. BY:	C.O. DAME				
NO. 3/4" SERV. INS.	⊕				
CITY OR CO.	CITY				
DEPT. INSP.	U.L.S.				

WATER DEPARTMENT	
ROANOKE	VIRGINIA
ANDREWS ROAD, N.W. and 10TH STREET, N.W.	
<i>MCS.</i>	
SCALE: 1" = 100'	<i>Reit B. L.</i> 3/23/90
DATE: 3-14-90	DIRECTOR UTILITIES & OPERATIONS DATE
DIST. MAP: 213,205,223	<i>William J. Clark</i> 3/23/90
PLAN NO.: 90-01	DIRECTOR OF PUBLIC WORKS DATE