


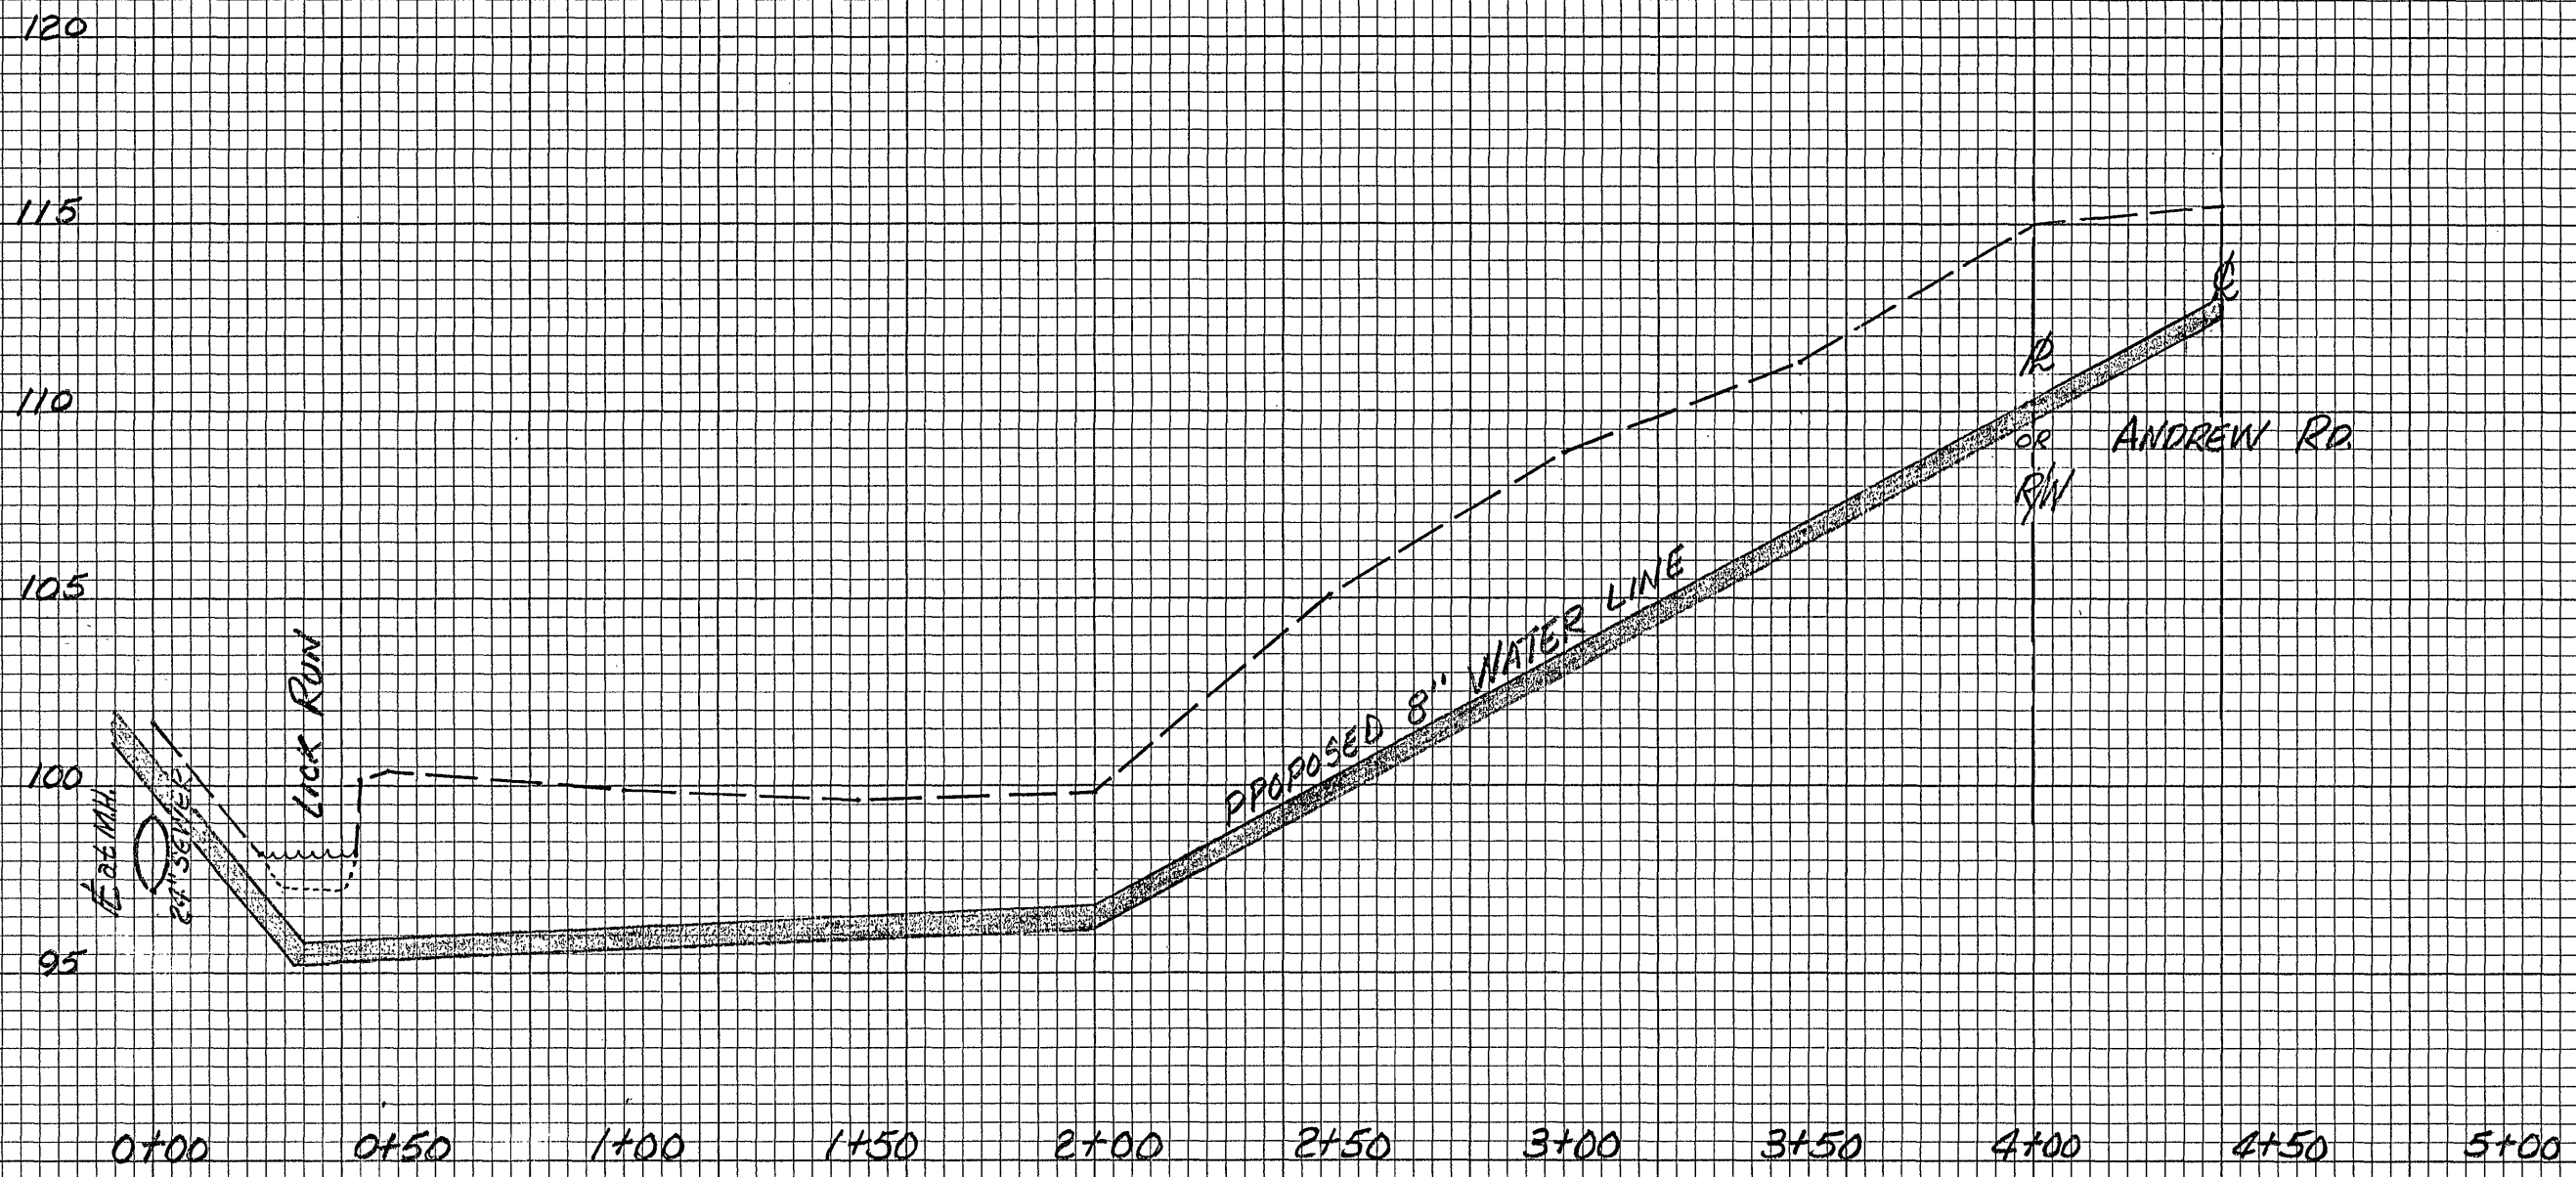

NOTE: MIN. 3' COVER
18" MIN. CLEARNESS BETWEEN
SEWER AND WATER

SCALE: VERT. 1" = 5'
HORIZ. 1" = 40'

PROFILE OF PROPOSED
WATER LINE ANDREWS RD.
TO SERVE 8.0 AC. TRACT ON
ROCKLAND AVE. N.W.

JULY 25, 1977 F.B. 608 PG. 57

Sheet 2 of 2

77-10