



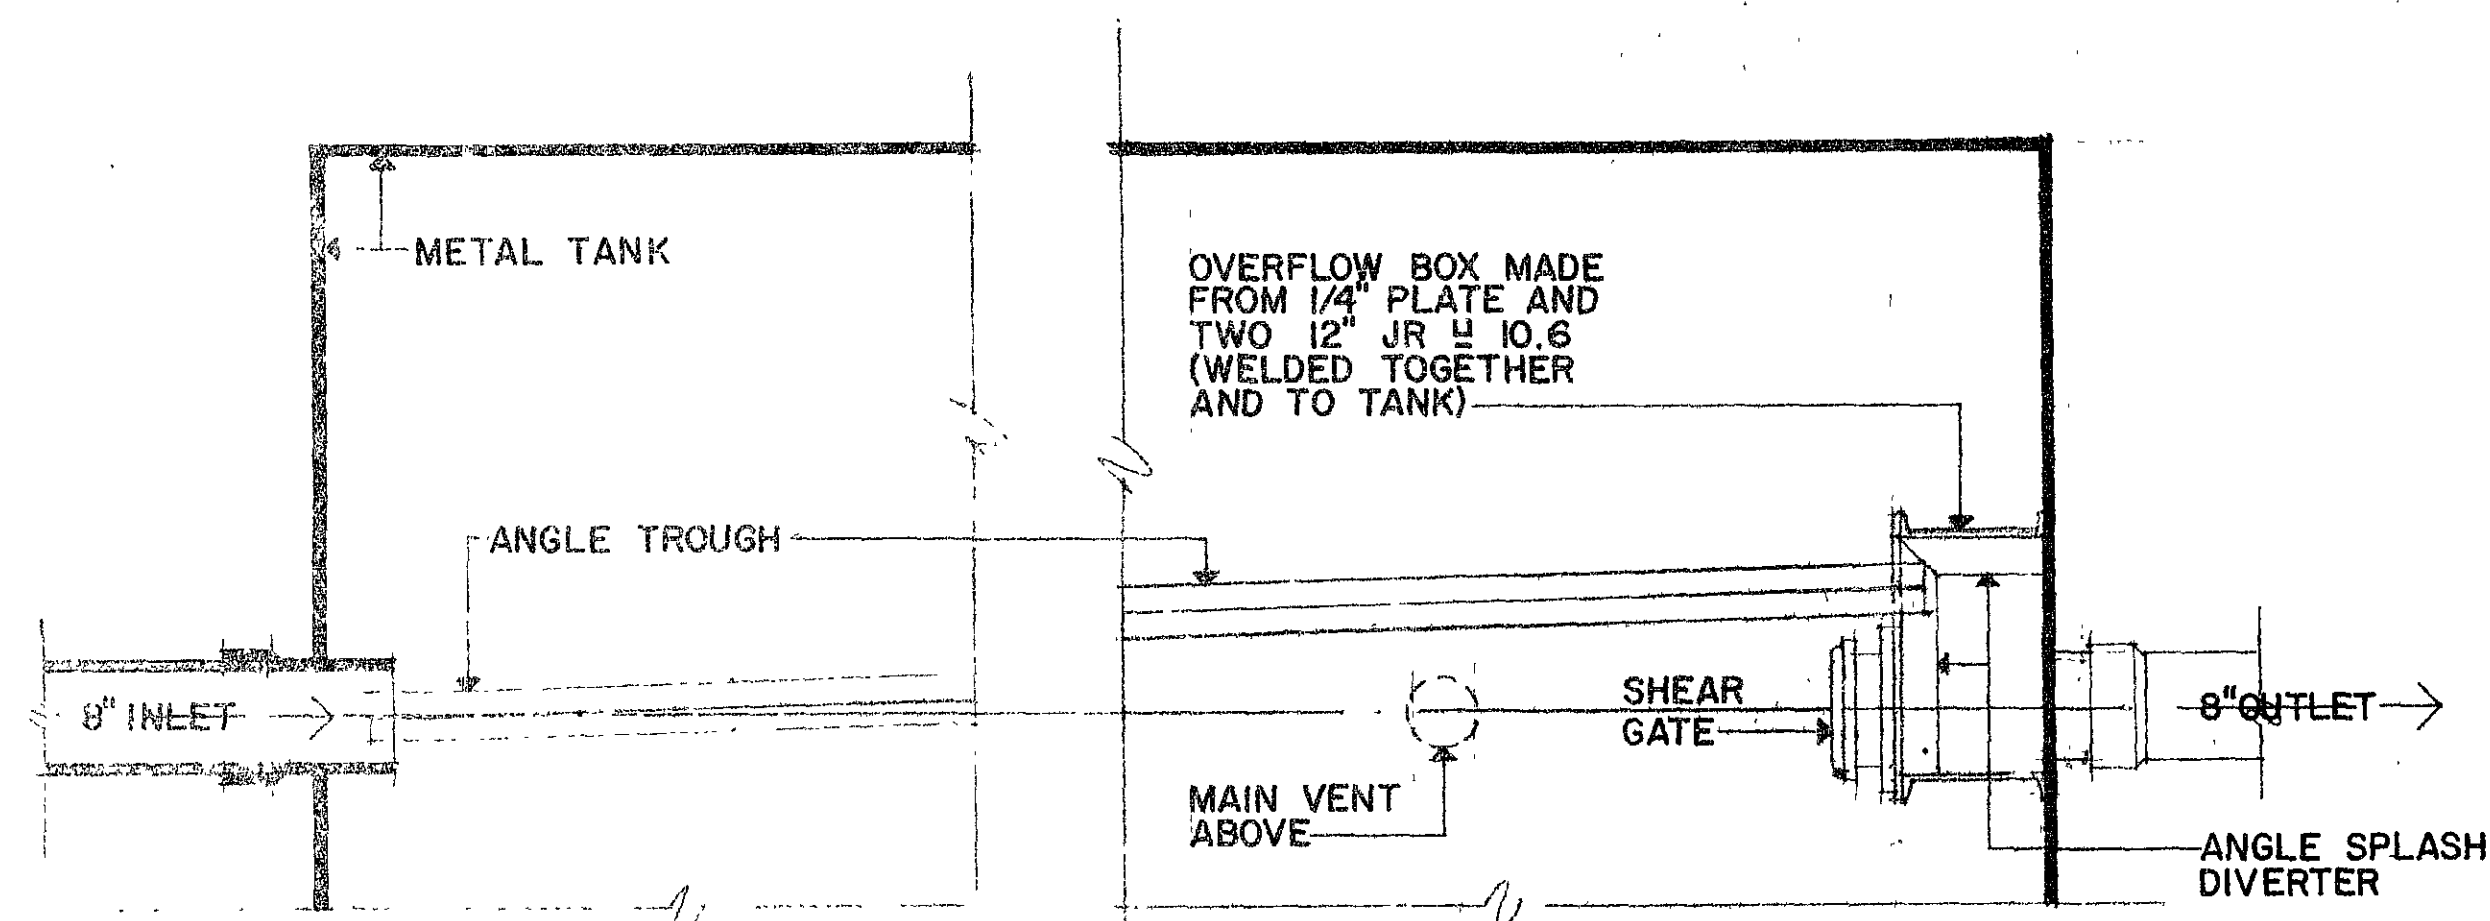

PARTIAL PLAN SECTION
SCALE • 3/4" = 1' - 0"

INTERIOR PLAN OF OPERATOR HOUSING

SCALE • 3/4" = 1' - 0"

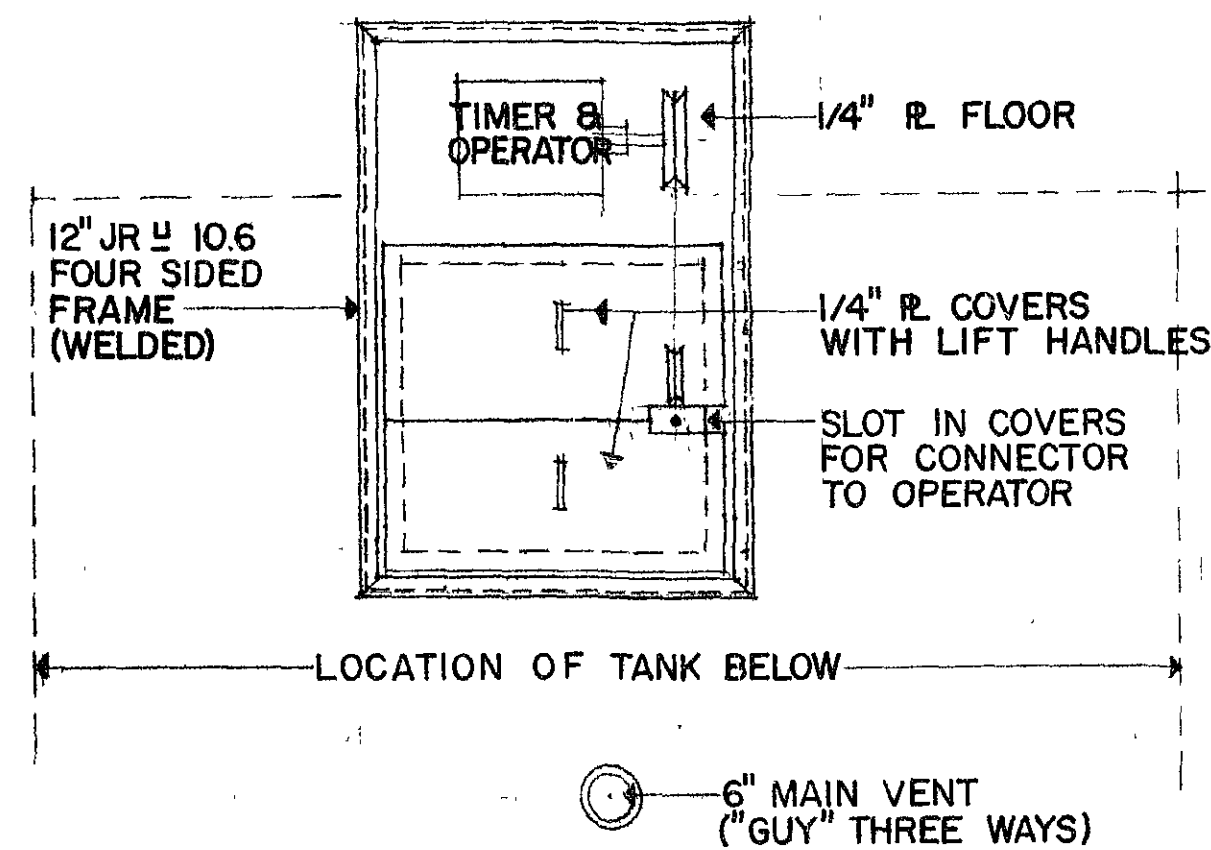


MAIN VENT FROM TANK - 6" STEEL PIPE

SLOT IN MAIN VENT FOR "LIQUID LEVEL" INDICATOR. LENGTH OF SLOT TO BE MAX. LIQUID LEVEL MINUS 1'-6" PLUS AN ADDITIONAL 4" CLEARANCE AT TOP


3 1/2" x 3 1/2" x 5/16" ANGLE TROUGH WITH SLOPE ADJUSTED ON THE JOB TO PERMIT A MAXIMUM FLOW OF 20 GALLONS PER MINUTE.

2" VENT FROM HIGH POINT OF TANK-CONNECT TO MAIN VENT

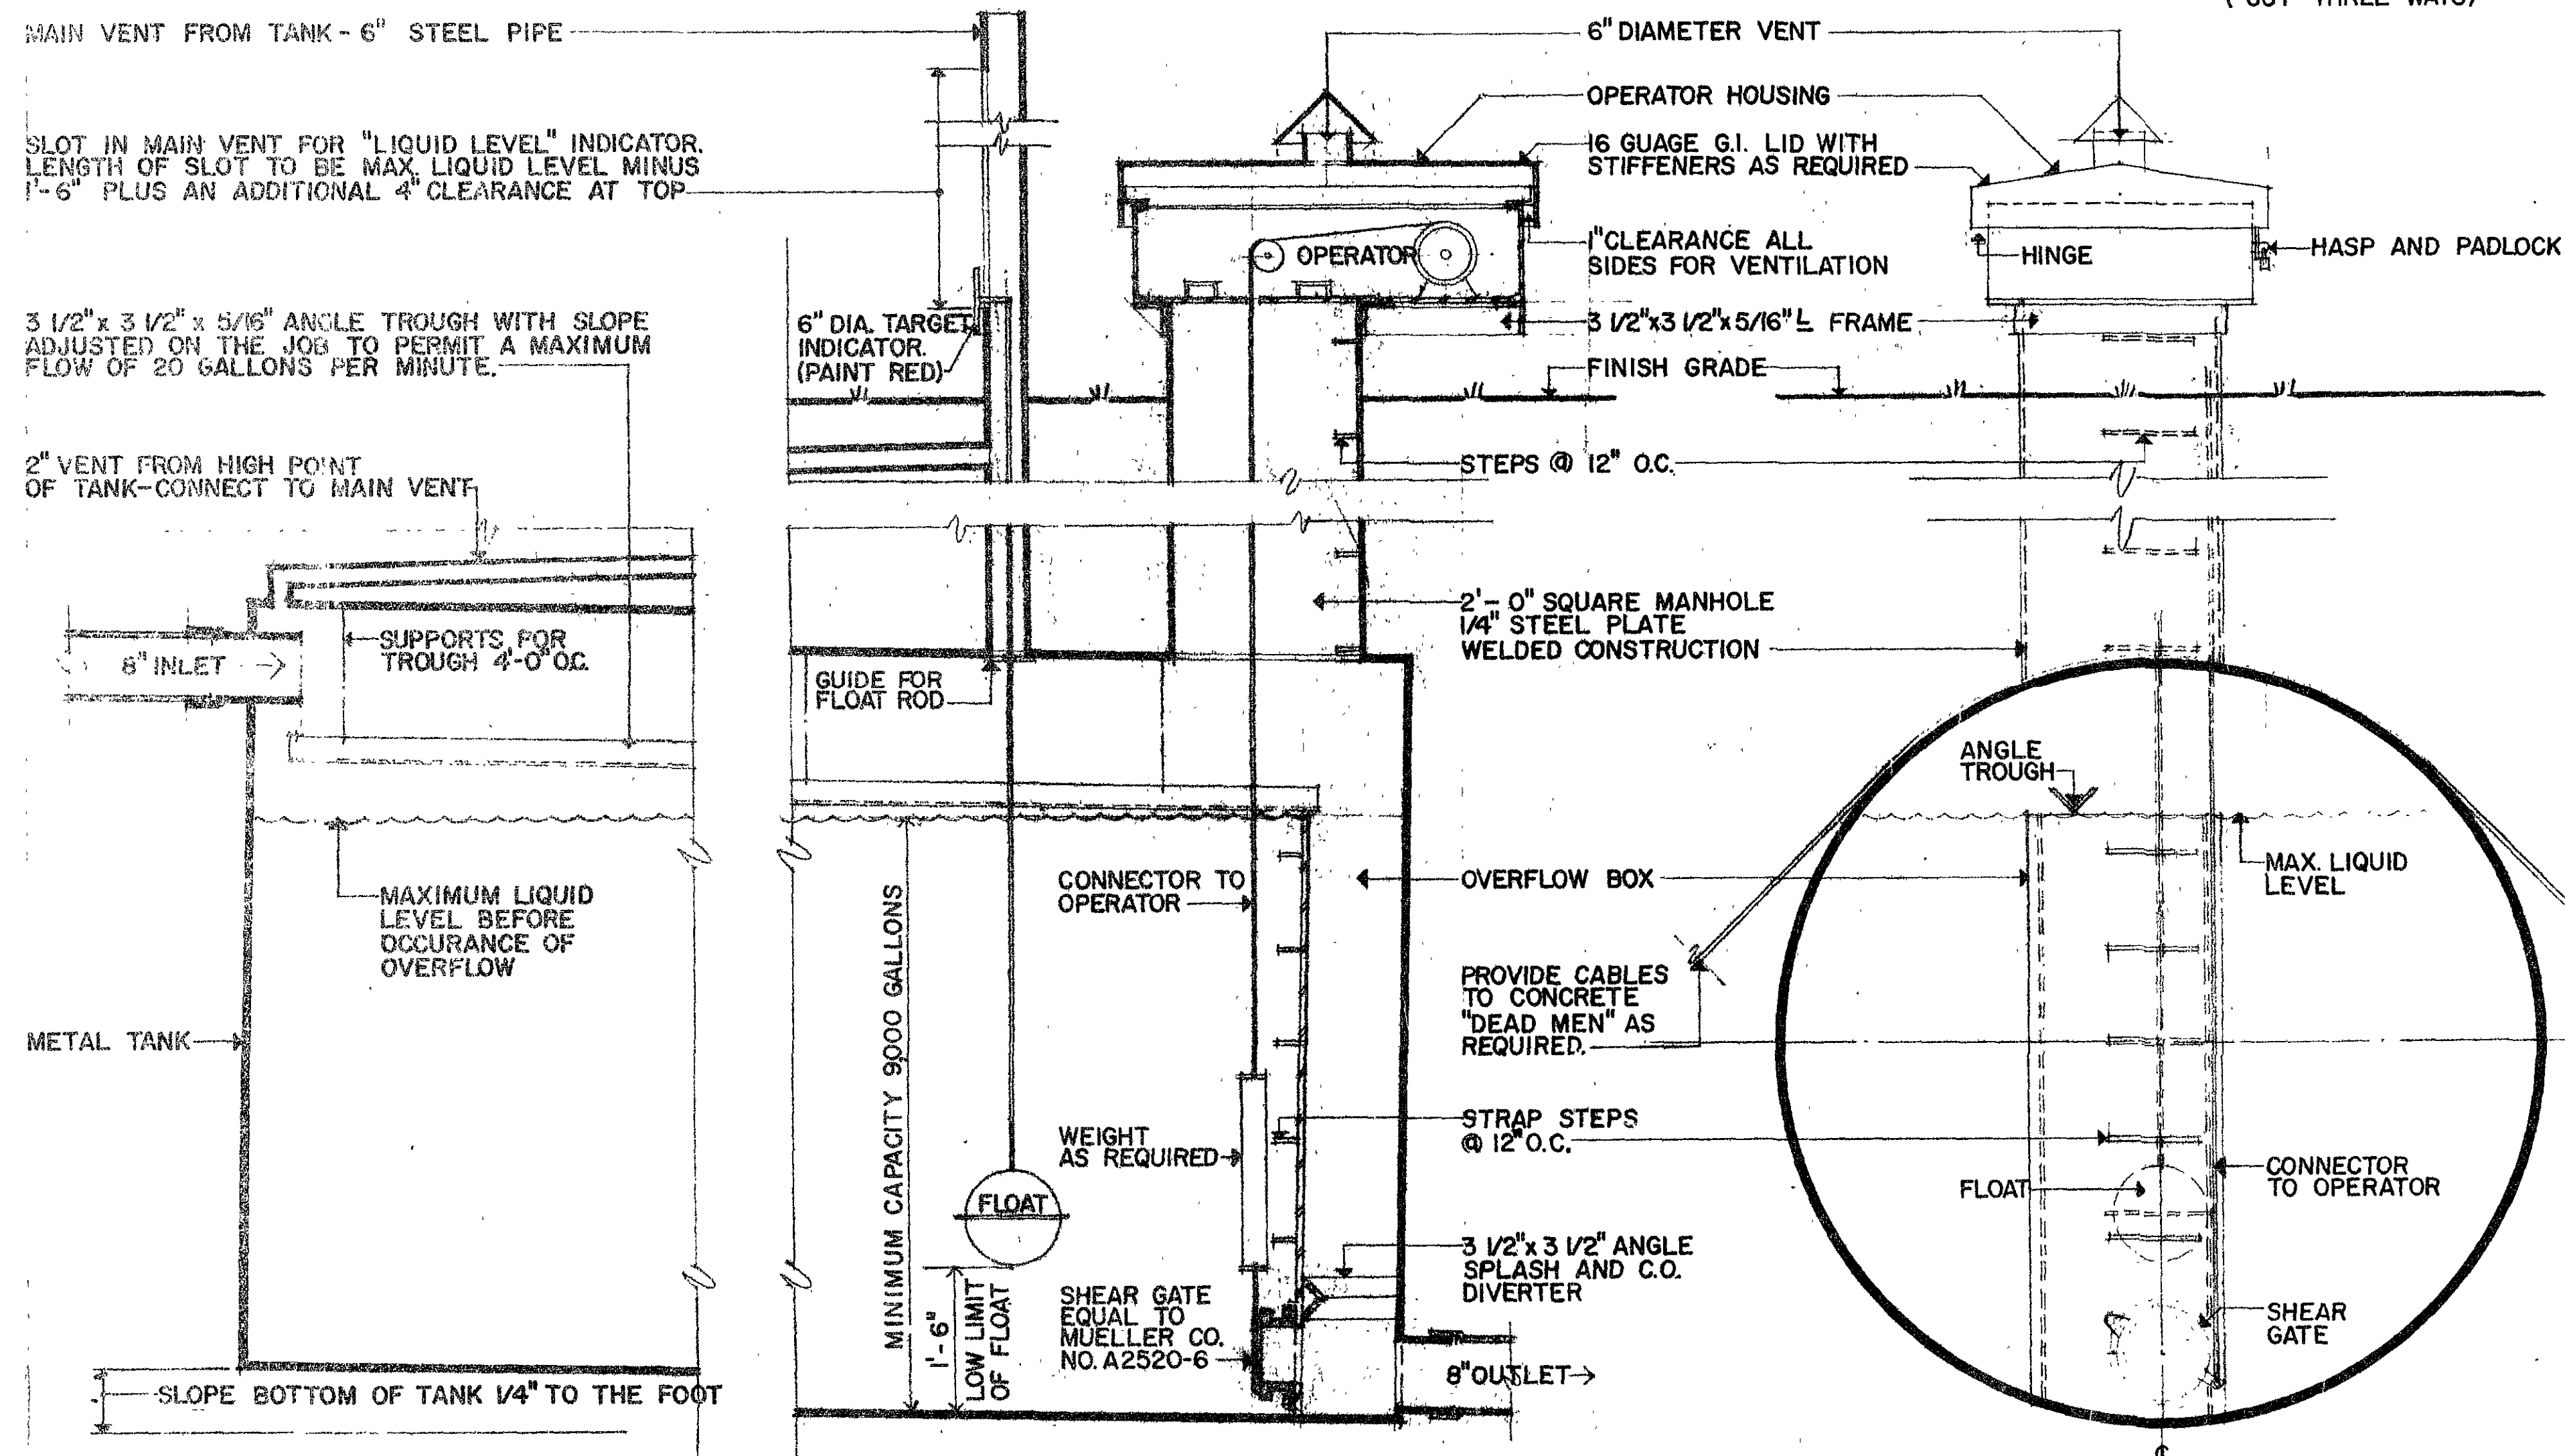

LONGITUDINAL CROSS SECTION
SCALE • 3/4" = 1' - 0"

LATERAL CROSS SECTION
SCALE • 3/4" = 1' - 0"

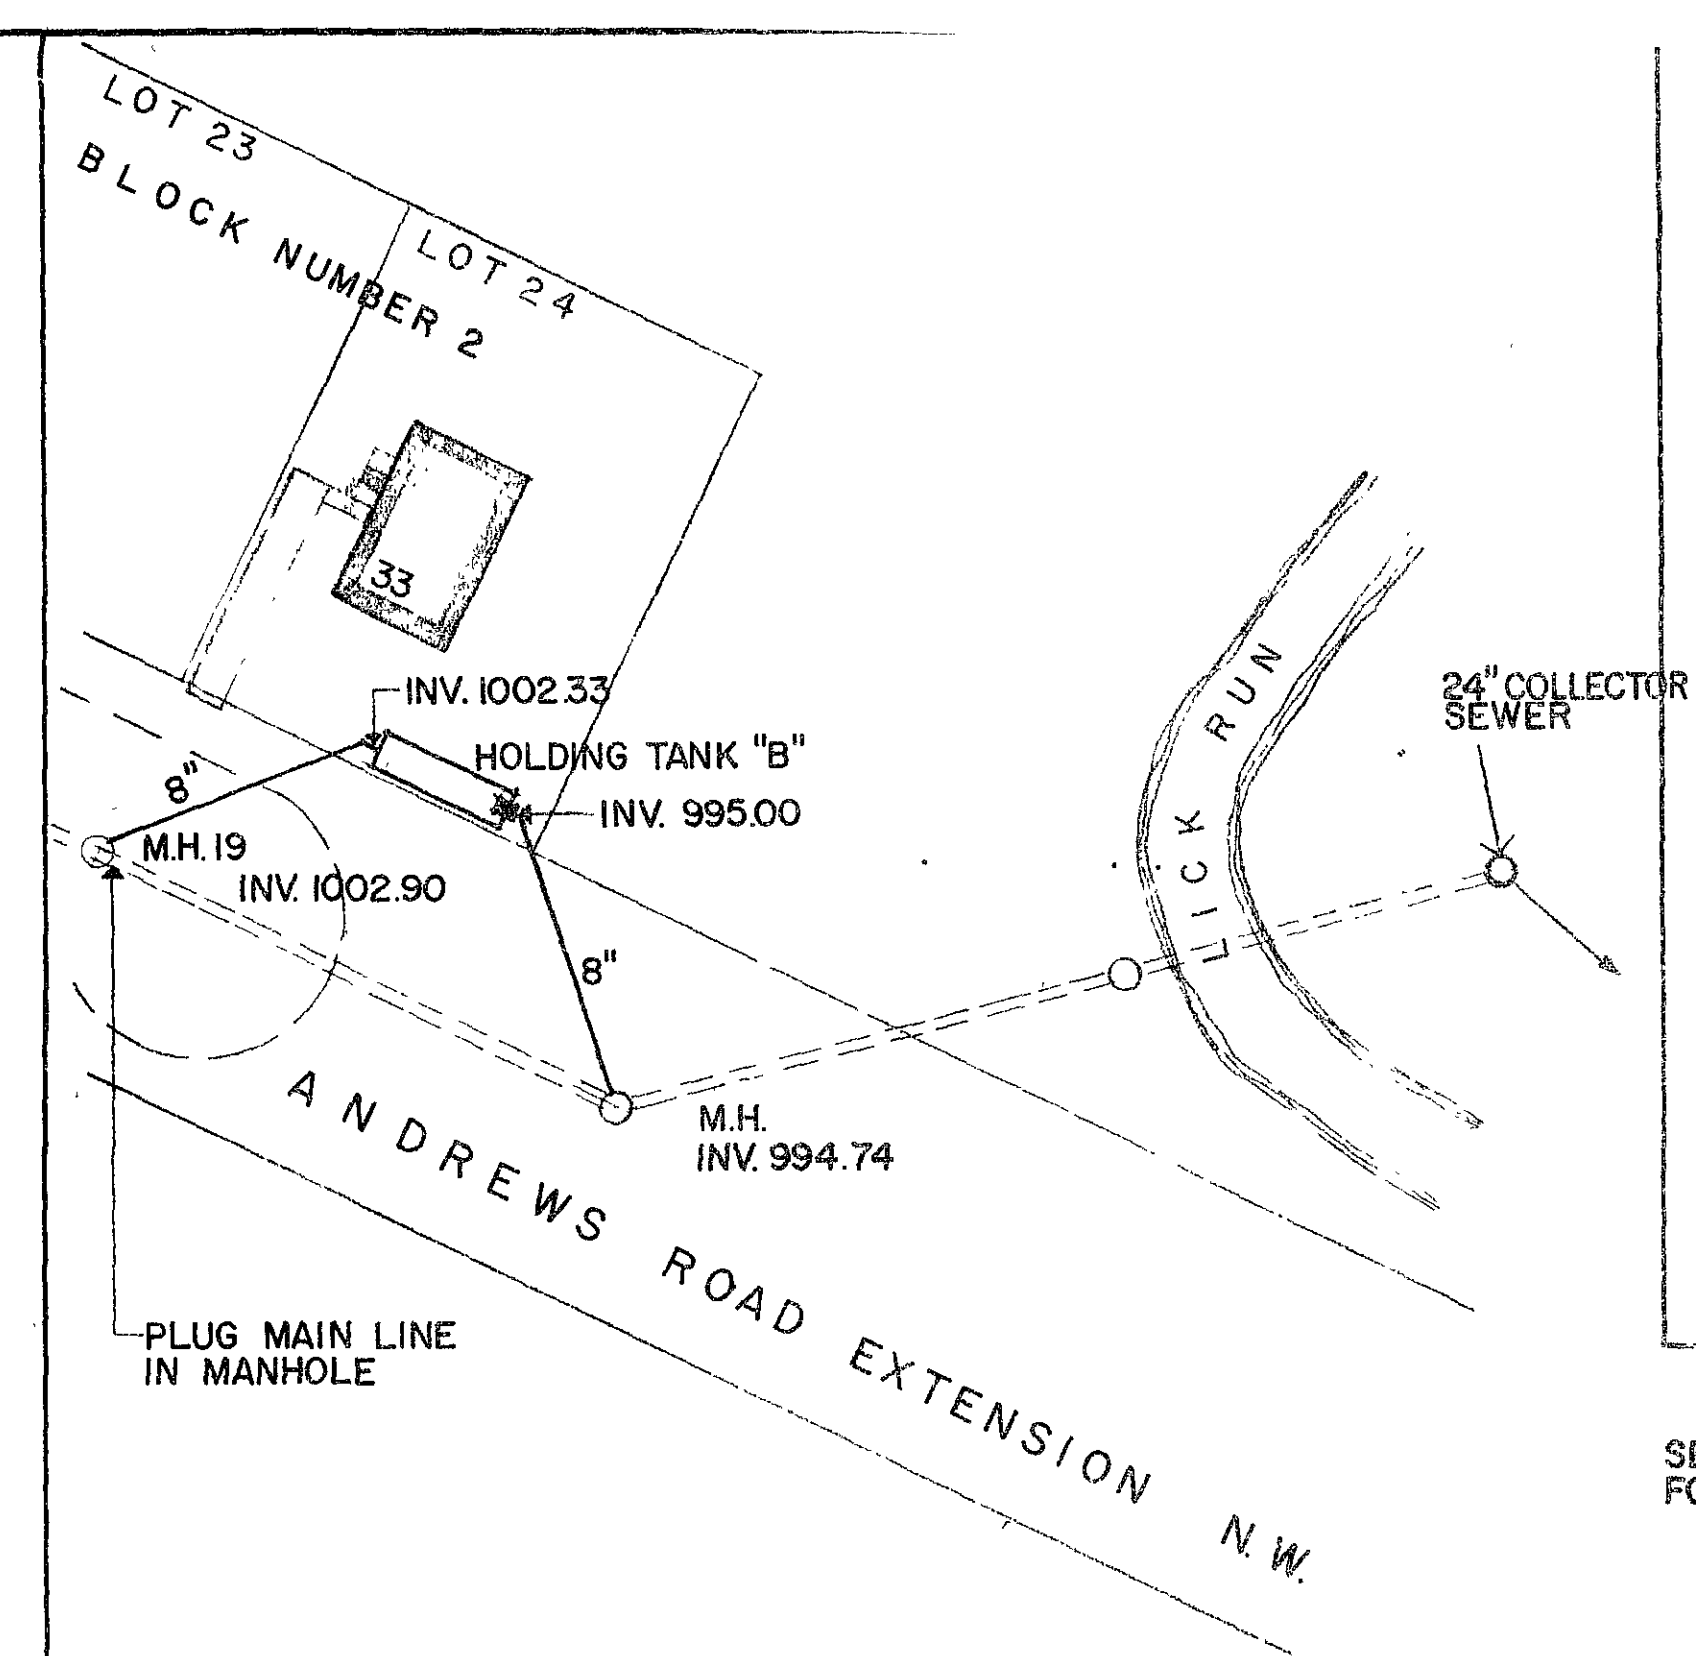

LOCATION MAP FOR HOLDING TANK 'B'
SCALE 1" = 40' - 0"

TYPICAL PLAN SHOWING FENCING AT TANKS 'A' & 'B'
SCALE • 3/8" = 1' - 0"

SEE ENGINEER'S DRAWINGS FOR SEWER PROFILES


NORTH

NOTES

1. DATA SHOWN IS BASED ON CYLINDRICAL TANKS 8'-0" IN DIAMETER AND 30'-0" IN LENGTH, EACH WITH A TOTAL VOLUME OF 11,280 GALLONS AND EFFECTIVE CAPACITY OF 9,000 GALLONS.
2. ELECTRICITY FOR THE TIMER AND OPERATOR SHALL BE DELIVERED (AND METERED) THRU HOUSES NO. 11 & 33. THIS SHALL BE BY UNDERGROUND CABLE WITH SEPARATE DISCONNECTS FOR THIS FUNCTION.
3. ALL PORTIONS OF MAIN VENTS AND OPERATOR HOUSING THAT ARE EXPOSED ABOVE GRADE SHALL BE PAINTED GRASS GREEN.



SEE ENGINEER'S DRAWINGS FOR SEWER PROFILES

NORTH

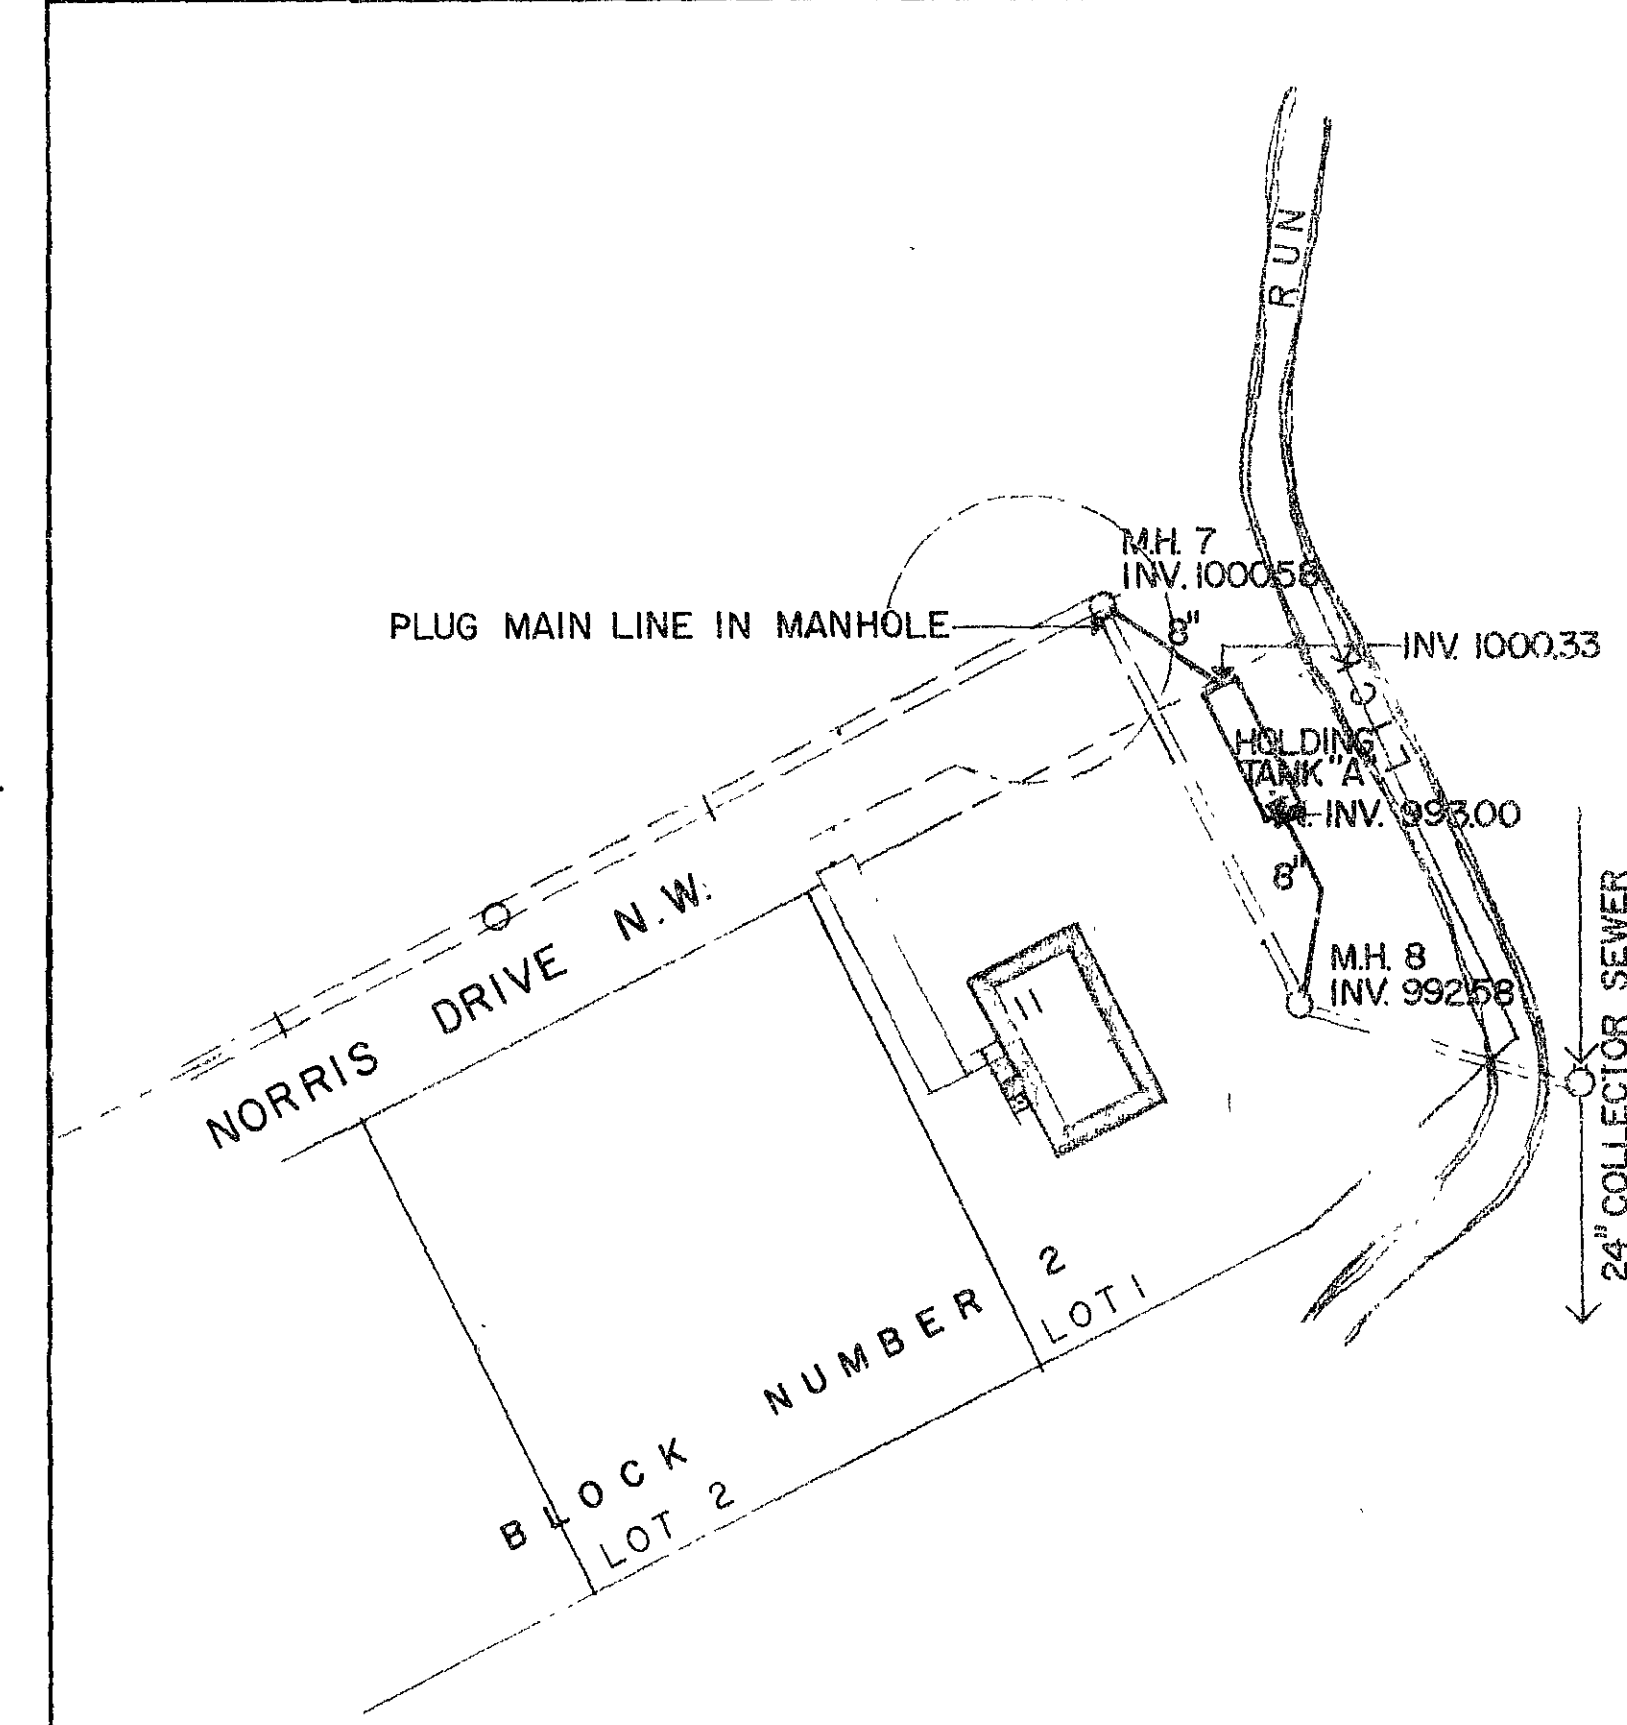

LOCATION MAP FOR HOLDING TANK 'A'
SCALE 1" = 40' - 0"

TYPICAL DETAILS OF HOLDING TANK

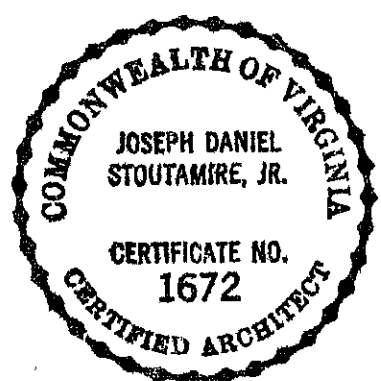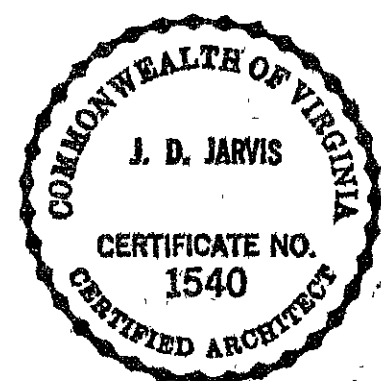

JARVIS AND
STOUTAMIRE
ARCHITECTS
ROANOKE VIRGINIA

NAME OF PROJECT

**PUBLIC HOUSING
PROJECT VA 11-4**
ROANOKE VIRGINIA

TITLE OF SHEET

LOCATION AND DETAILS OF
HOLDING TANKS 'A' & 'B'

PROJECT
NUMBER

1566

SHEET

X-2

DATE OCTOBER 18, 1968