


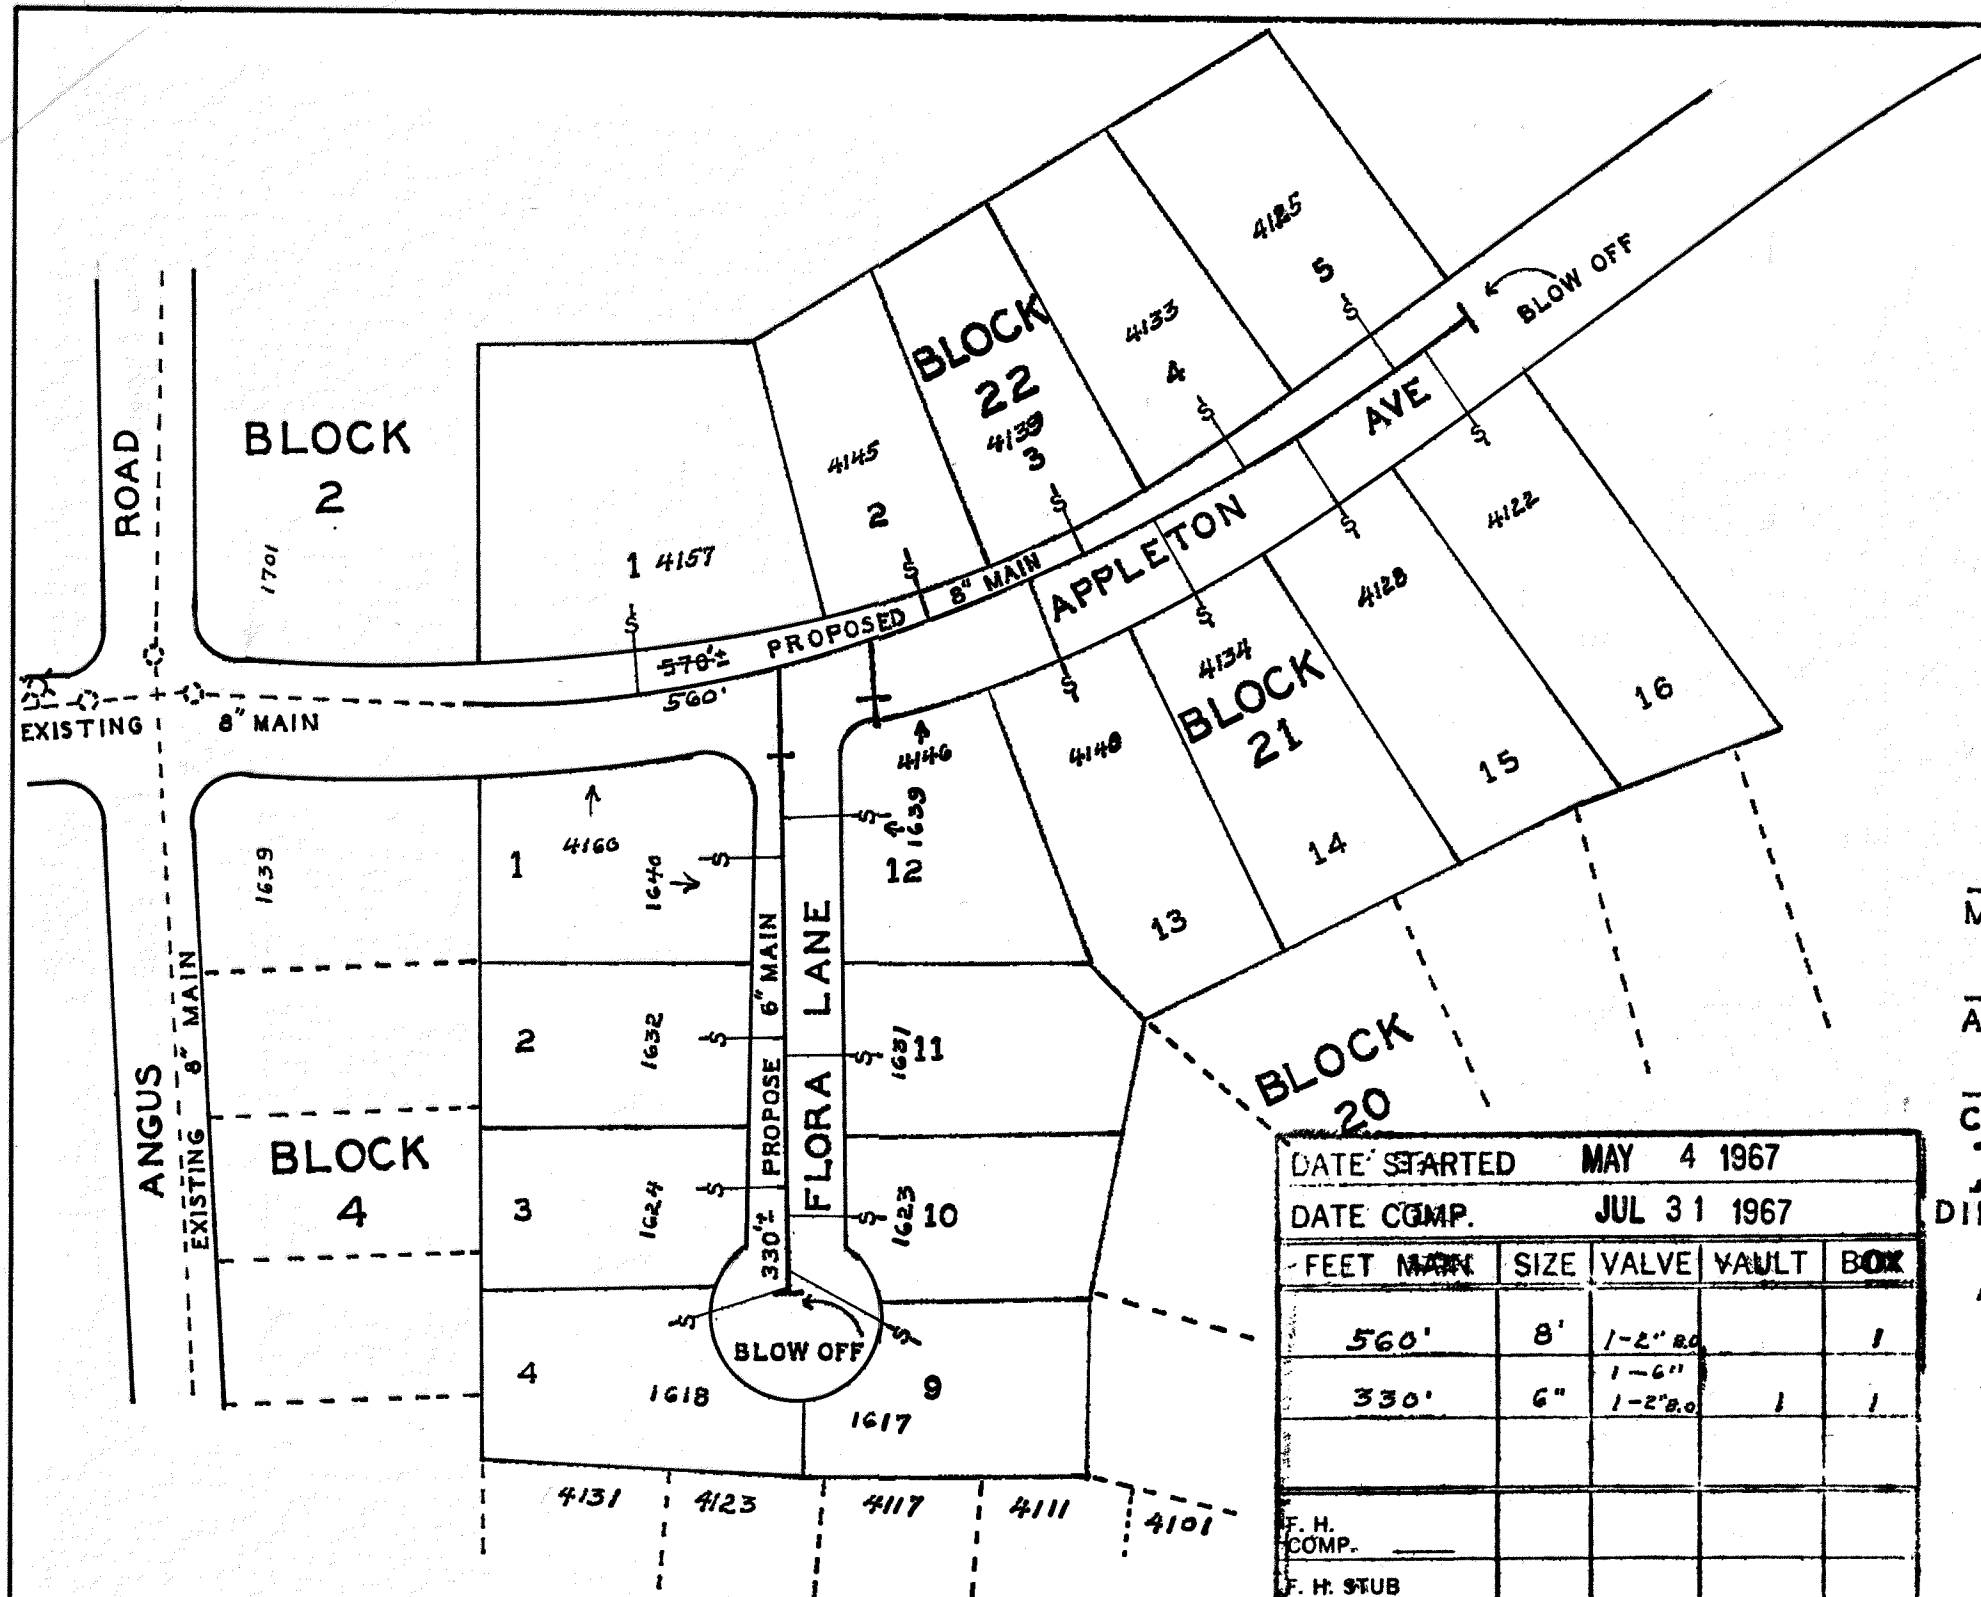

DATE STARTED		MAY 4 1967		
DATE COMP.		JUL 31 1967		
FEET MAIN	SIZE	VALVE	VAULT	BOX
560'	8'	1-2" R.O.		1
330'	6"	1-6"	1	1
		1-2" R.O.		
F. H. COMP.				
F. H. STUB ONLY	1	6"	1-6"	1
SERV. INS. BY: GIMBERT & GIMBERT				
MAINS INS. BY: GIMBERT & GIMBERT				
NO. 3/4" SERV. INS. 17				
CITY OR CO.		COUNTY		
DEPT. INSP.		D. T. M.		

J. A. Brogan
MGR. ROANOKE WATER DEPT.

Dexter N. Smith
AGENT FOR ROANOKE PLANNING COMMS.

William F. Clark
CITY ENGINEER OF ROANOKE, VA.

H. Clitus Broyles
DIRECTOR OF PUBLIC WORKS.

APPROVED BY CITY COUNCIL RES.# 17080
JUNE, 20, 1966

6-22-66
DATE

6-22-66
DATE

8-12-66
DATE

8-12-66
DATE

WATER DEPARTMENT
CITY OF ROANOKE, VA.
SECTION #9
HEMLOCK HILLS N.W.
SCALE 1"=100'
DRAWN BY C.G.C. JUNE 3, 1966