


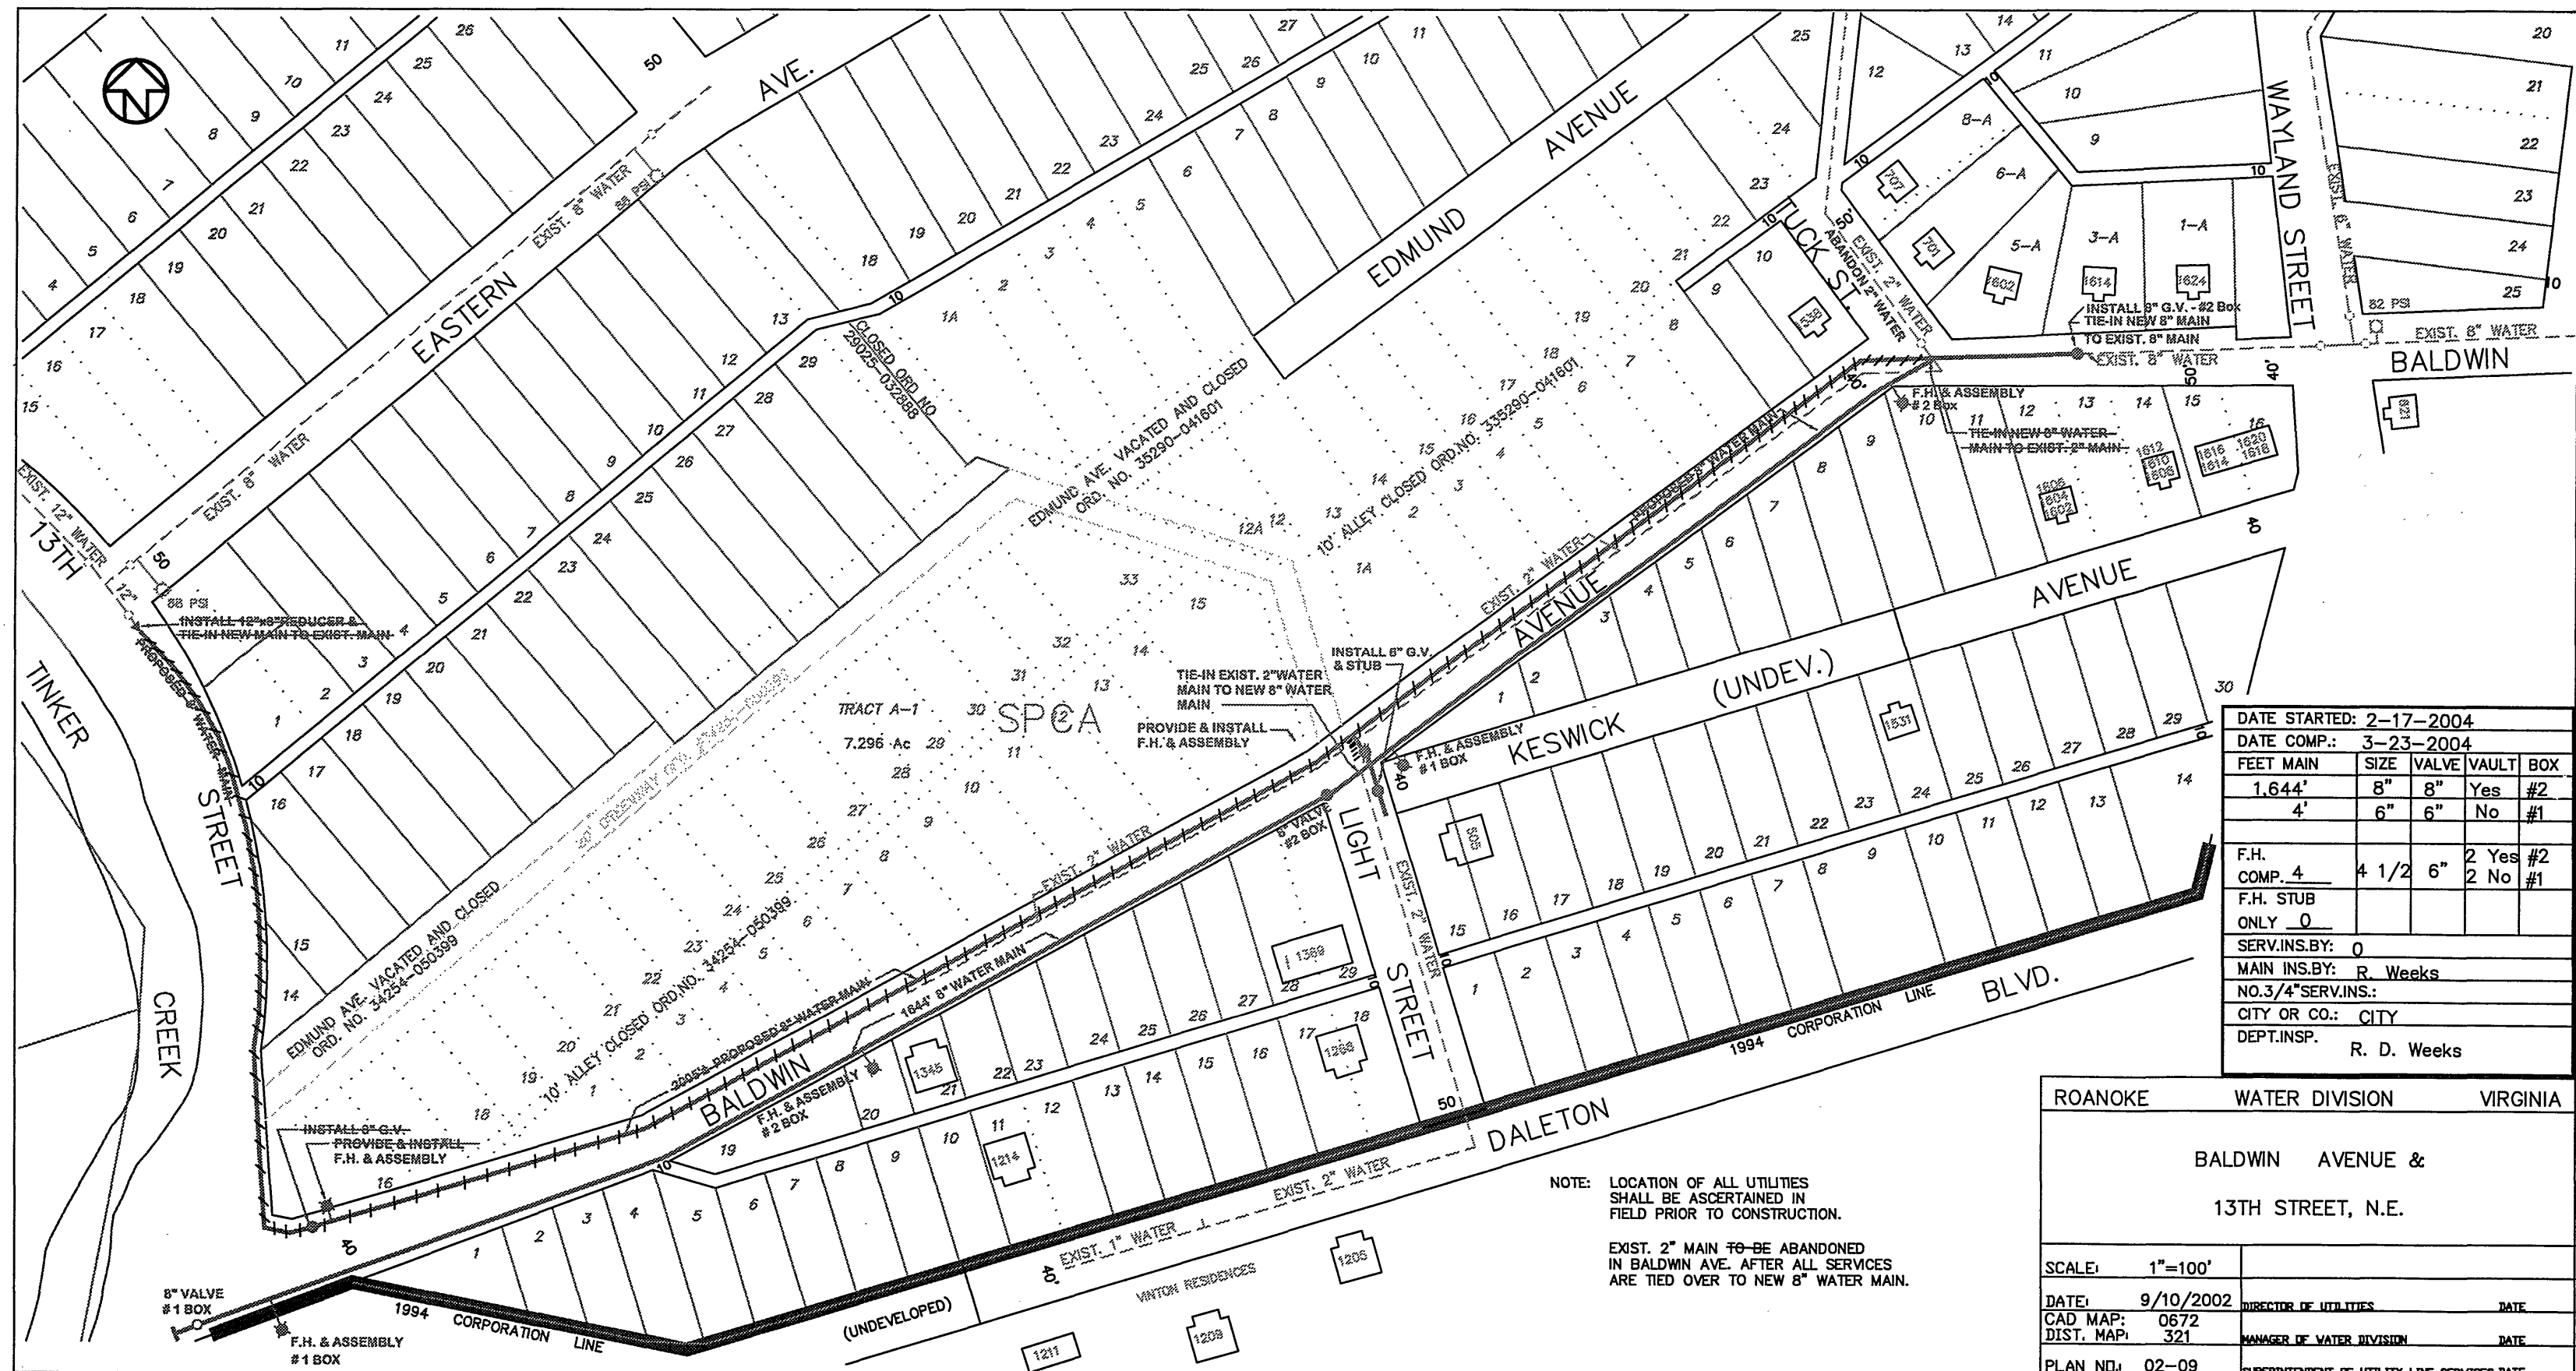

| DATE STARTED: 2-17-2004 |       |       |       |     |
|-------------------------|-------|-------|-------|-----|
| DATE COMP.: 3-23-2004   |       |       |       |     |
| FEET MAIN               | SIZE  | VALVE | VAULT | BOX |
| 1,644'                  | 8"    | 8"    | Yes   | #2  |
| 4'                      | 6"    | 6"    | No    | #1  |
| F.H. COMP. 4            | 4 1/2 | 6"    | 2 Yes | #2  |
| F.H. STUB ONLY 0        |       |       | 2 No  | #1  |
| SERV.INS.BY: 0          |       |       |       |     |
| MAIN INS.BY: R. Weeks   |       |       |       |     |
| NO.3/4" SERV.INS.:      |       |       |       |     |
| CITY OR CO.: CITY       |       |       |       |     |
| DEPT.INS.P. R. D. Weeks |       |       |       |     |

|                                       |                                              |          |
|---------------------------------------|----------------------------------------------|----------|
| ROANOKE                               | WATER DIVISION                               | VIRGINIA |
| BALDWIN AVENUE &<br>13TH STREET, N.E. |                                              |          |
| SCALE: 1"=100'                        |                                              |          |
| DATE: 9/10/2002                       | DIRECTOR OF UTILITIES                        | DATE     |
| CAD MAP: 0672                         | MANAGER OF WATER DIVISION                    | DATE     |
| DIST. MAP: 321                        |                                              |          |
| PLAN NO: 02-09                        | SUPERINTENDENT OF UTILITY LINE SERVICES DATE |          |

NOTE: LOCATION OF ALL UTILITIES SHALL BE ASCERTAINED IN FIELD PRIOR TO CONSTRUCTION.

EXIST. 2" MAIN TO BE ABANDONED IN BALDWIN AVE. AFTER ALL SERVICES ARE TIED OVER TO NEW 8" WATER MAIN.