


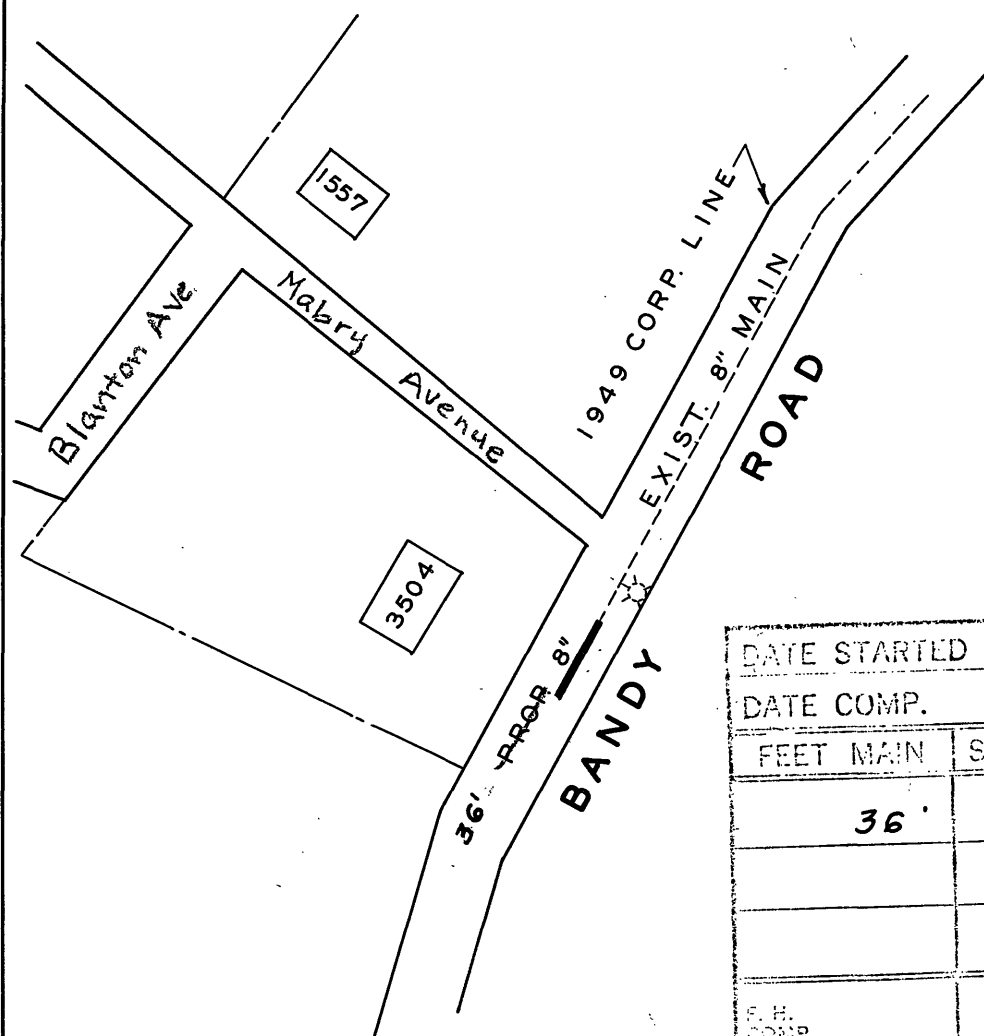

DATE STARTED		MAY 7 1963			
DATE COMP.		MAY 7 1963			
FEET MAIN	SIZE	VALVE	Vault	BOX	
36'	8"				
F. H. COMP.					
F. H. STUB ONLY					
SERV. INS. BY:		R. W. D.			
MAINS INS. BY:		R. W. D.			
NO. 3/4" SERV. INS.		1			
CITY OR CO.		COUNTY			
DEPT. INSP.		J. W. M.			

WATER DEPARTMENT
CITY OF ROANOKE, VA.

BANDY ROAD S. E.

SCALE - 1" = 100'

DRAWN BY N.H.C. APRIL 9, 1963