


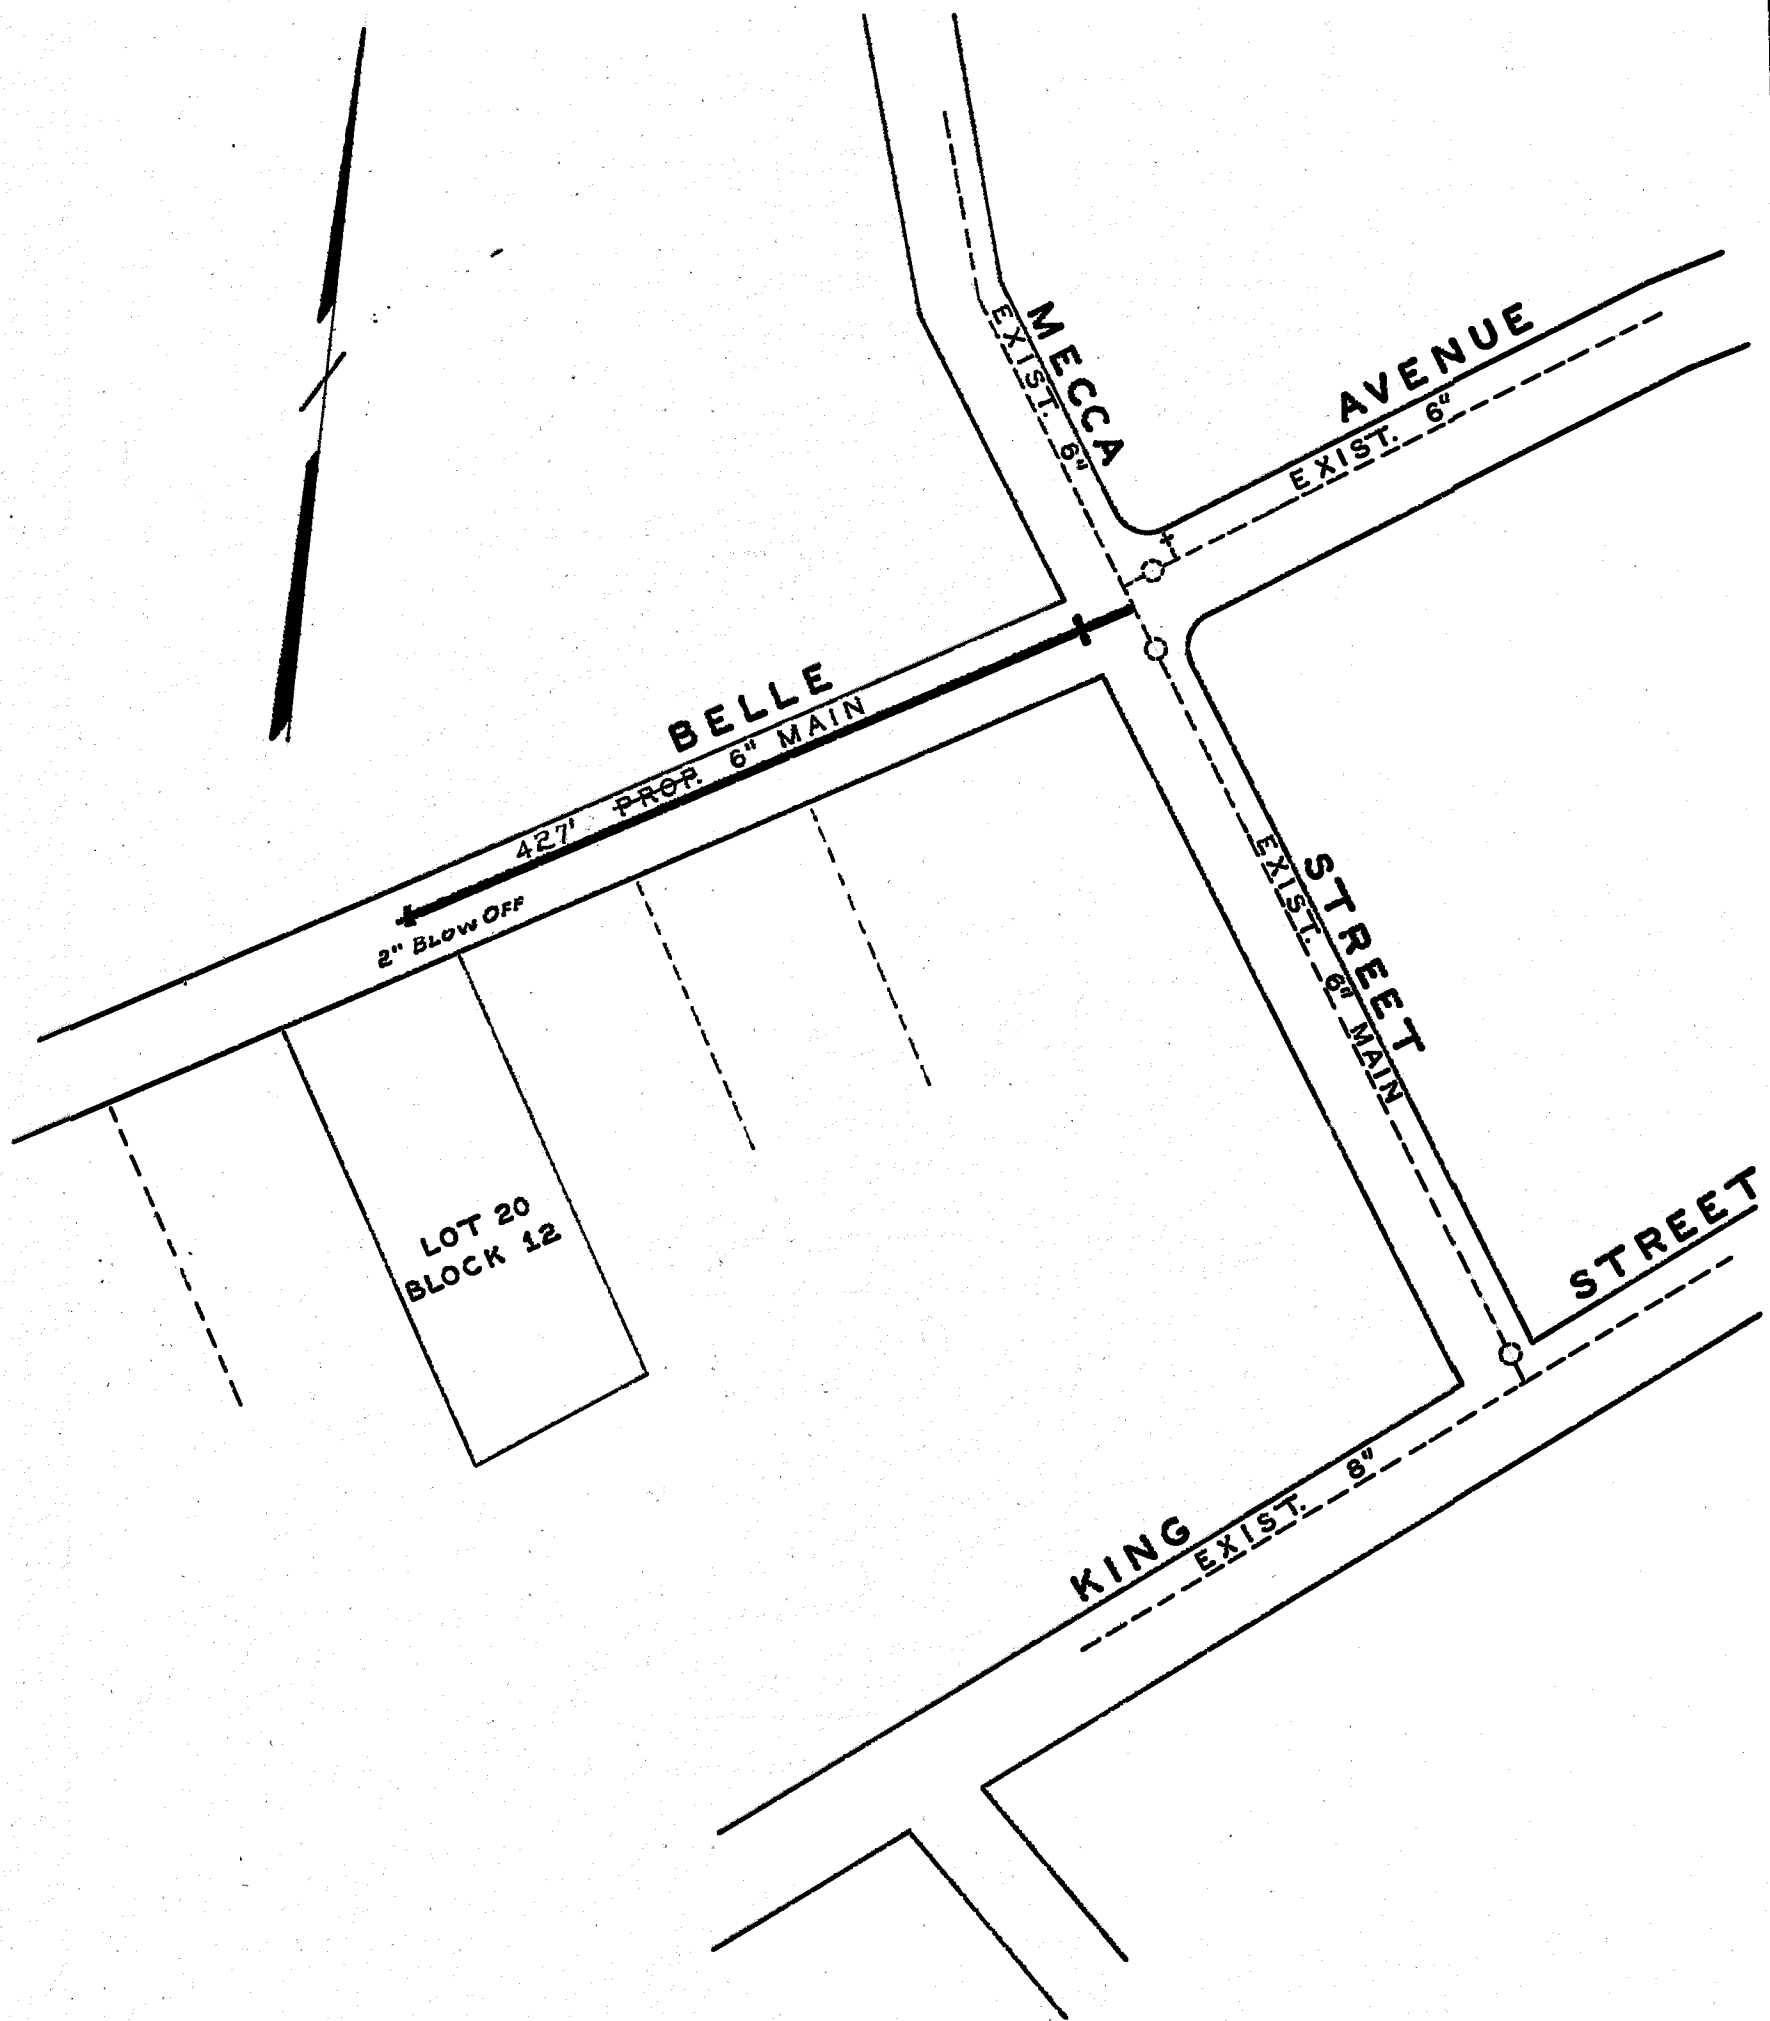

DATE STARTED		AUG 21 1963			
DATE COMP.		AUG 26 1963			
FEET MAIN	SIZE	VALVE	VAULT	BOX	
427'	6"	1	1		
BLOW OFF	2"	1		1	
F. H. COMP.					
F. H. STUB ONLY					
SERV. INS. BY: R. W. D					
MAINS INS. BY: R. W. D.					
NO. 3/4" SERV. INS. 1					
CITY OR CO. CITY					
DEPT. INSP. R. L. G.					

WATER DEPARTMENT
CITY OF ROANOKE, VA.

BELLE AVENUE N. E.

SCALE - 1" = 100'

DRAWN BY N.H.C. AUG. 15, 1963