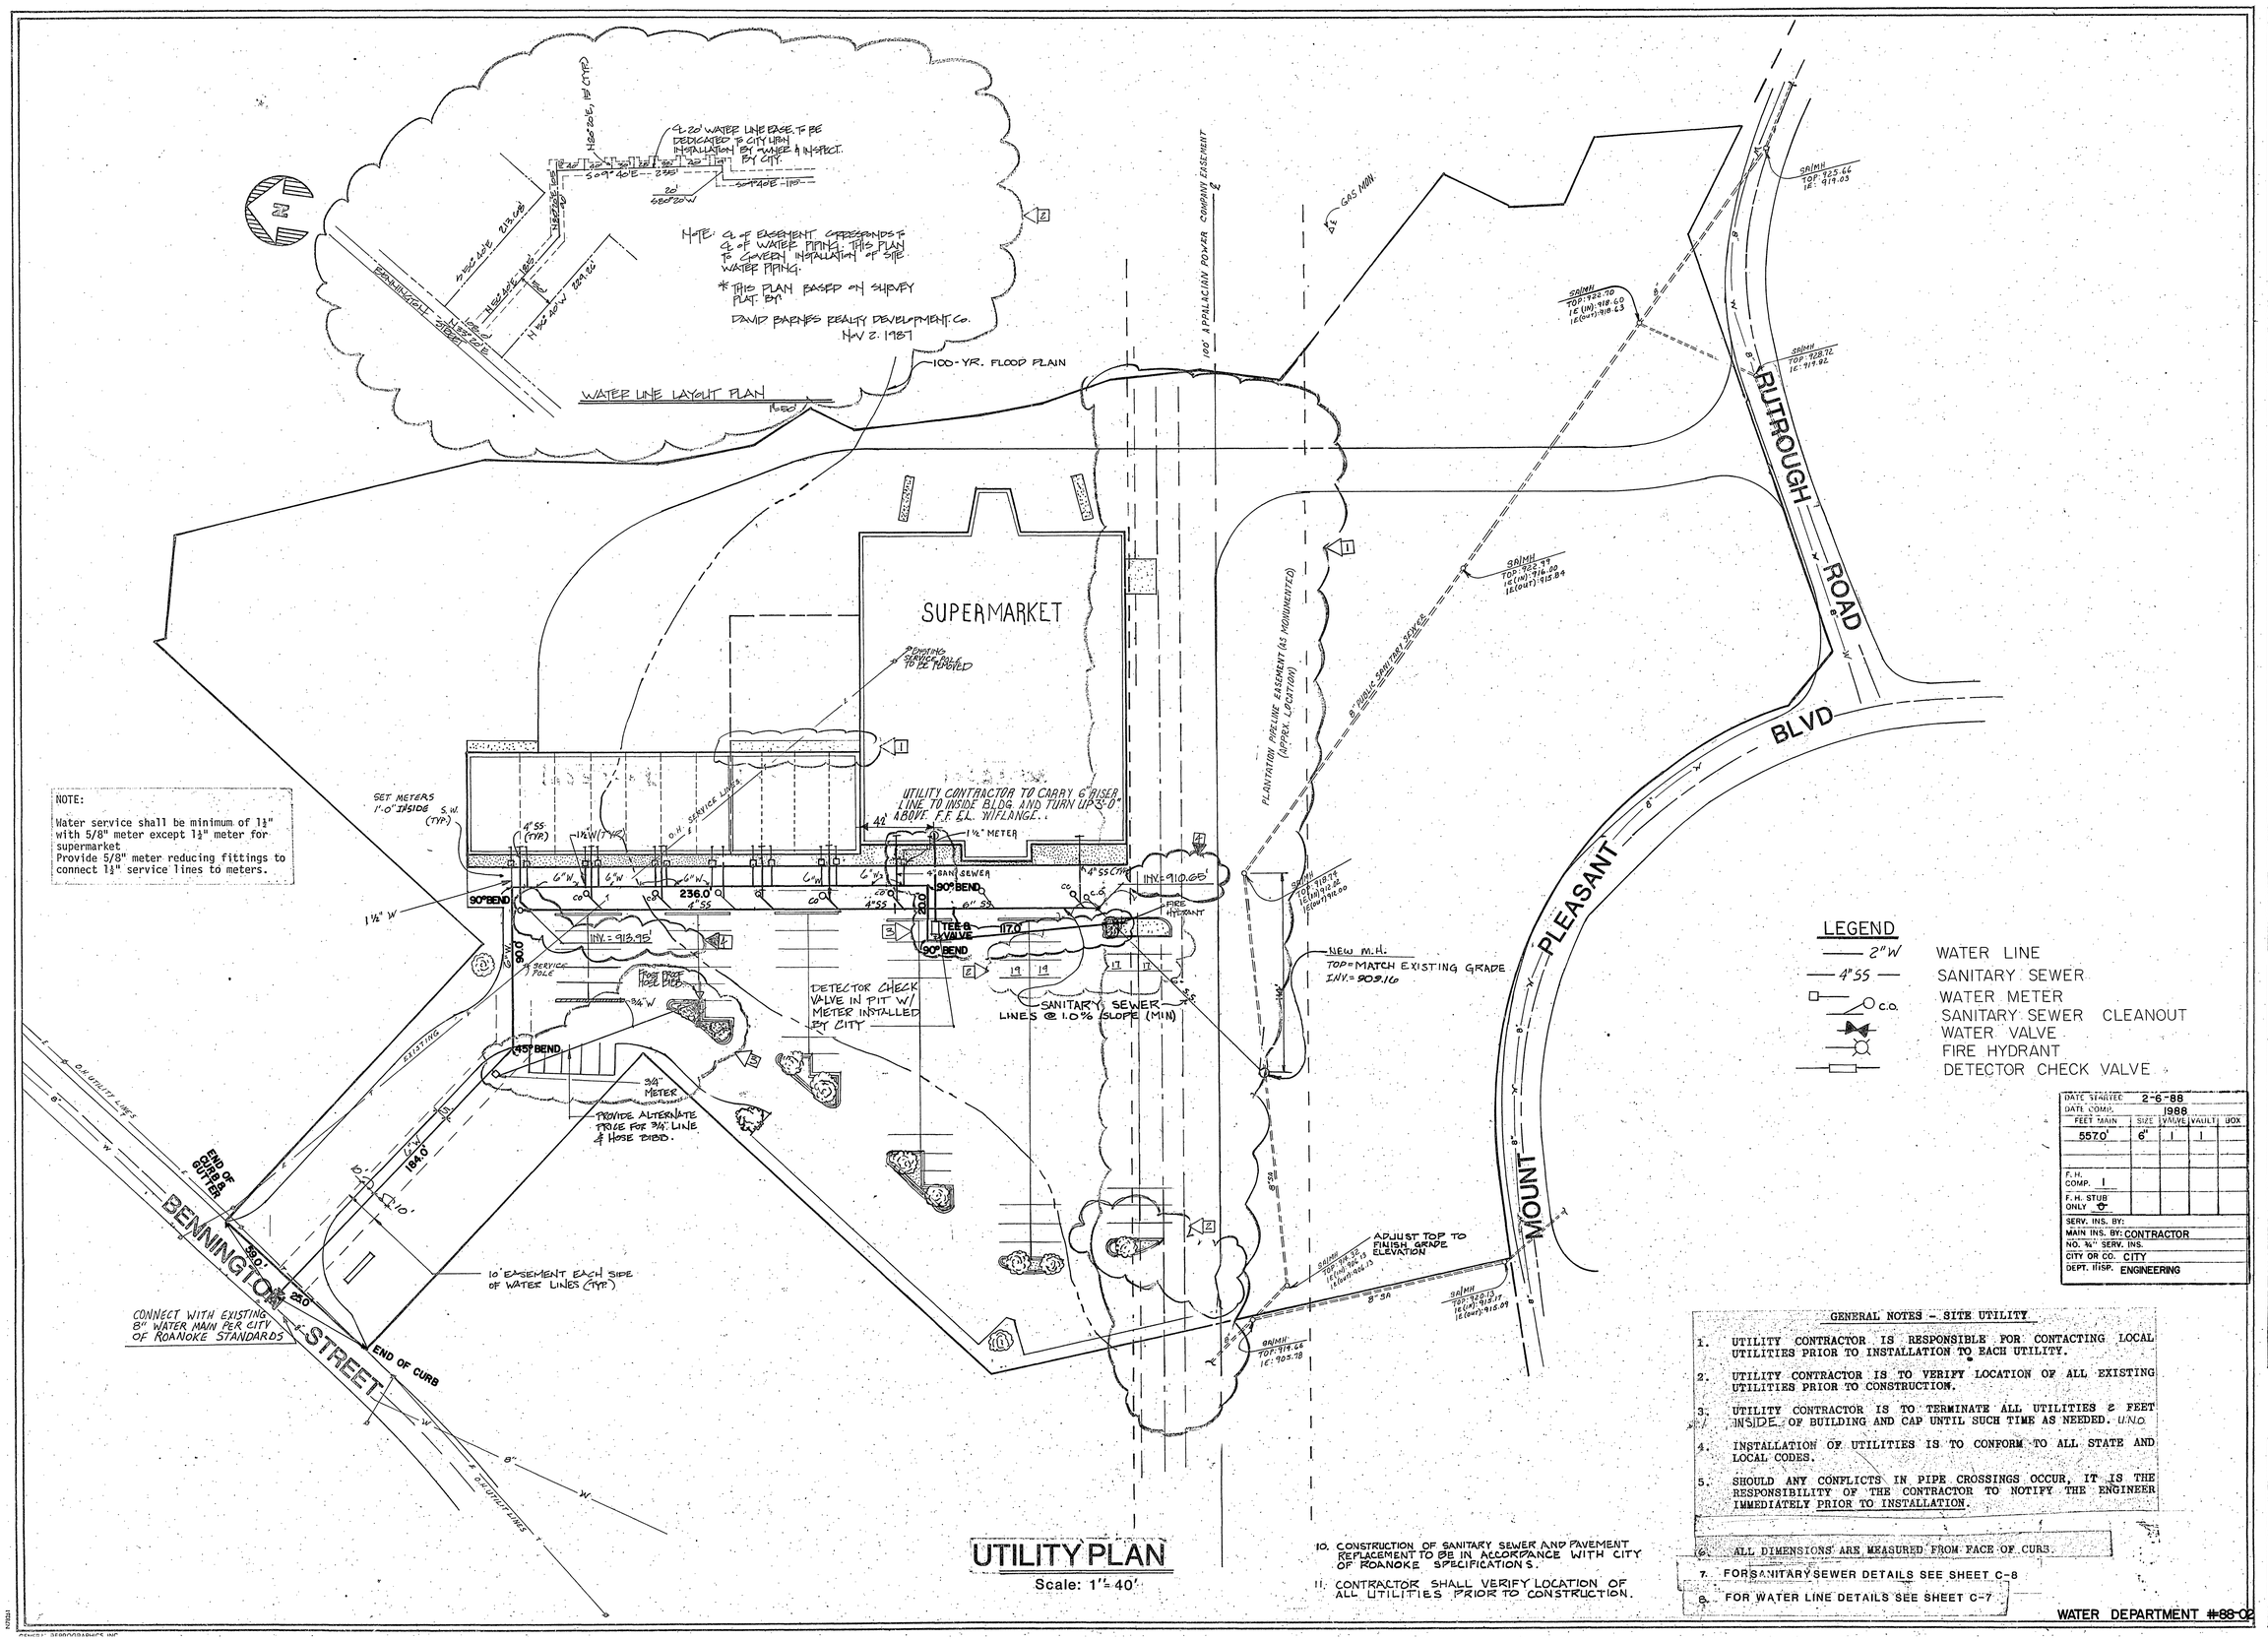

DATE STARTED	2-6-88			
DATE COMP.	1988			
FEET MAIN	SIZE	VALVE	VAULT	BOX
557.0'	6"	1	1	
F.H. COMP. 1				
F.H. STUB ONLY				
SERV. INS. BY:				
MAIN INS. BY: CONTRACTOR				
NO. ¾" SERV. INS.				
CITY OR CO. CITY				
DEPT. INSP. ENGINEERING				

GENERAL NOTES - SITE UTILITY

1. UTILITY CONTRACTOR IS RESPONSIBLE FOR CONTACTING LOCAL UTILITIES PRIOR TO INSTALLATION TO EACH UTILITY.
2. UTILITY CONTRACTOR IS TO VERIFY LOCATION OF ALL EXISTING UTILITIES PRIOR TO CONSTRUCTION.
3. UTILITY CONTRACTOR IS TO TERMINATE ALL UTILITIES 2 FEET INSIDE OF BUILDING AND CAP UNTIL SUCH TIME AS NEEDED. U.N.O.
4. INSTALLATION OF UTILITIES IS TO CONFORM TO ALL STATE AND LOCAL CODES.
5. SHOULD ANY CONFLICTS IN PIPE CROSSINGS OCCUR, IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO NOTIFY THE ENGINEER IMMEDIATELY PRIOR TO INSTALLATION.
6. ALL DIMENSIONS ARE MEASURED FROM FACE OF CURB.
7. FOR SANITARY SEWER DETAILS SEE SHEET C-8
8. FOR WATER LINE DETAILS SEE SHEET C-7
10. CONSTRUCTION OF SANITARY SEWER AND PAVEMENT REPLACEMENT TO BE IN ACCORDANCE WITH CITY OF ROANOKE SPECIFICATIONS.
11. CONTRACTOR SHALL VERIFY LOCATION OF ALL UTILITIES PRIOR TO CONSTRUCTION.

UTILITY PLAN

Scale: 1" = 40'

WATER DEPARTMENT #88-02

no.	revision	date
1	GEN. REVISION	11-4-87
2	FEE HYDRANT	11-23-87
3	FOOD LION	12-22-87
4	GEN. REVISION	1-5-88
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		

SHOPPING CENTER
BENNINGTON ST. & MT. PLEASANT BLVD,
ROANOKE, VA.

artech design group, incorporated
architecture, planning
interior design, graphics
chattanooga, tennessee
phone - 615-265-4313

COMMONWEALTH OF VIRGINIA
J. DAVID HUDSON
No. 009103
ARCHITECT

job no. 87-125
date 9-18-87
drawn BCR
ch'k ARC
sheet: C-3
of 9