


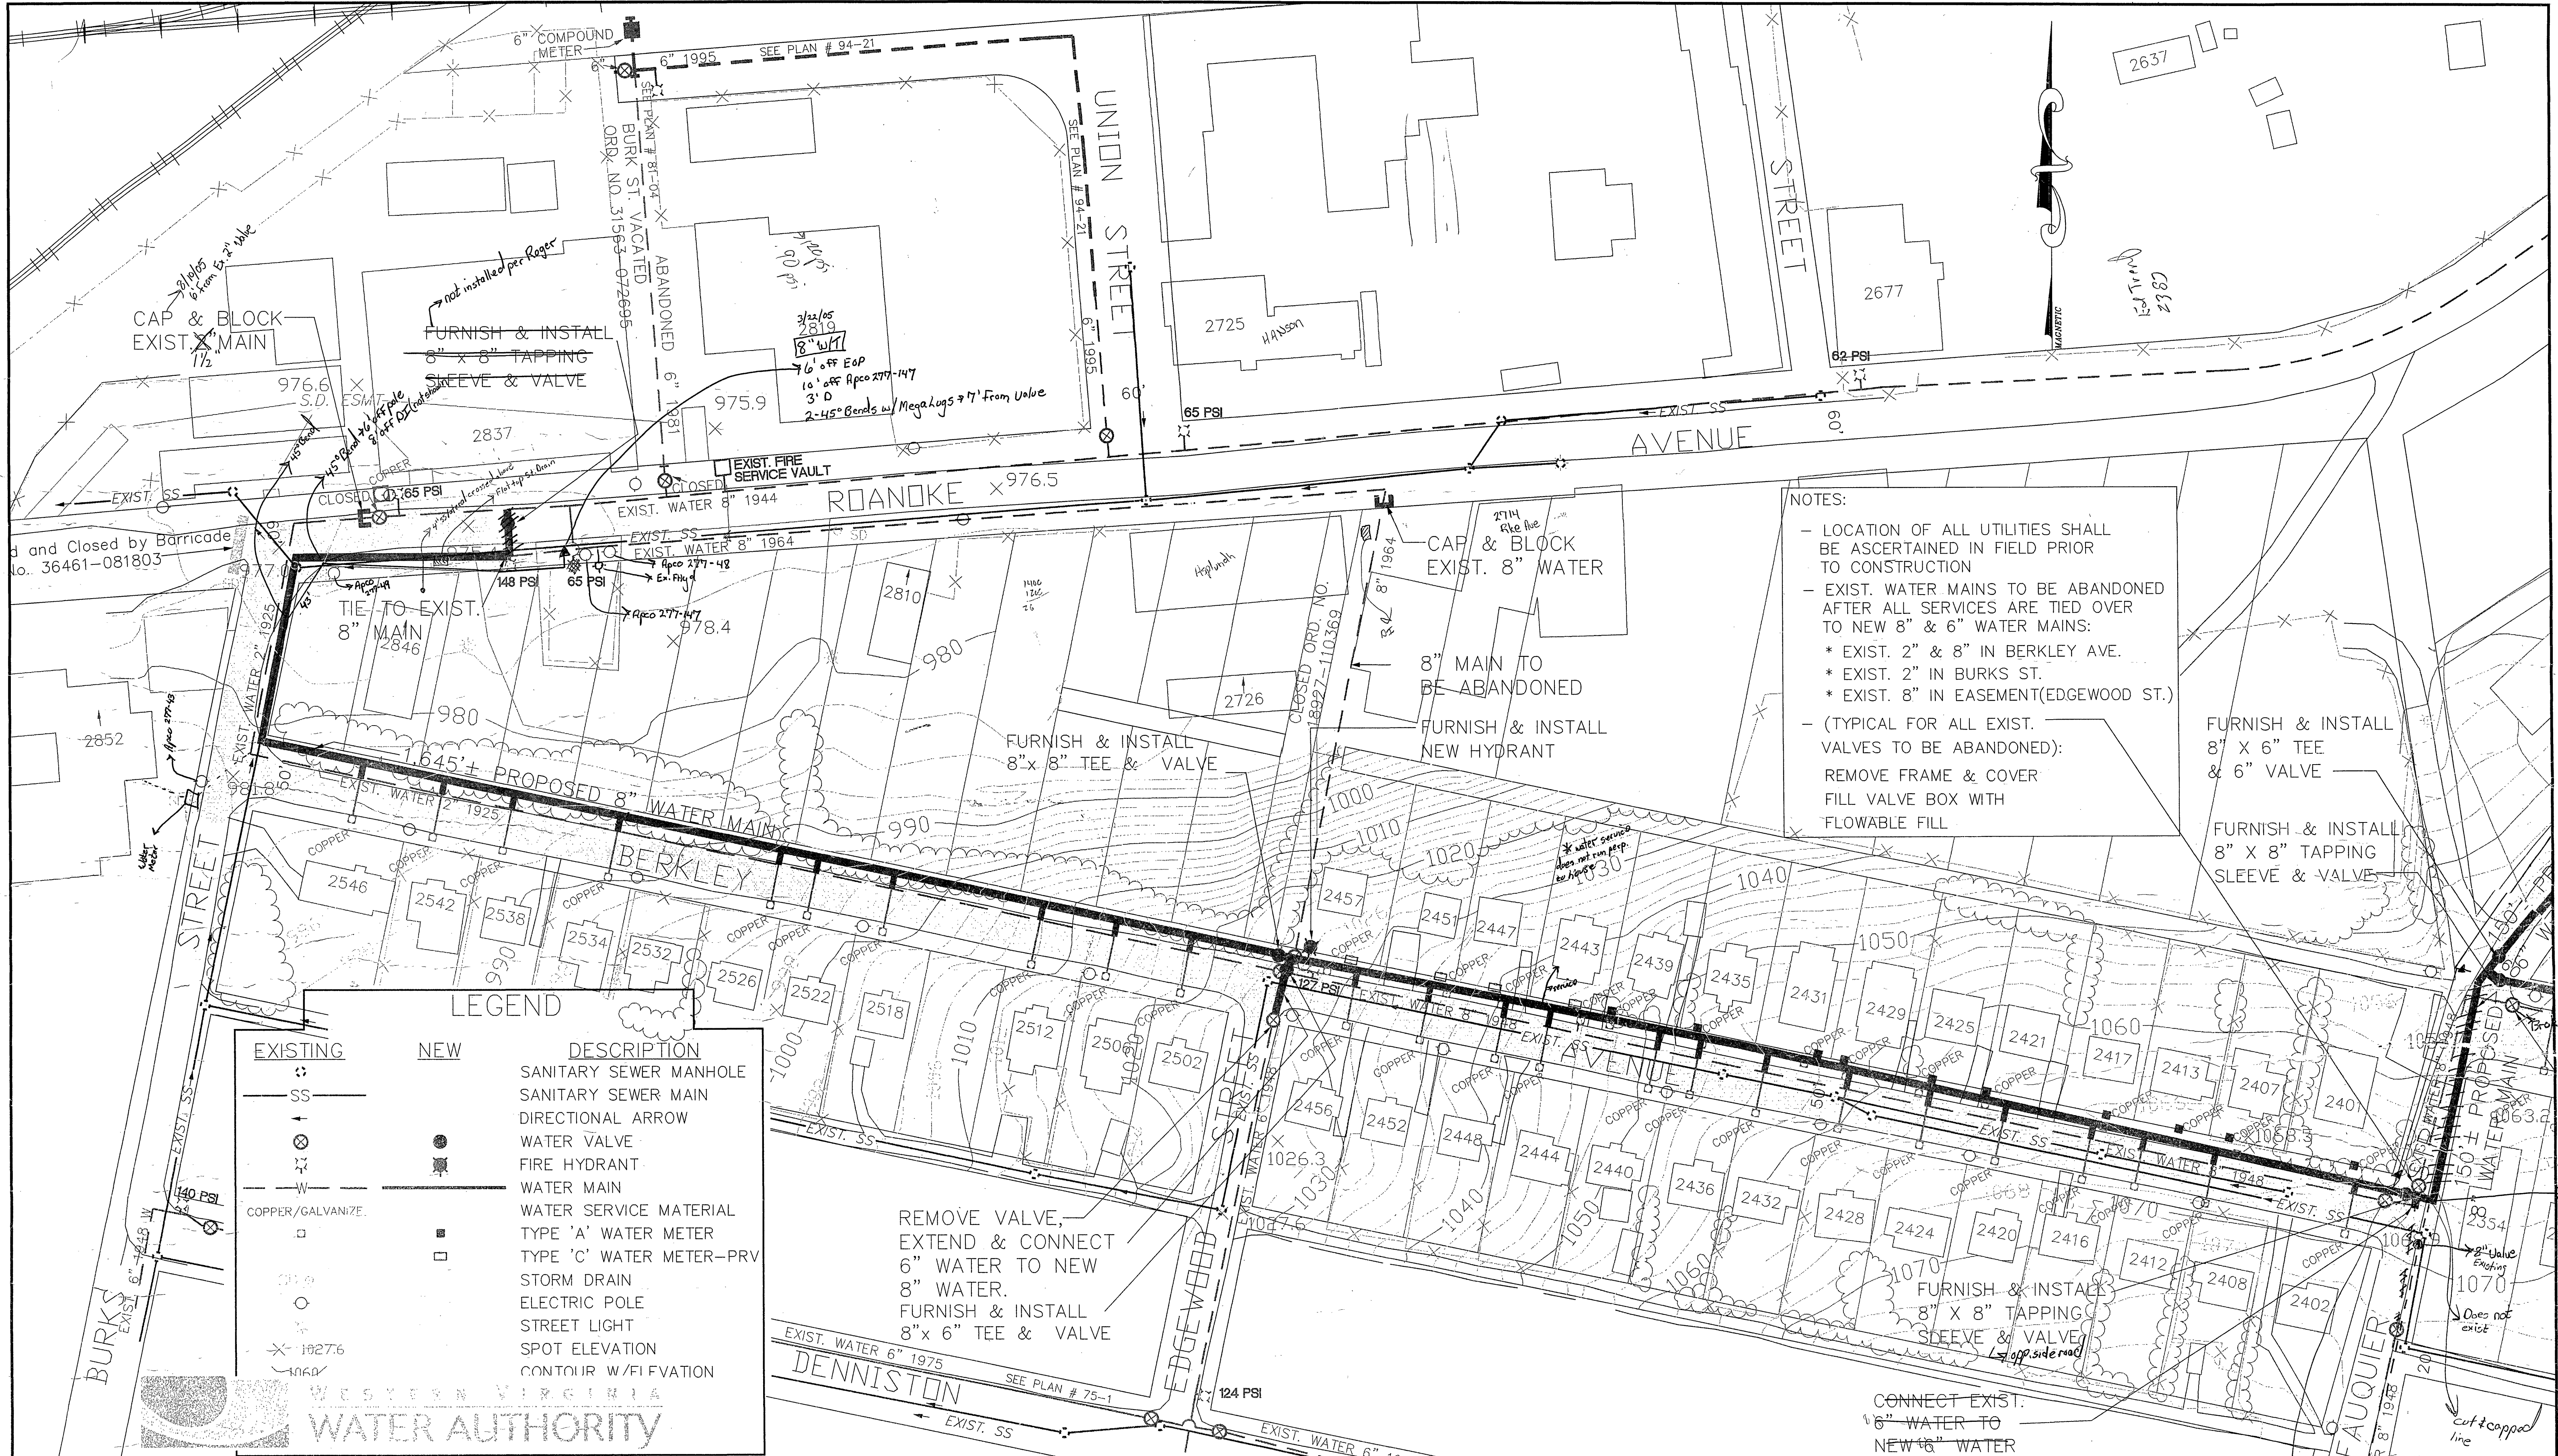

NOTES:

- LOCATION OF ALL UTILITIES SHALL BE ASCERTAINED IN FIELD PRIOR TO CONSTRUCTION
- EXIST. WATER MAINS TO BE ABANDONED AFTER ALL SERVICES ARE TIED OVER TO NEW 8" & 6" WATER MAINS:
 - * EXIST. 2" & 8" IN BERKLEY AVE.
 - * EXIST. 2" IN BURKS ST.
 - * EXIST. 8" IN EASEMENT(EDGEWOOD ST.)
- (TYPICAL FOR ALL EXIST. VALVES TO BE ABANDONED):
 - REMOVE FRAME & COVER
 - FILL VALVE BOX WITH FLOWABLE FILL

FURNISH & INSTALL 8" X 6" TEE & 6" VALVE

FURNISH & INSTALL 8" X 8" TAPPING SLEEVE & VALVE


EXISTING	NEW	DESCRIPTION
SS		SANITARY SEWER MANHOLE
SS		SANITARY SEWER MAIN
→		DIRECTIONAL ARROW
⊗		WATER VALVE
⊙		FIRE HYDRANT
W		WATER MAIN
□		WATER SERVICE MATERIAL
○		TYPE 'A' WATER METER
○		TYPE 'C' WATER METER-PRV
○		STORM DRAIN
○		ELECTRIC POLE
×		STREET LIGHT
×		SPOT ELEVATION
—		CONTOUR W/F ELEVATION

WESTERN VIRGINIA
WATER AUTHORITY

ENGINEERING SERVICES
2012 S. JEFFERSON STREET
SUITE 100
ROANOKE, VIRGINIA 24014
PHONE: (540) 853-5468
FAX: (540) 853-1017

REV.	DATE:	DESCRIPTION
1	4/10/05	pressure tested from WPA on Ave Ave to intersection Edgewood/Berkley Ave 175 psi 1 1/2 hr
2	1/19/05	pressure tested from Edgewood to Fauquier 175 psi 1 1/2 hr

Drawn By:	NHP
Designed By:	LET
Checked By:	JGR
Date:	10/12/2004
Scale:	1" = 50'

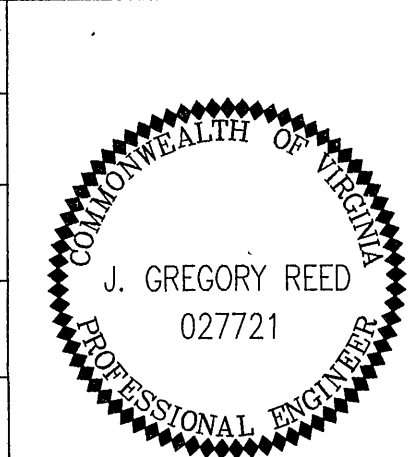

BERKLEY AVENUE, SW BURKS ST. TO CHESTERFIELD ST. WATERLINE REPLACEMENT

TAX MAP#: 143, 151, 152
CAD MAP#: 0631

PATH: C:\Land Projects 2004\CIP\BerkleyAveBurksSttoChesterfieldStSW.dwg

SHEET	1 of 2
PLAN NO.	

x does have pressure come off 8"