


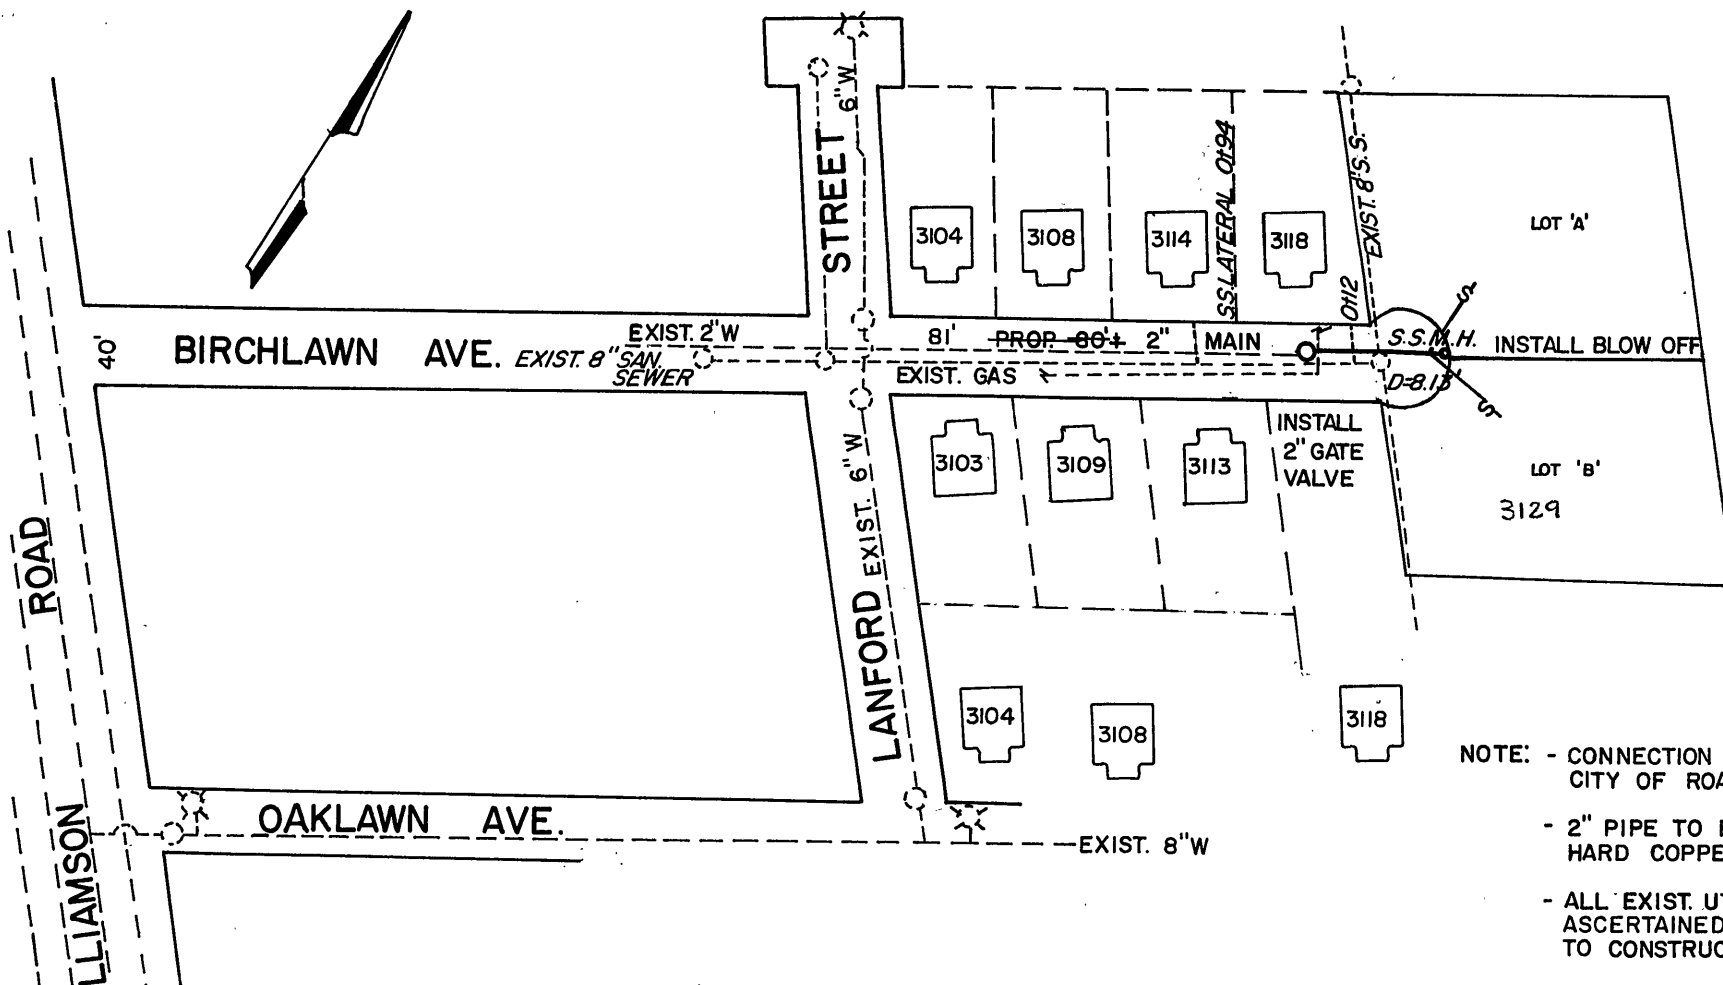

NOTE: - CONNECTION TO BE MADE BY CITY OF ROANOKE.

- 2" PIPE TO BE TYPE K HARD COPPER.

- ALL EXIST. UTILITIES SHALL BE ASCERTAINED IN THE FIELD PRIOR TO CONSTRUCTION.

STARTED 9-7-89				
WATER COMP. 9-12-89				
FEET MAIN	SIZE	VALVE	VAULT	BOX
81' CI	2"	2		#1
BLOW OFF	2"	2		#1
W.H. COMP.				
W.H. STUB ONLY				
SERV. INS. BY:				
MAIN INS. BY: C.O. DAME				
NO. 1/2" SERV. INS.				
CITY OR CO. CITY				
DEPT. INSP. U.L.S. - C.O. DAME				

WATER DEPARTMENT	
ROANOKE	VIRGINIA
BIRCHLAWN AVE., N.W.	
SCALE: 1"=100'	1/23/89
DATE: 1/19/89	DIRECTOR UTILITIES & OPERATIONS DATE
DIST. MAP: 217	1-24-89
PLAN NO.: 89-01	DIRECTOR OF PUBLIC WORKS DATE

Joseph H. Parker
MANAGER UTILITY LINE SERVICES