


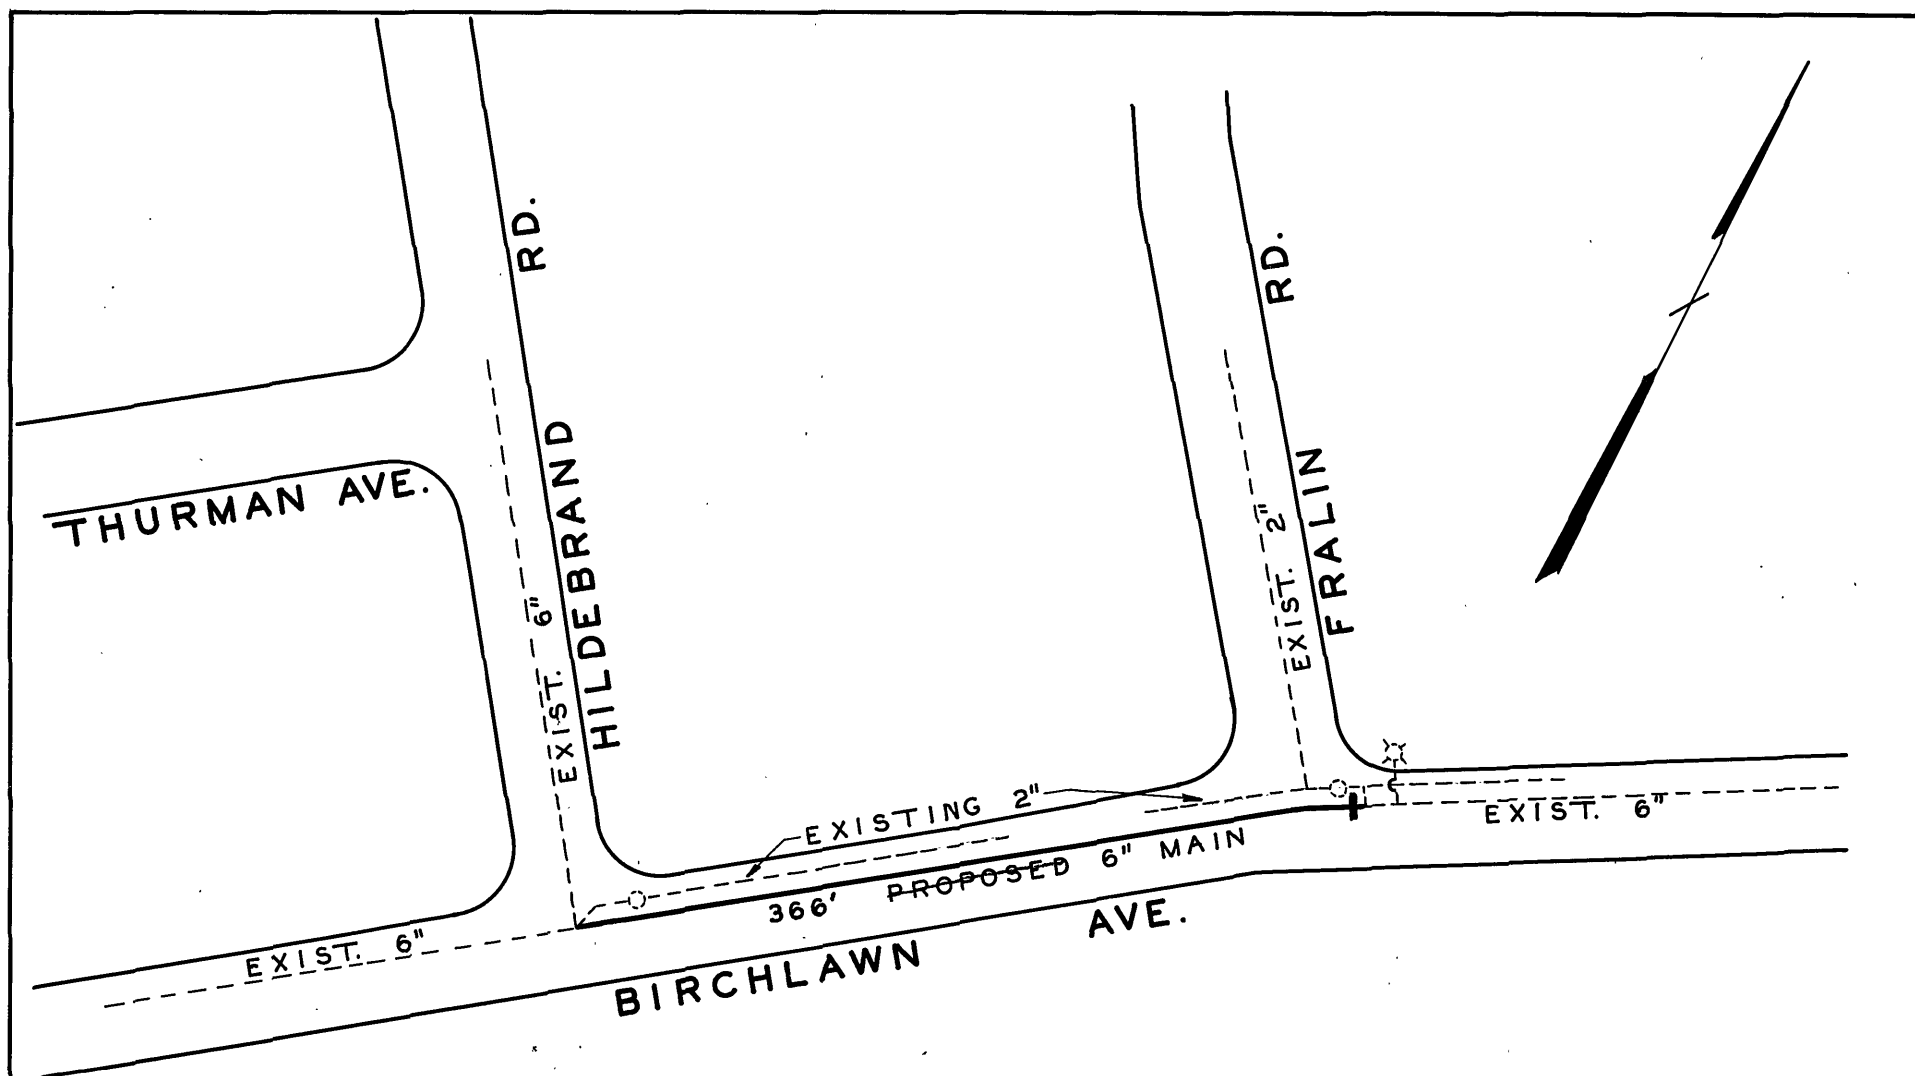

DATE STARTED 9-12-61				
DATE COMP. 9-15-61				
FEET MAIN	SIZE	VALVE	VAULT	BOX
366	6"	1	1	
F. H. COMP.				
F. H. STUB ONLY				
SERV. INS. BY:				
MAINS INS. BY: B. R. H.				
NO. 3/4" SERV. INS.				
CITY OR CO. CITY				
DEPT. INSP.				

WATER DEPARTMENT
CITY OF ROANOKE, VA.
BIRCHLAWN AVE. N.W.

SCALE - 1" = 100'
DRAWN BY N. H. C. SEPT. 13, 1961

61-30