


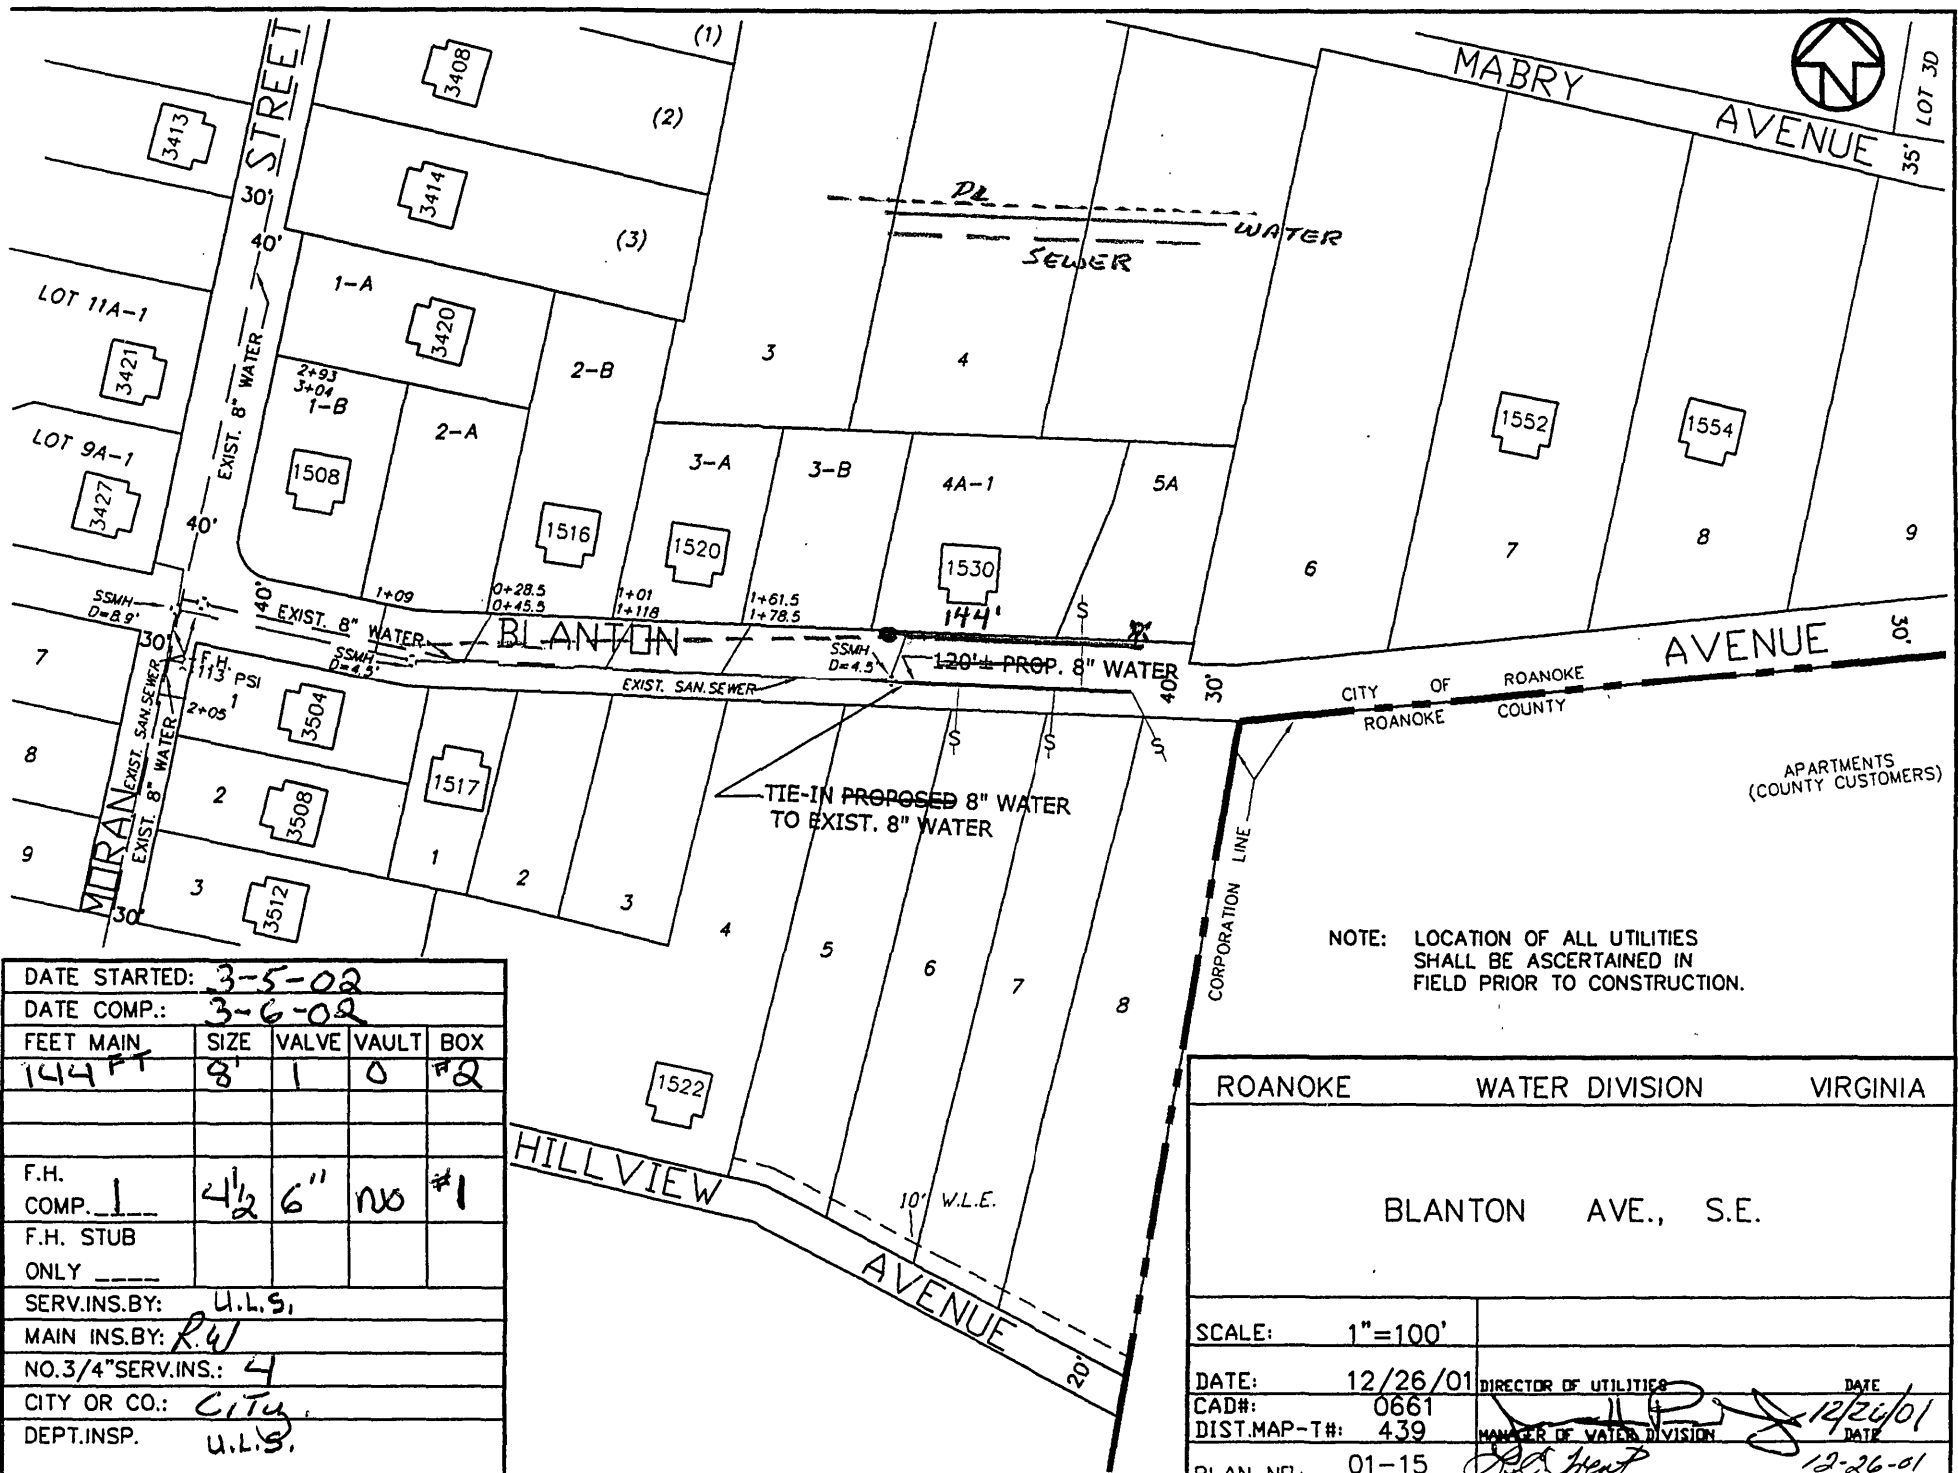

DATE STARTED: 3-5-02				
DATE COMP.: 3-6-02				
FEET MAIN	SIZE	VALVE	VAULT	BOX
144 FT	8"	1	0	#2
F.H. COMP.	1	4 1/2	6"	no #1
F.H. STUB ONLY				
SERV. INS. BY: U.L.S.				
MAIN INS. BY: R.W.				
NO. 3/4" SERV. INS.: 4				
CITY OR CO.: City				
DEPT. INSP.: U.L.S.				

ROANOKE		WATER DIVISION		VIRGINIA	
BLANTON AVE., S.E.					
SCALE: 1"=100'					
DATE: 12/26/01		DIRECTOR OF UTILITIES		DATE	
CAD#: 0661		MANAGER OF WATER DIVISION		DATE	
DIST. MAP-T#: 439		01-15		12-26-01	