


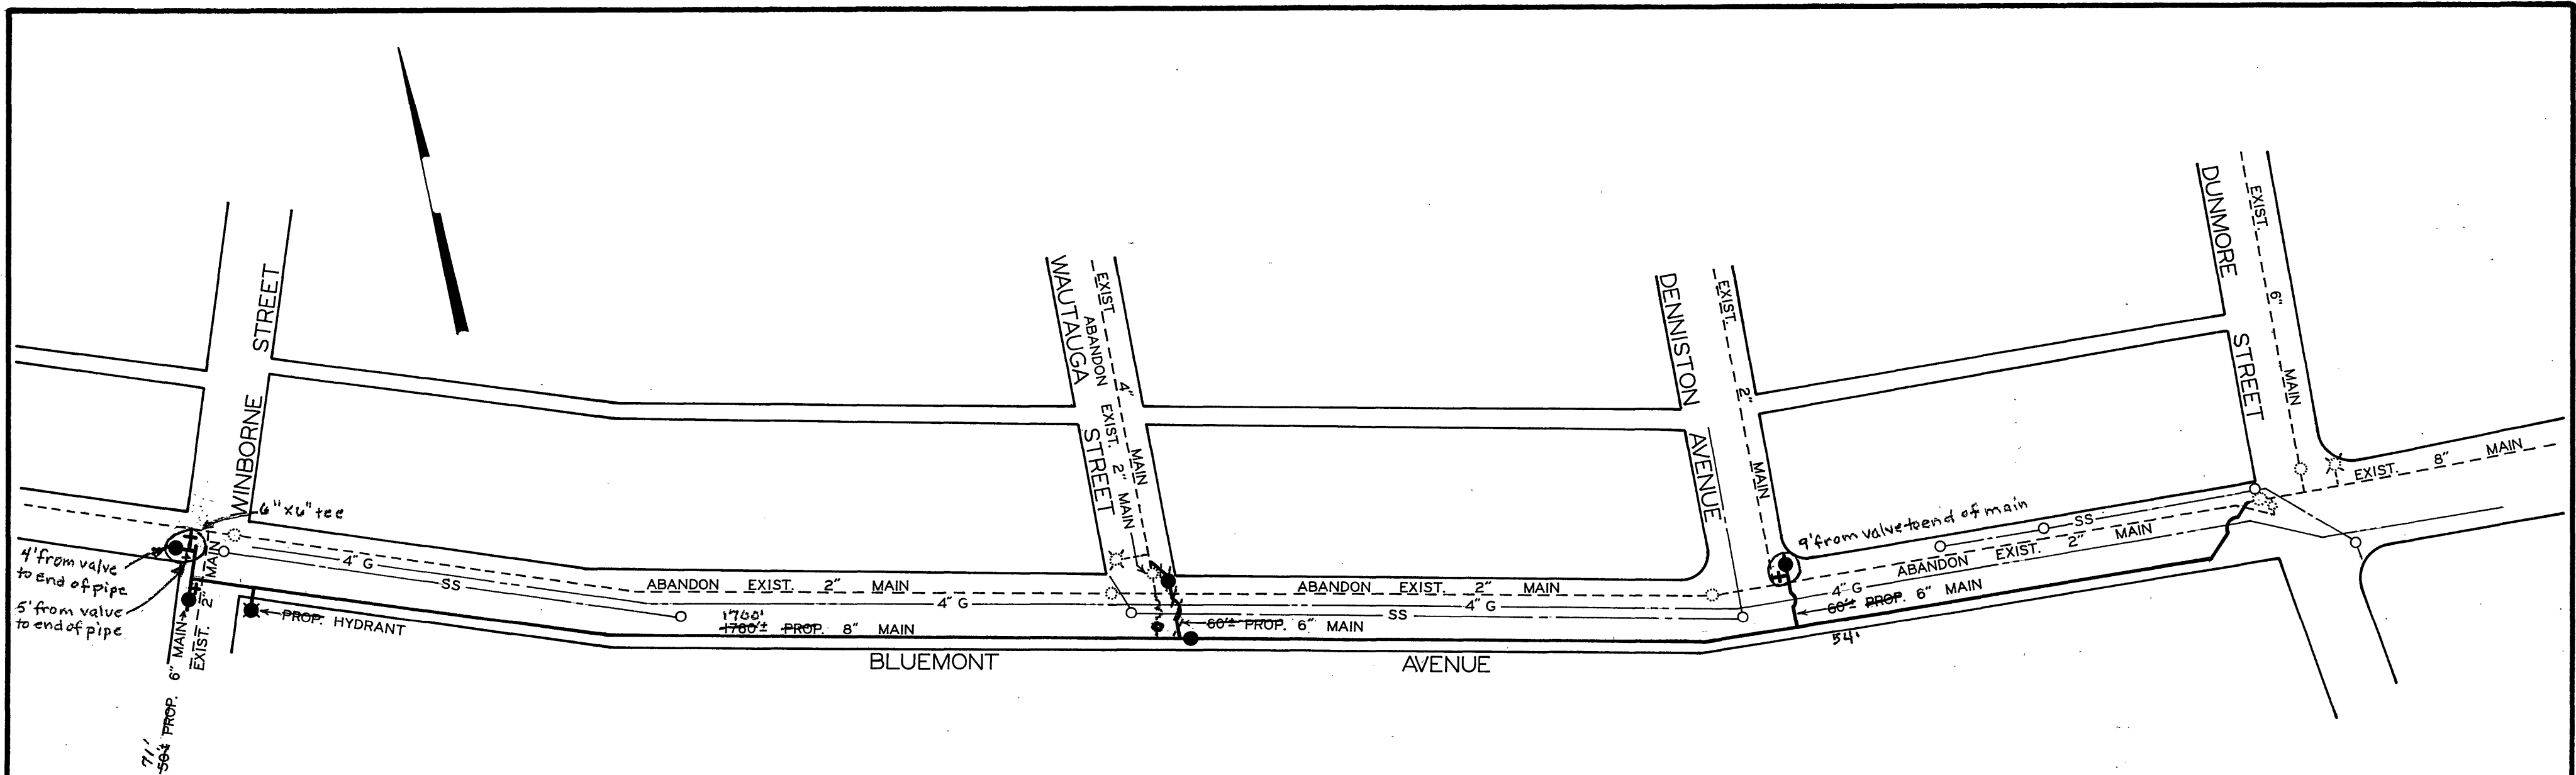

DATE STARTED					2-4-74	
DATE COMP.					2-25-74	
FEET MAIN		SIZE	VALVE	VAULT	BOX	
1700		8"	1	1		
125		6"	3	3		
4		2"	3			
F. H.		4"	1			
F. H. COMP.	<u>1</u>	6"	1	1		
F. H. STUB ONLY	<u> </u>					
SERV. INS. BY:						
MAIN INS. BY: <u>R.W.D.</u>						
NO. ¾" SERV. INS.						
CITY OR CO. <u>CITY</u>						
DEPT. INSP. <u>J.W. MAXEY</u>						

2" valves in vault w/6" valves

C. B. B...
 DIRECTOR UTILITIES & OPERATIONS
Richard B. J...
 CITY ENGINEER OF ROANOKE, VA.
 DIRECTOR OF PUBLIC WORKS

1/29/74
 DATE
6/29/74
 DATE
1/30/74
 DATE

WATER DEPARTMENT
 CITY OF ROANOKE, VA.
 BLUEMONT AVENUE S.W.
 SCALE - 1"=100'
 DRAWN BY C.A.H. JAN. 29, 1974