


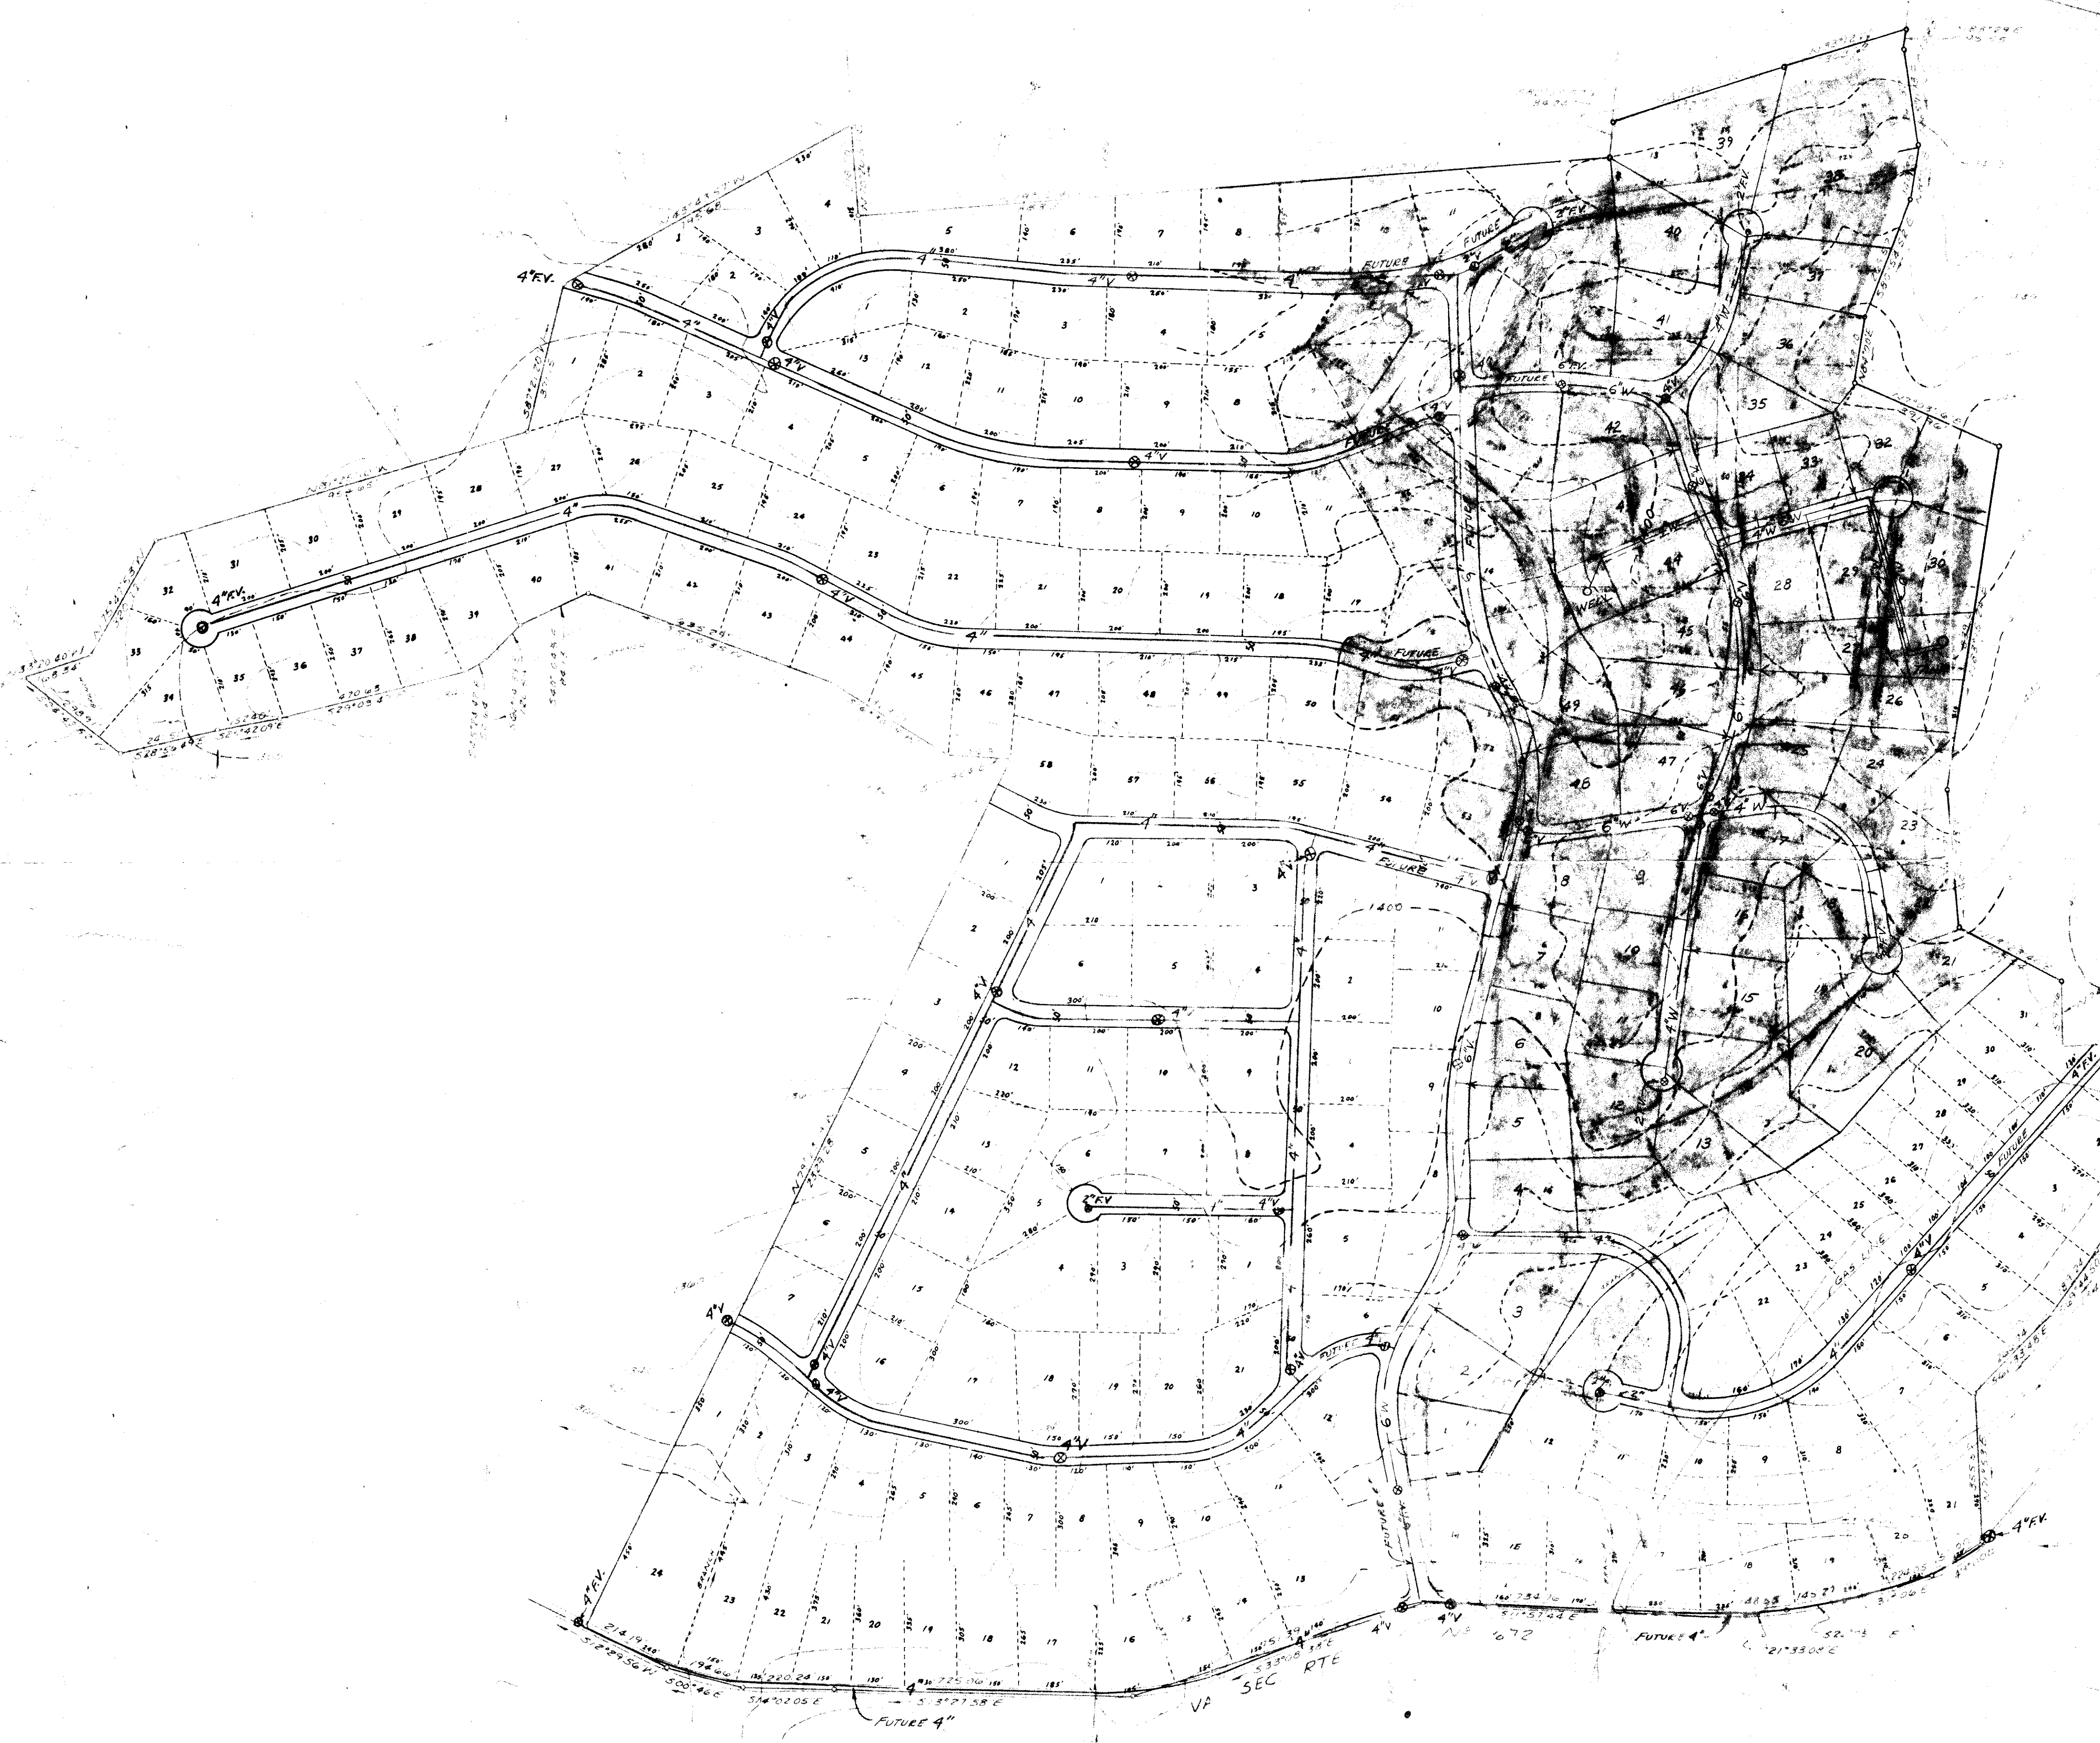

- NOTES**
1. WATER DISTRIBUTION SYSTEM SHALL BE 200 R.V.C. PIPE.
 2. FITTINGS SHALL BE A.W.W.A. STD. CLASS M.U. WITH TRANSITION RINGS FOR ADAPTING R.V.C. PIPE.
 3. VALVES SHALL BE A.W.W.A. STD. CLASS 12 M.U. WITH TRANSITION RINGS FOR ADAPTING R.V.C. PIPE.
 4. ADEQUATE THRUST BLOCKS ARE TO BE PROVIDED FOR ALL CHANGES IN PIPE SIZE.

- LEGEND**
- 6" W. = 6 INCH P.V.C. WATER PIPE
 - 4" W. = 4 INCH P.V.C. WATER PIPE
 - CV = CAST IRON VALVE WITH ADJUSTABLE VALVE BOX
 - FV = FLUSH VALVE ENCLOSED IN STANDARD PRE-CAST MANHOLE
 - LOT LINE
 - METER SERVICE

DAL-NITA HILLS
WATER DISTRIBUTION SYSTEM
DALLAS BYRD
 SHOWING 270 ACRE TRACT
 CONTAINING 150 ONE ACRE LOTS
 BOTETOURT COUNTY, VIRGINIA
 SCALE: 1"=200' NOVEMBER 10, 1972
 BY: T.P. PARKER & SON
 ENGINEERS & SURVEYORS

REVISED: (LEGEND ADDED) JUNE 1, 1974