
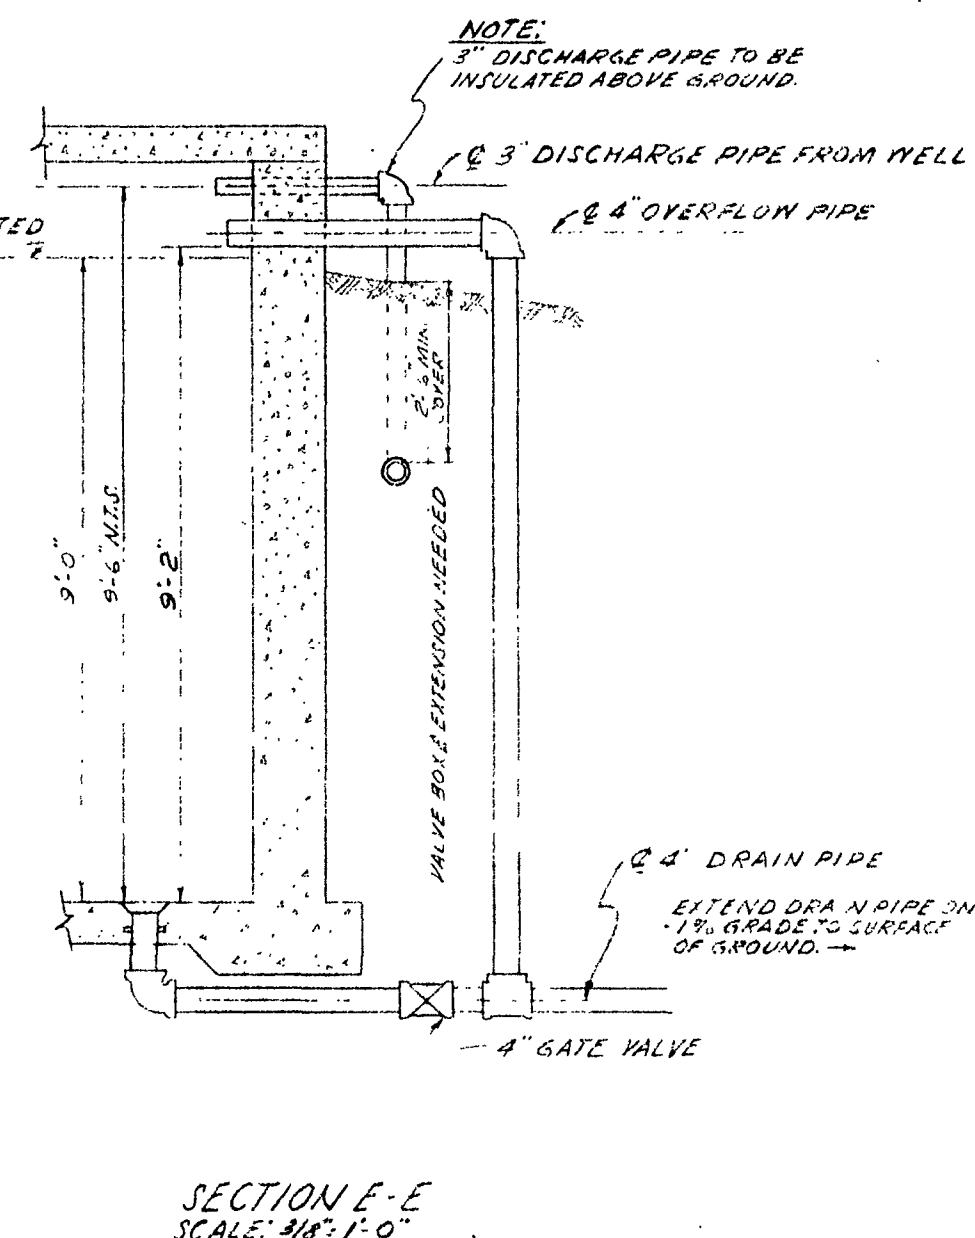
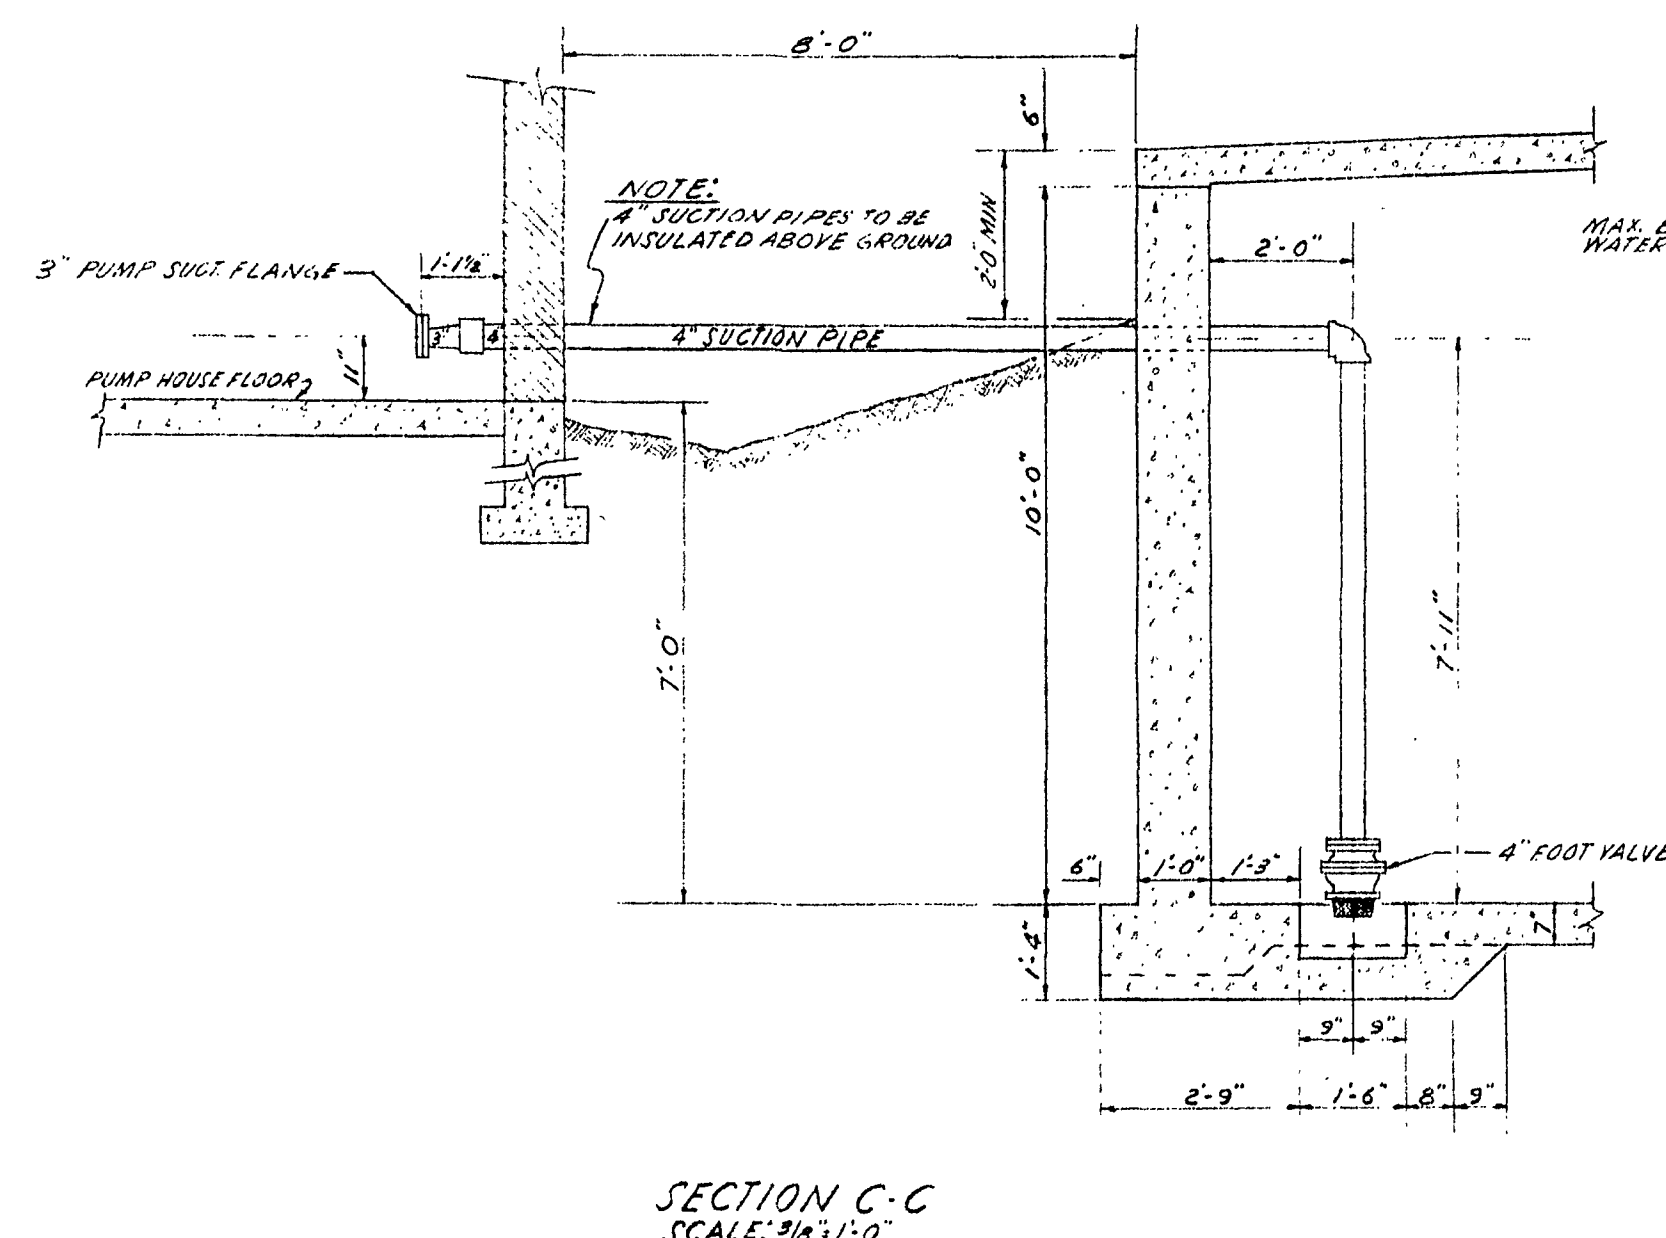
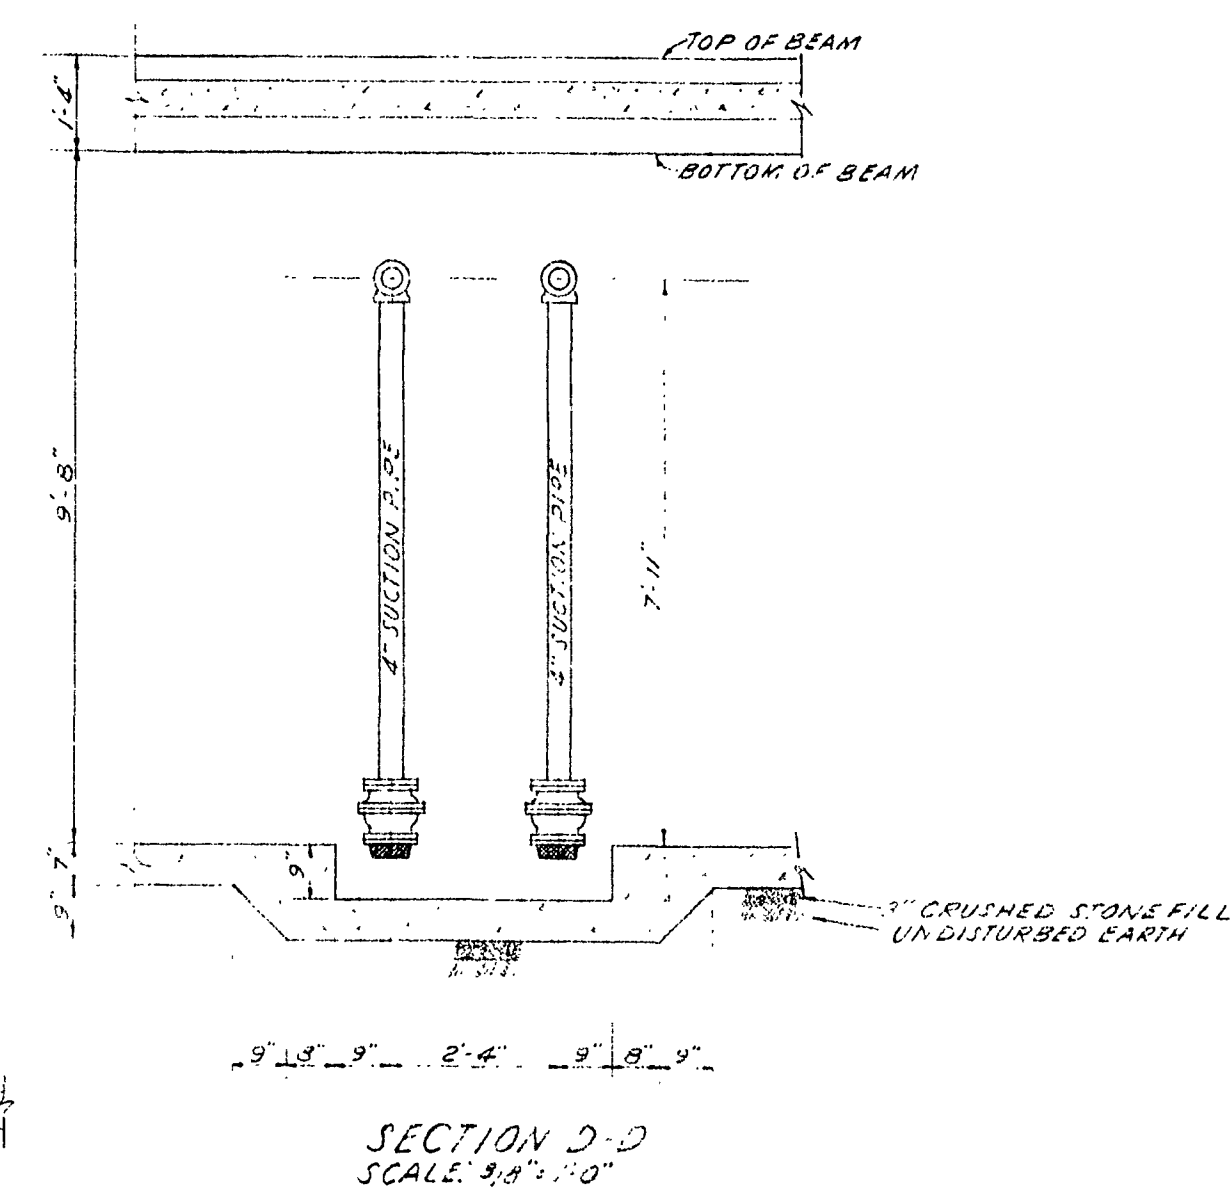
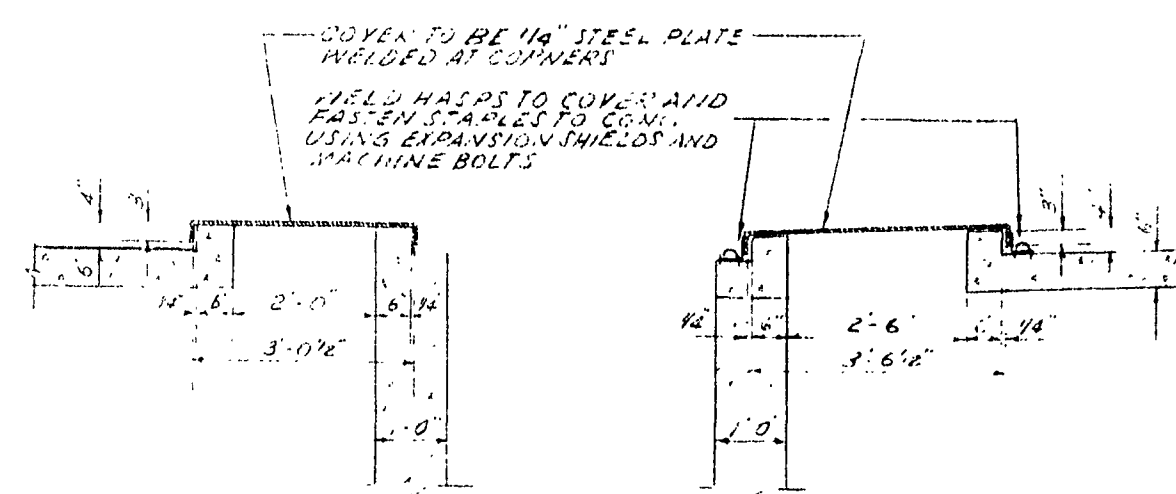
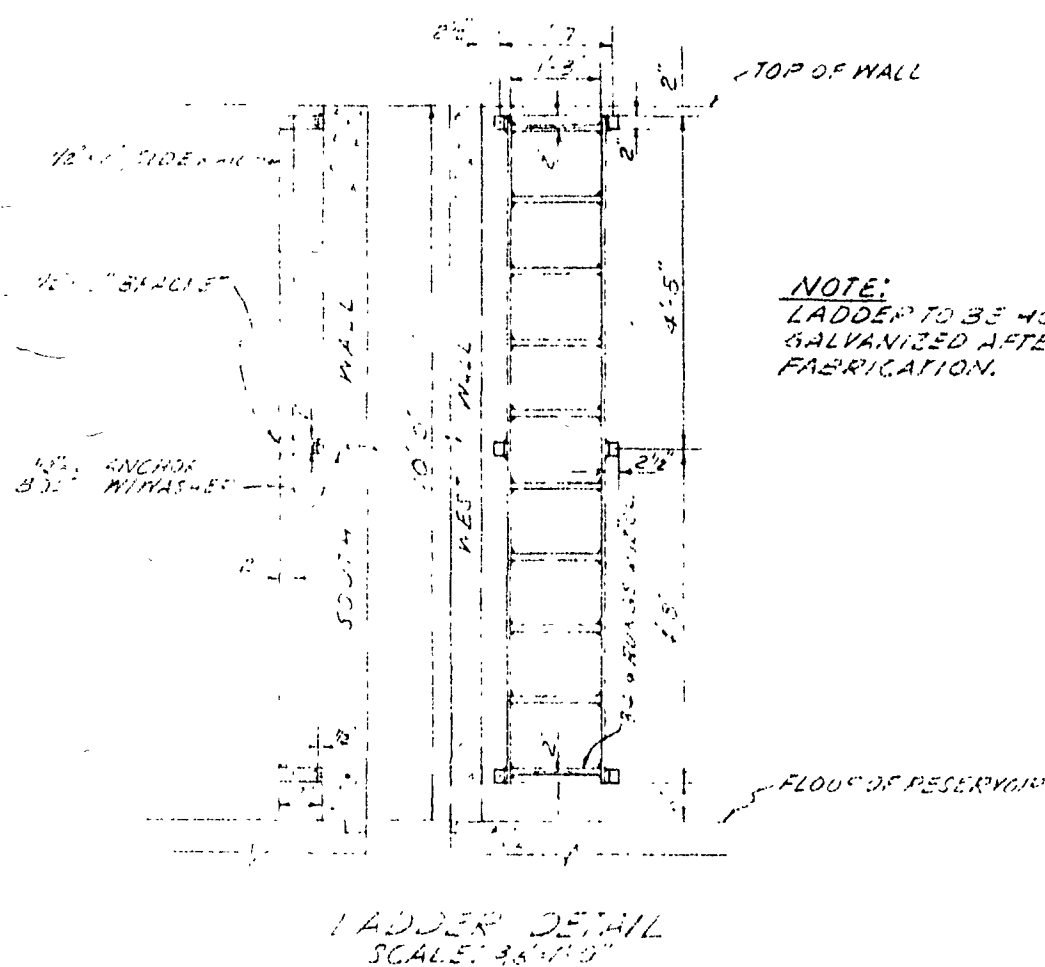
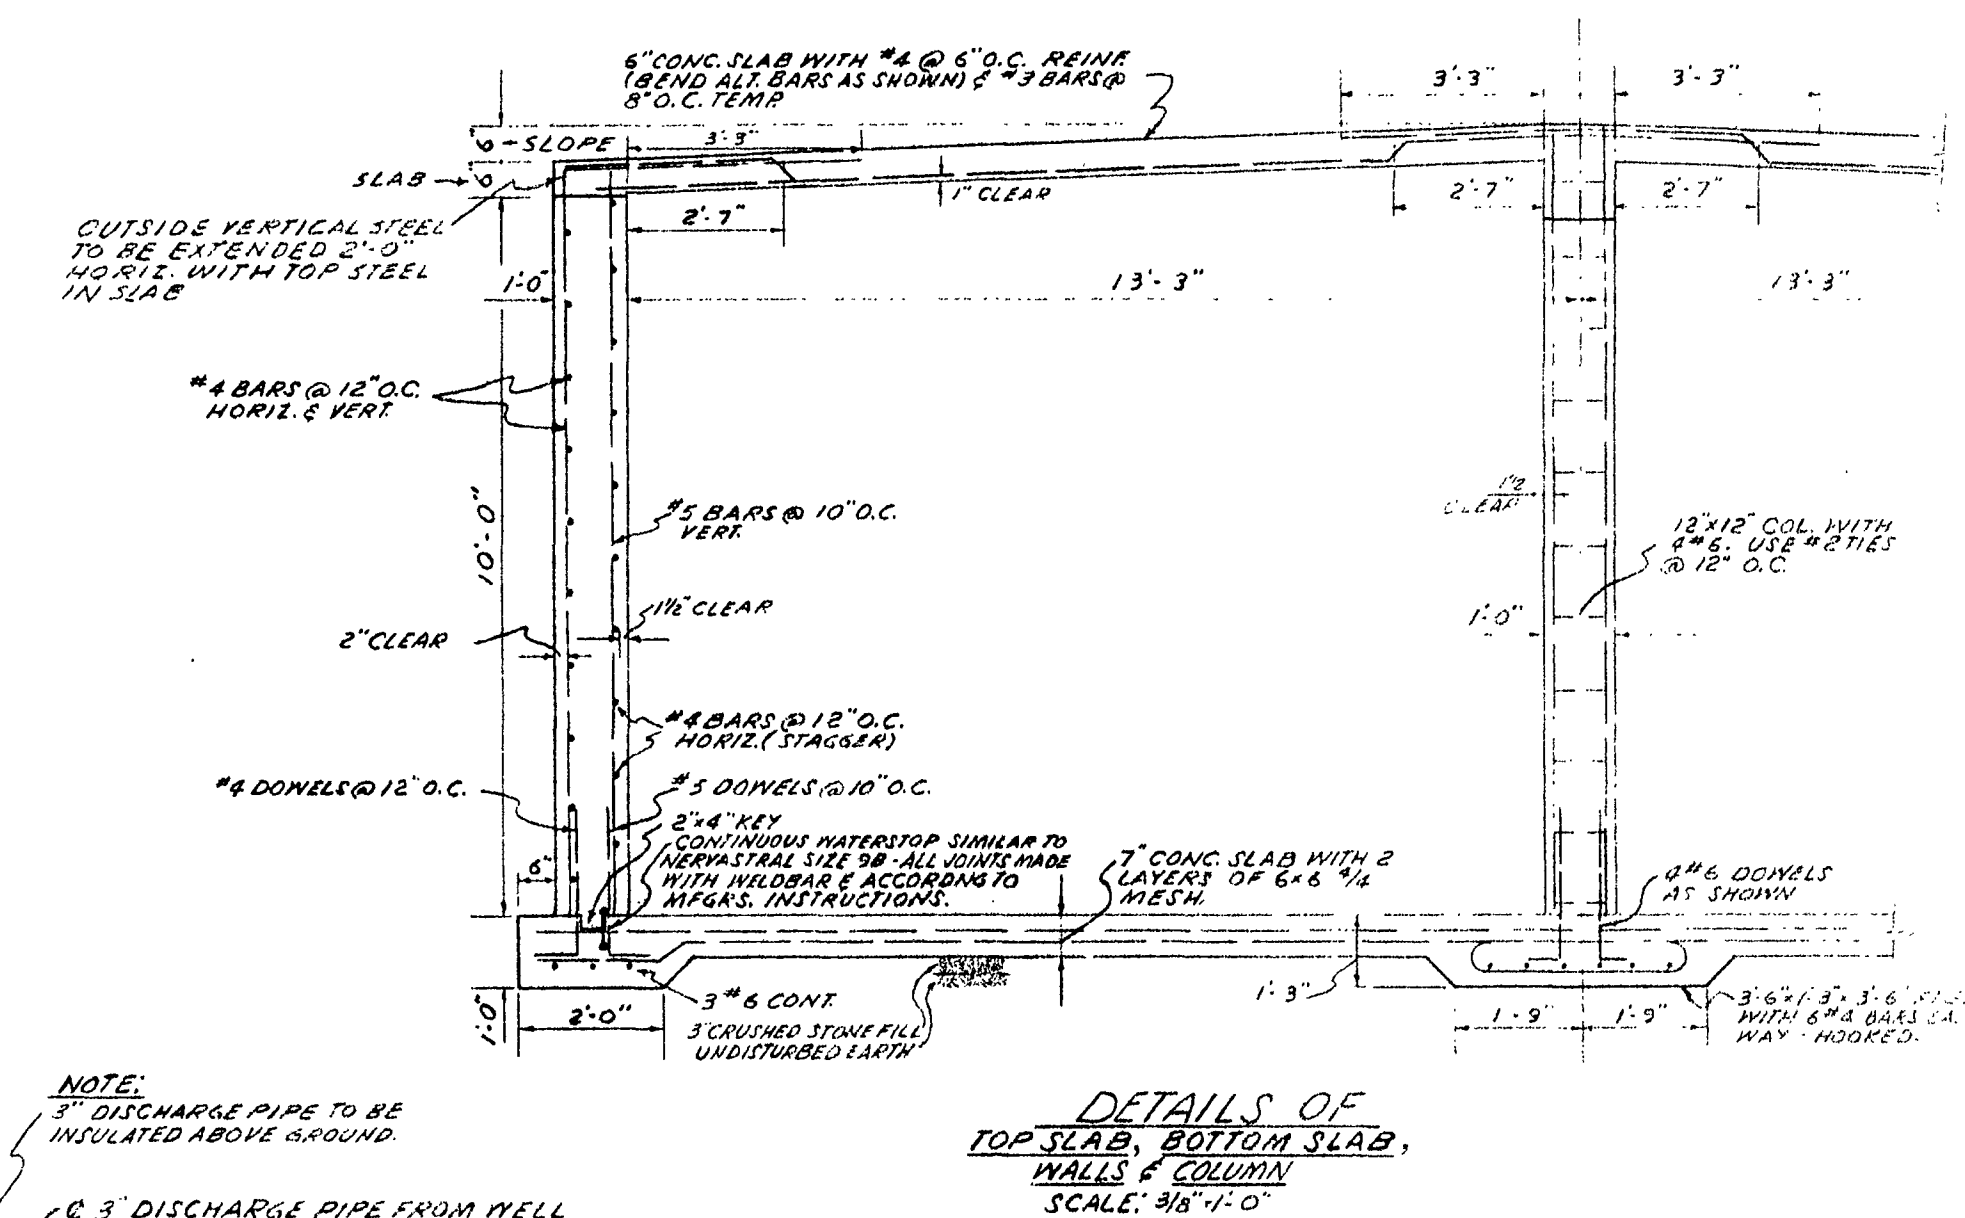
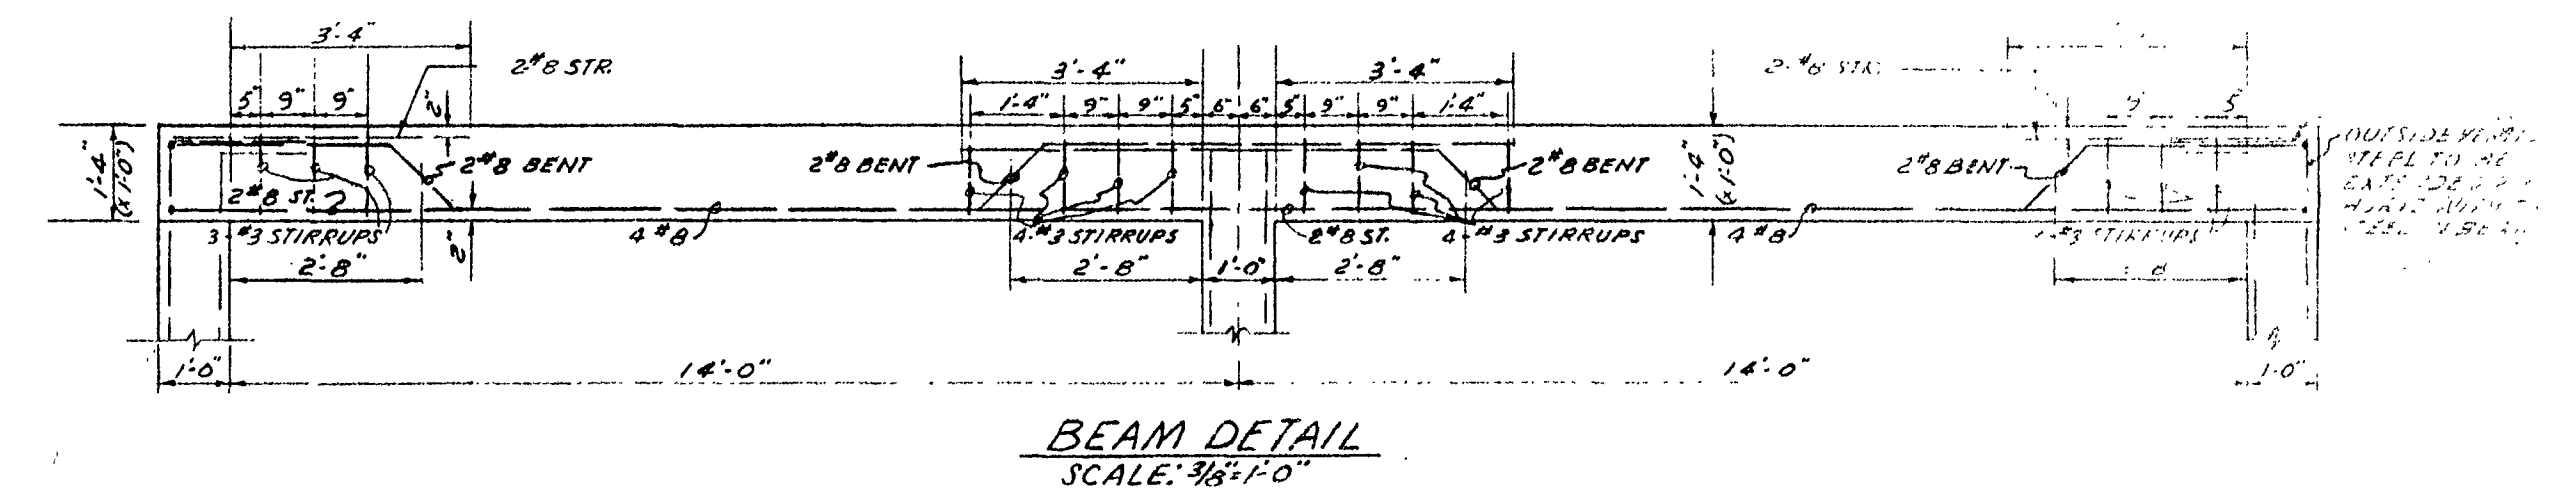


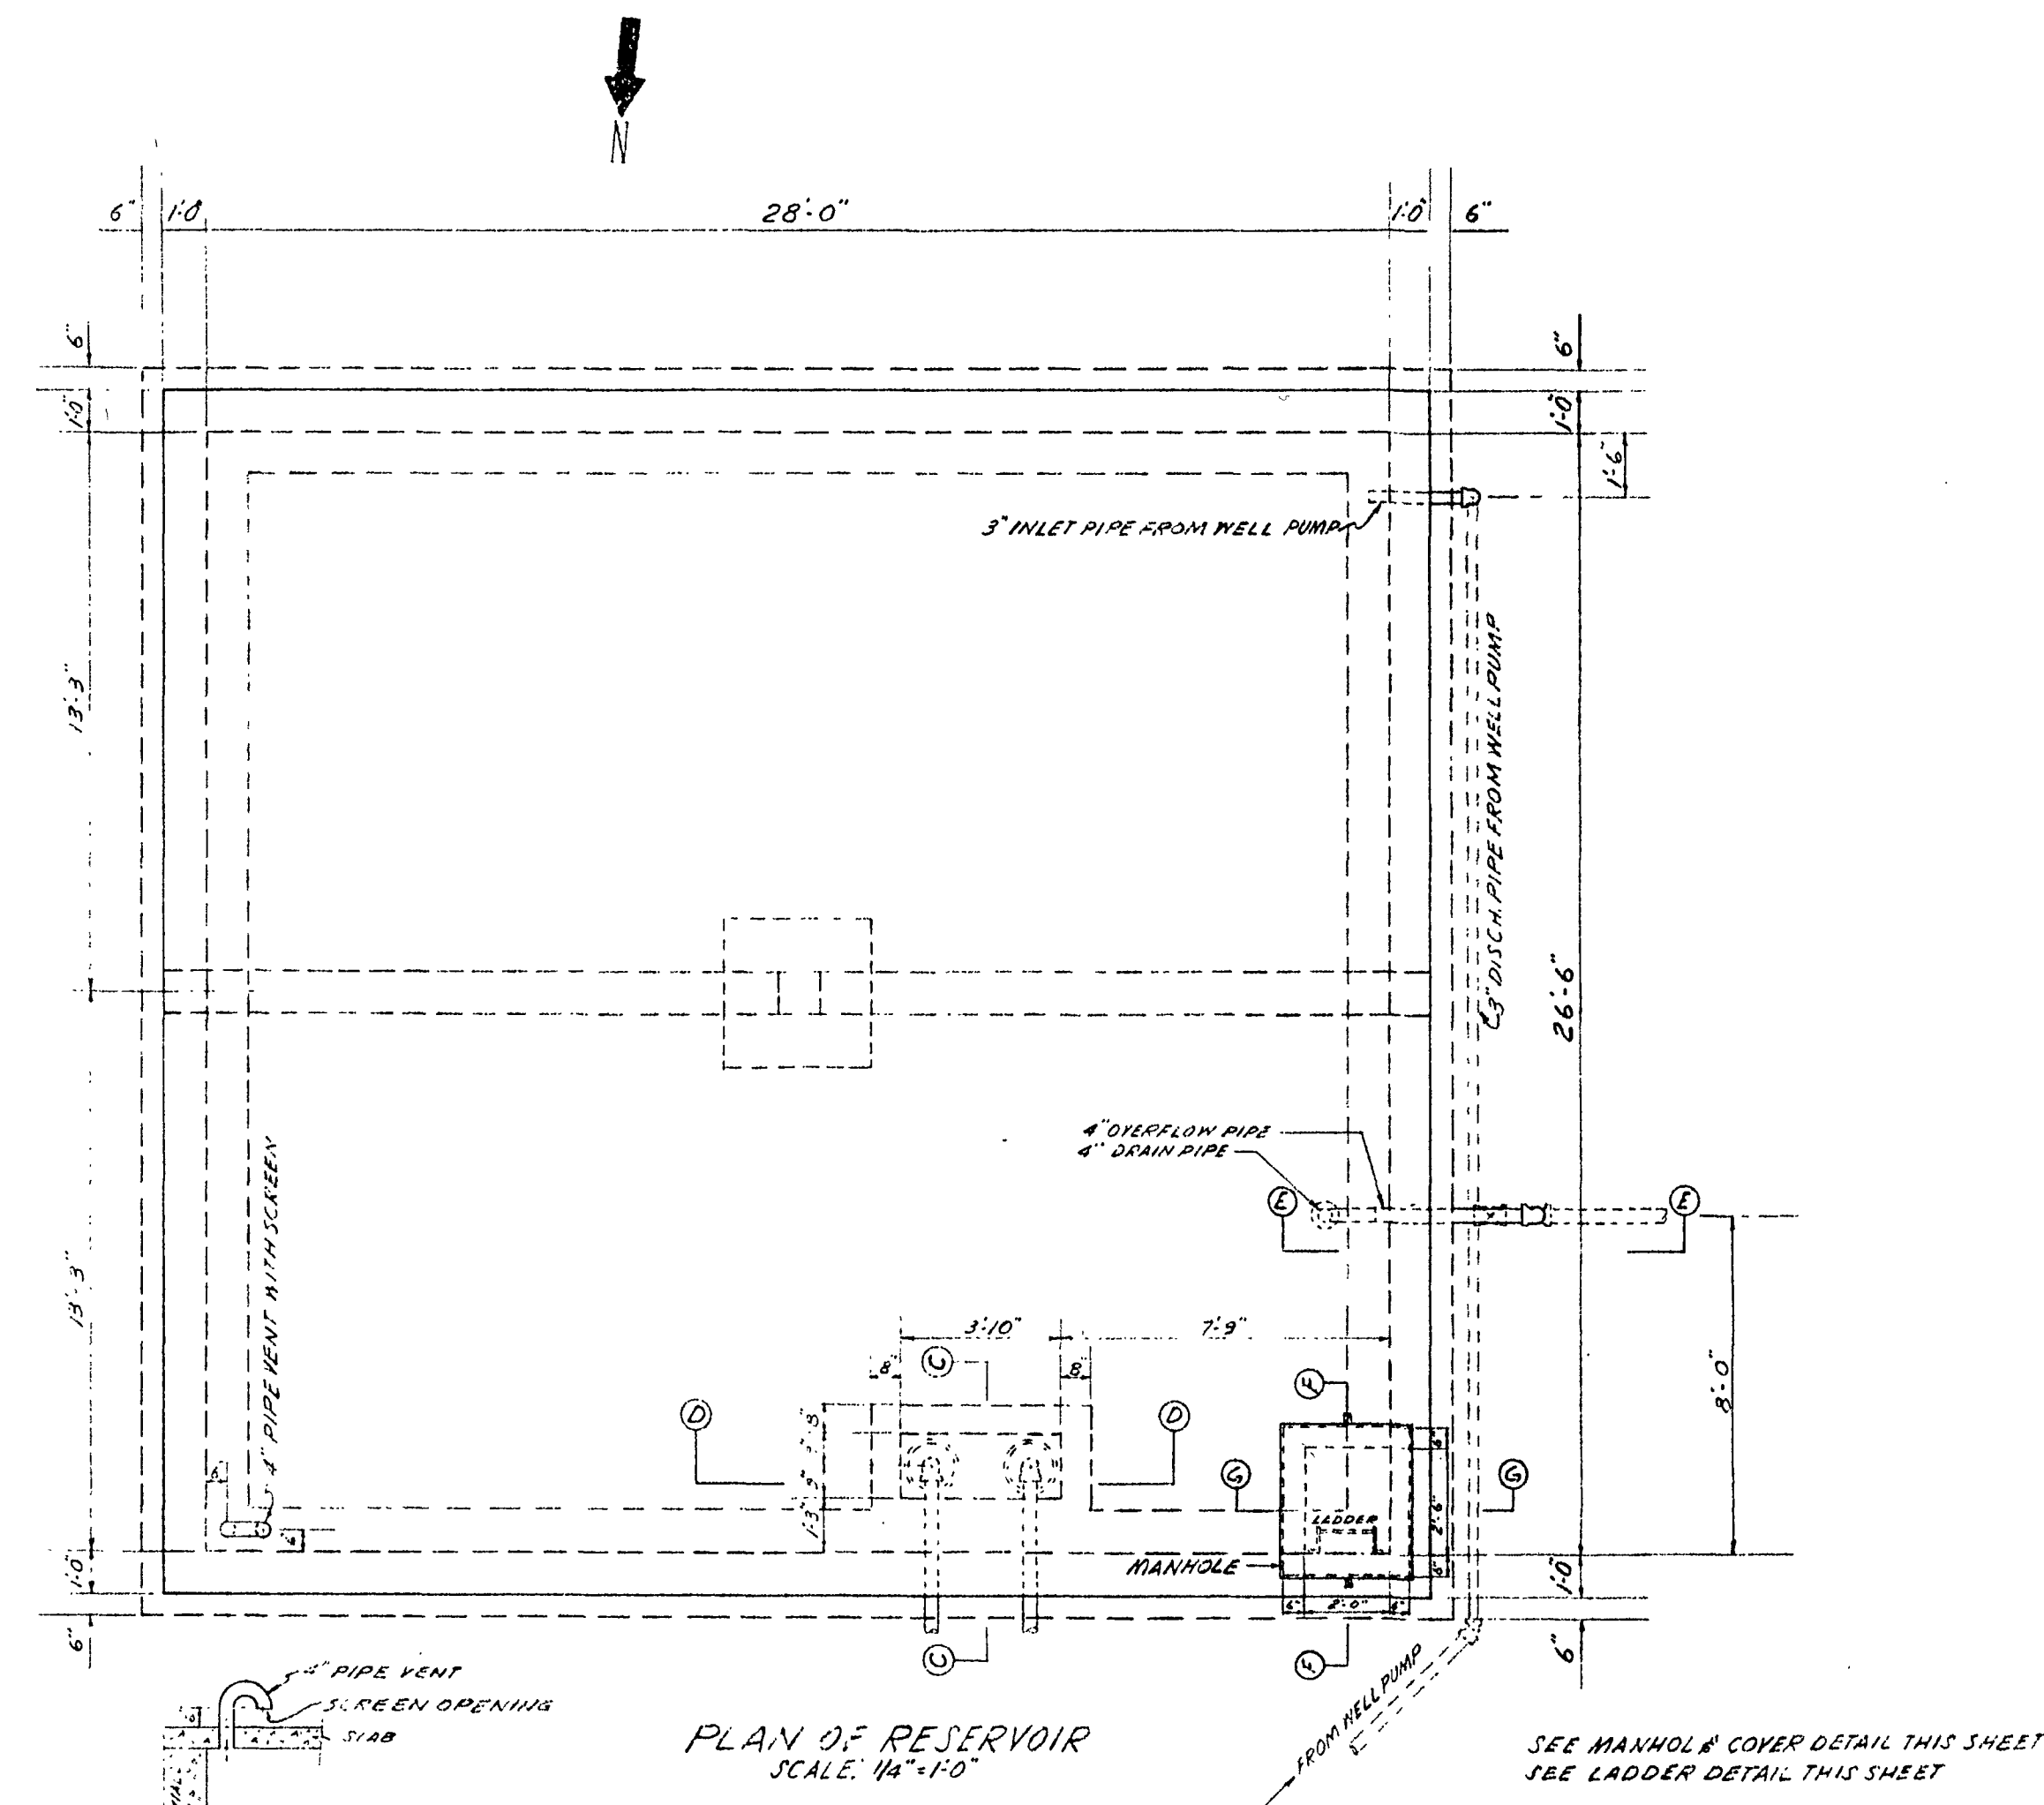

NOTE:
ALL CONCRETE = 3,000 P.S.I. IN 28 DAYS
ALL REINFORCING STEEL = 60,000 P.S.I. DEFORMED BARS
USE PLAIN WELDED WIRE MESH
REINFORCING STEEL SHALL HAVE 5% TENSILE OVERSTRESS
OF 1/4" SLAB, 3/8" WASTES AND 1/2" AND 3/4" DIA. IN
WALL AND IN BEAMS.

AZALEA ROAD
 PLAN OF RESERVOIR
 FOR
 TINKERVUE WATER COMPANY
 AT
 TINKERVUE GARDENS
 BOTETOURT CO., VIRGINIA.
DAVID DICK & ASSOCIATES
 ENGINEERS & SURVEYORS
 DATE: MAY 31, 1972 SCALE: AS SHOWN

JOB N° 9050