
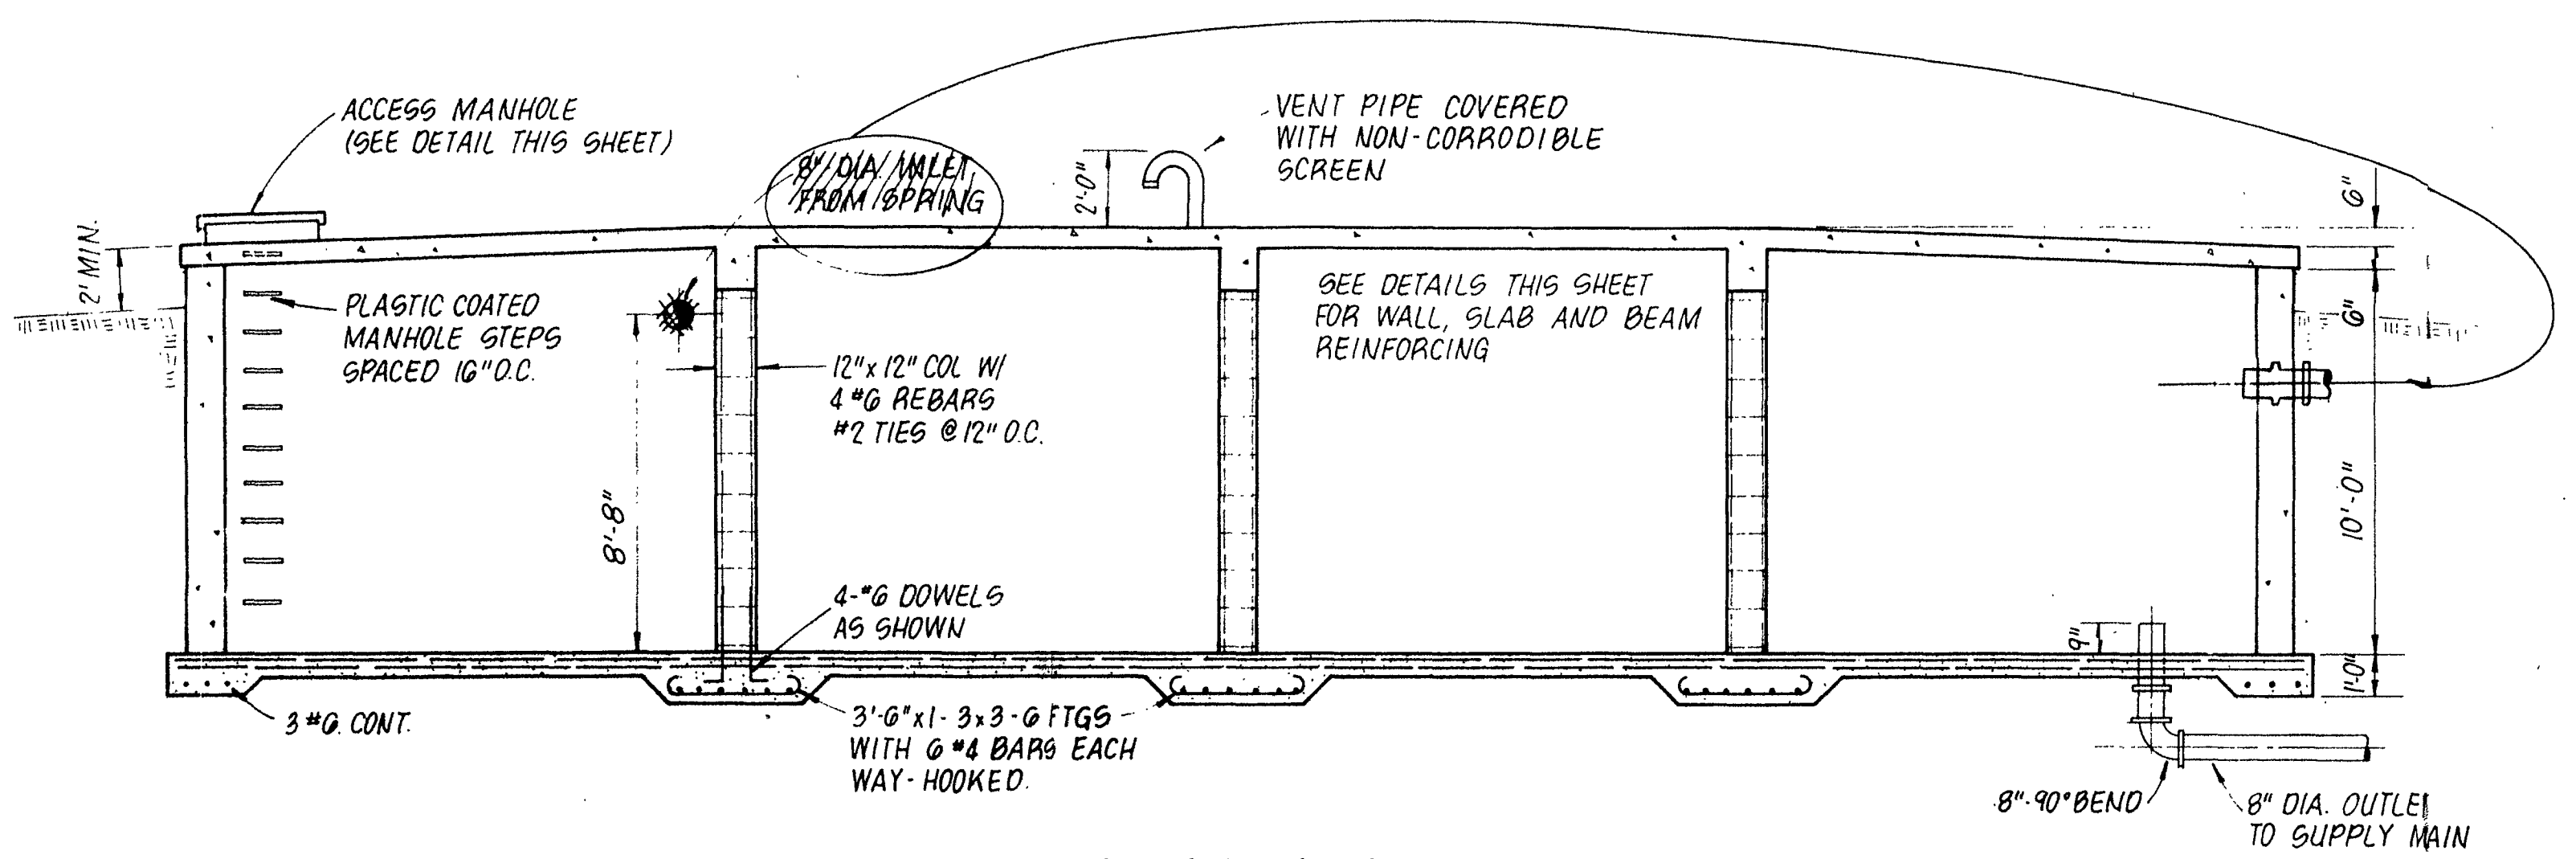




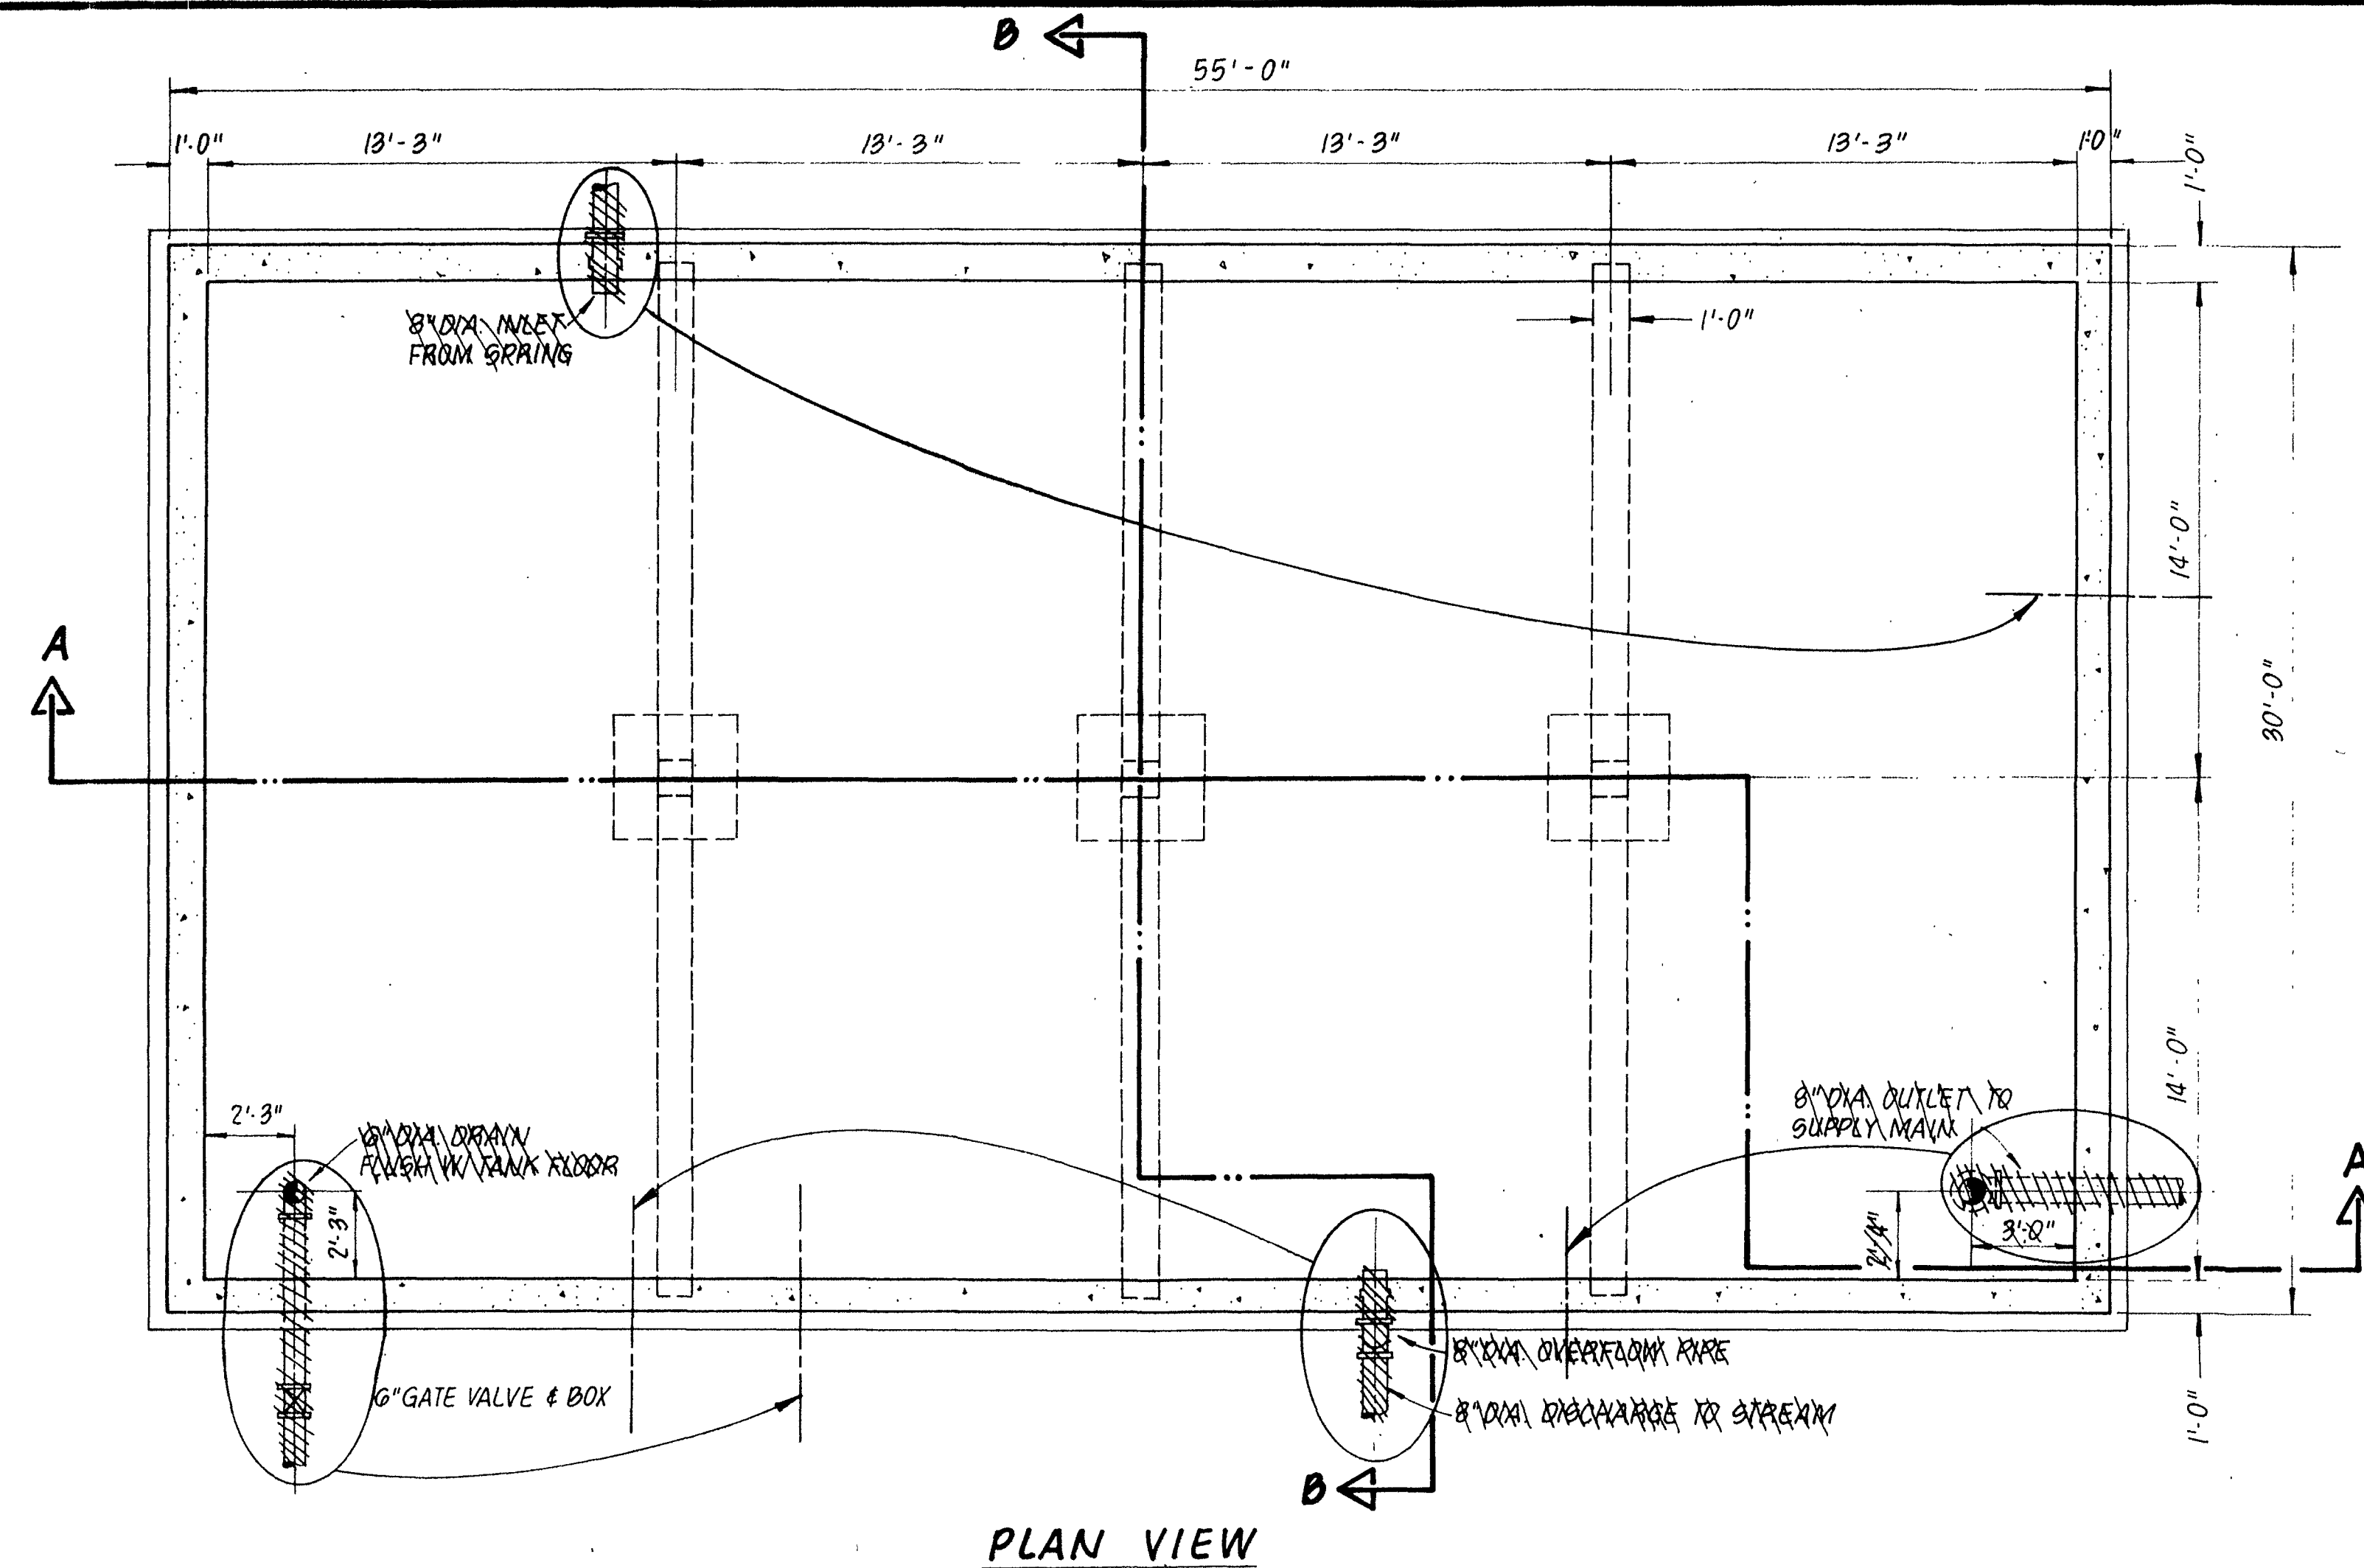


NOTE:

REFERENCE IS MADE TO PLAN OF TANK AND DETAILS PREPARED BY THOMPSON AND PAYNE, ARCHITECTS AND ENGINEERS, ROANOKE, VIRGINIA FOR HUB WATER COMPANY DATED 8-5-65.


BY REQUEST OF OWNER, THIS PLAN FOR THE PROPOSED WATER TANK WAS REPRODUCED FROM MENTIONED REFERENCE PLANS. PROPOSED WATER TANK DESIGN TO MATCH EXISTING TANK DESIGN.

6" CONC. SLAB WITH #4 @ 6" O.C. REINF.
(BEND ALT. BARS AS SHOWN)
#3 BARS @ 8" O.C. TEMP.

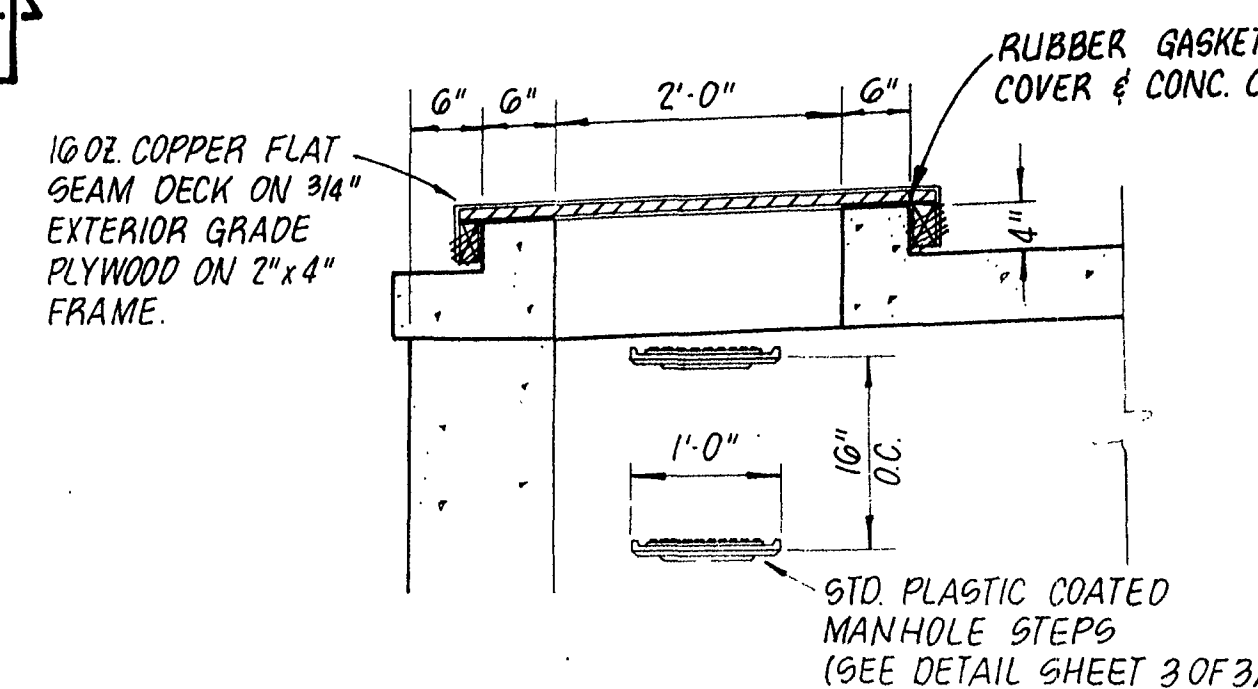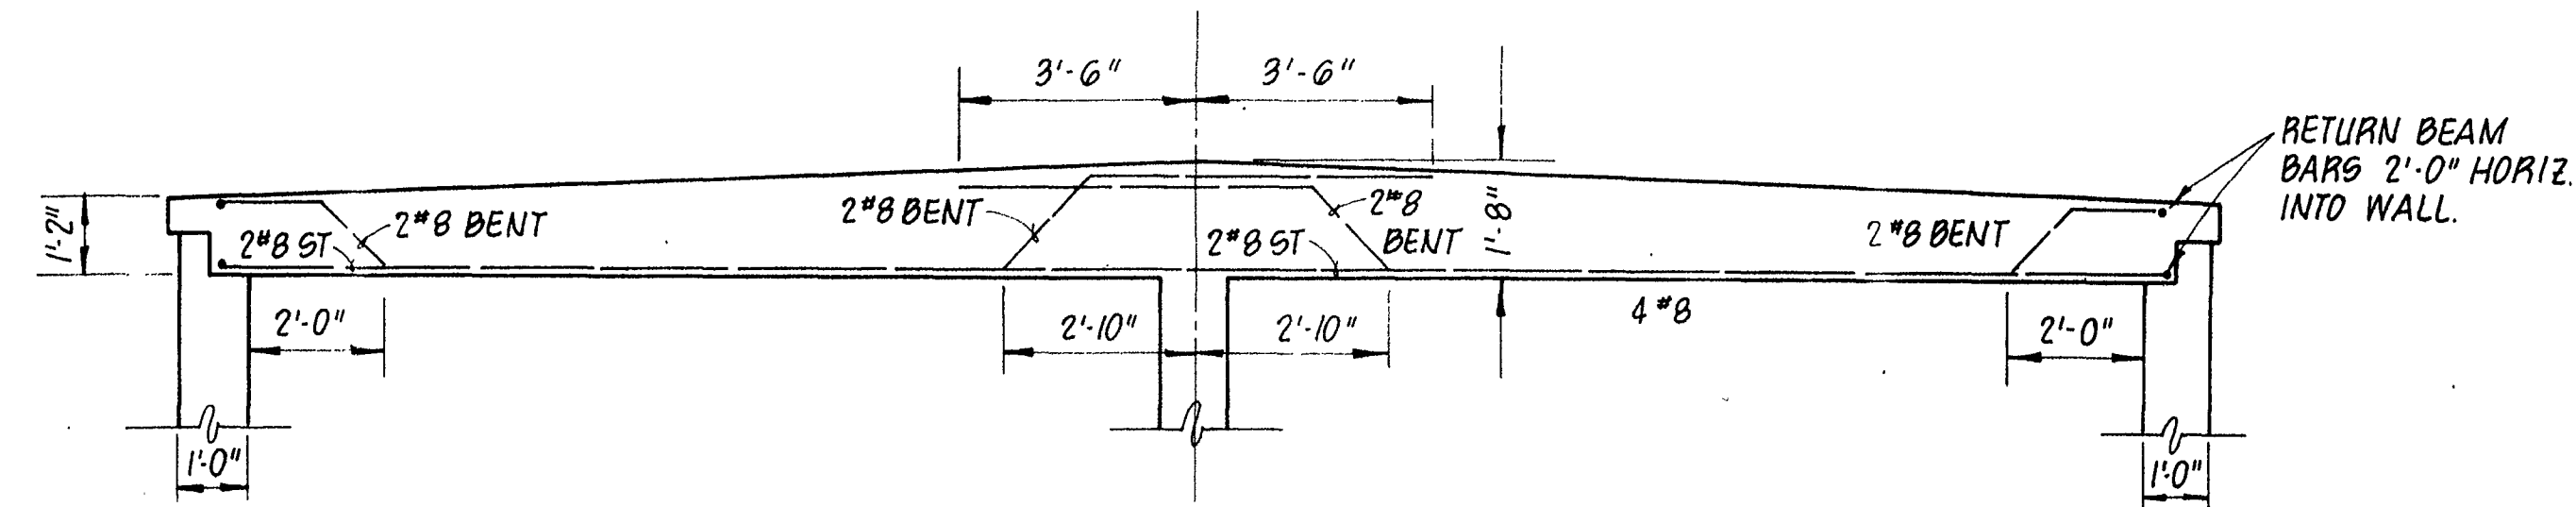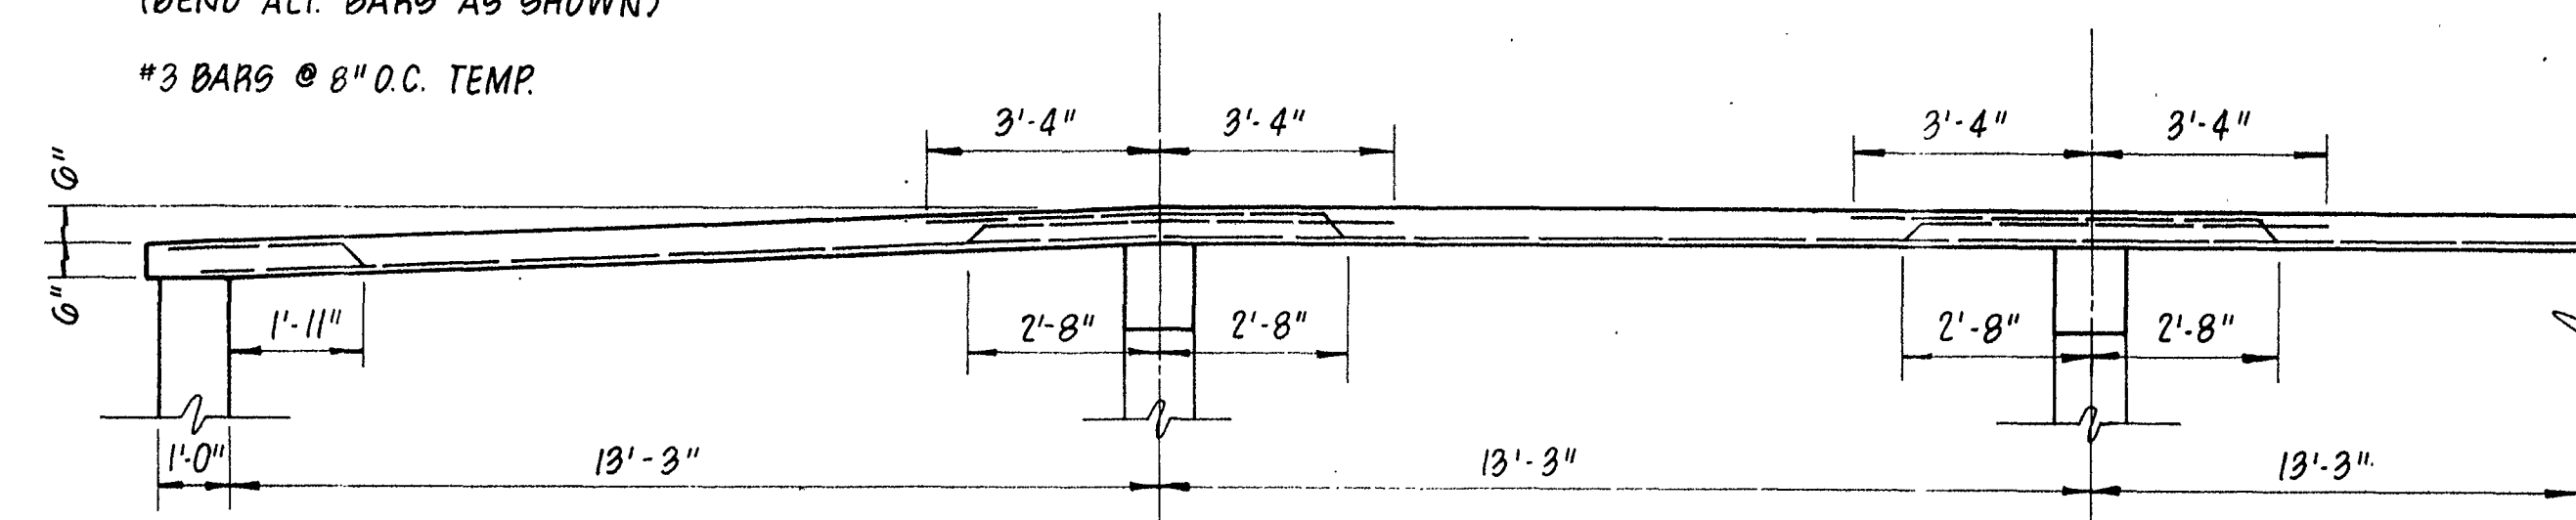

NOTES

ALL CONCRETE SHALL BE 3000 PSI
ALL REINF. BARS SHALL BE ASTM A15 OR A16 AND DEFORMATIONS SHALL BE A 305.
PLAIN WELDED WIRE FABRIC IS REQ'D.

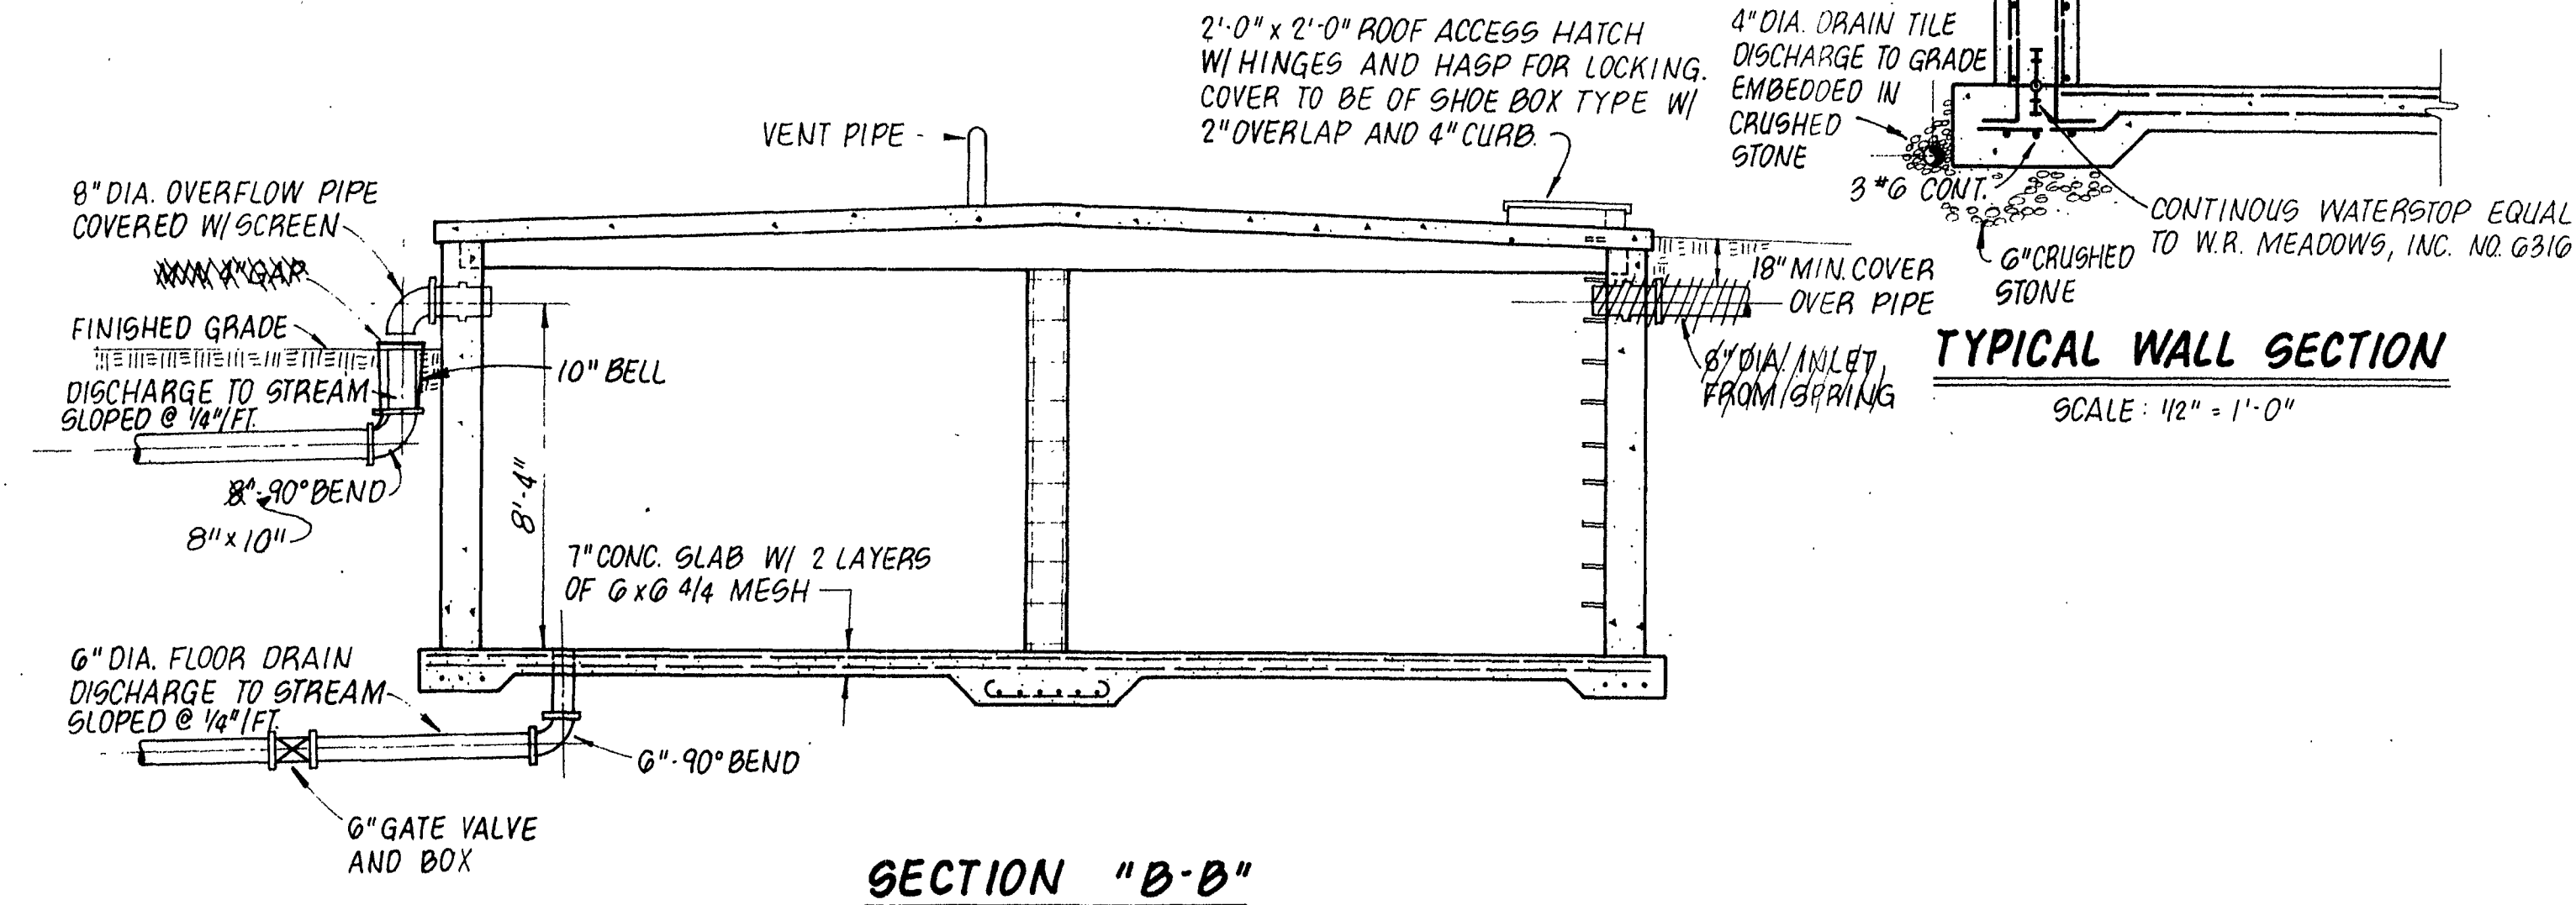

"AS - BUILT"

Designed: DJR
Drafted: CFA
Checked: DJR
Approved: DJR

Clean Water Engineers, Inc.
Fincastle, Virginia

PROPOSED WATER TANK
TINKERVIEW WATER COMPANY
BOTETOURT COUNTY, VIRGINIA

Sheet: 2 of 3
Scale: AS SHOWN
Date: APRIL, 1985
Project: 8502