
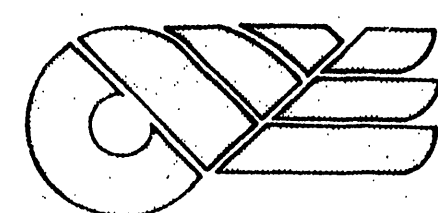


- NOTES:
- CONTRACTOR SHALL BE RESPONSIBLE FOR LOCATING AND VERIFYING ALL EXISTING UTILITIES AND CONDITIONS.
 - 4" TIE TO EXISTING DOMESTIC WATERLINE SHALL BE MADE OUTSIDE NURSING HOME BUILDING, IN STRICT COORDINATION WITH PLUMBING SUBCONTRACTOR. APPROVED RP2 BACKFLOW PREVENTER SHALL BE PROVIDED ON THE DOMESTIC SUPPLY LINE IN THE NURSING HOME (BY OTHERS).

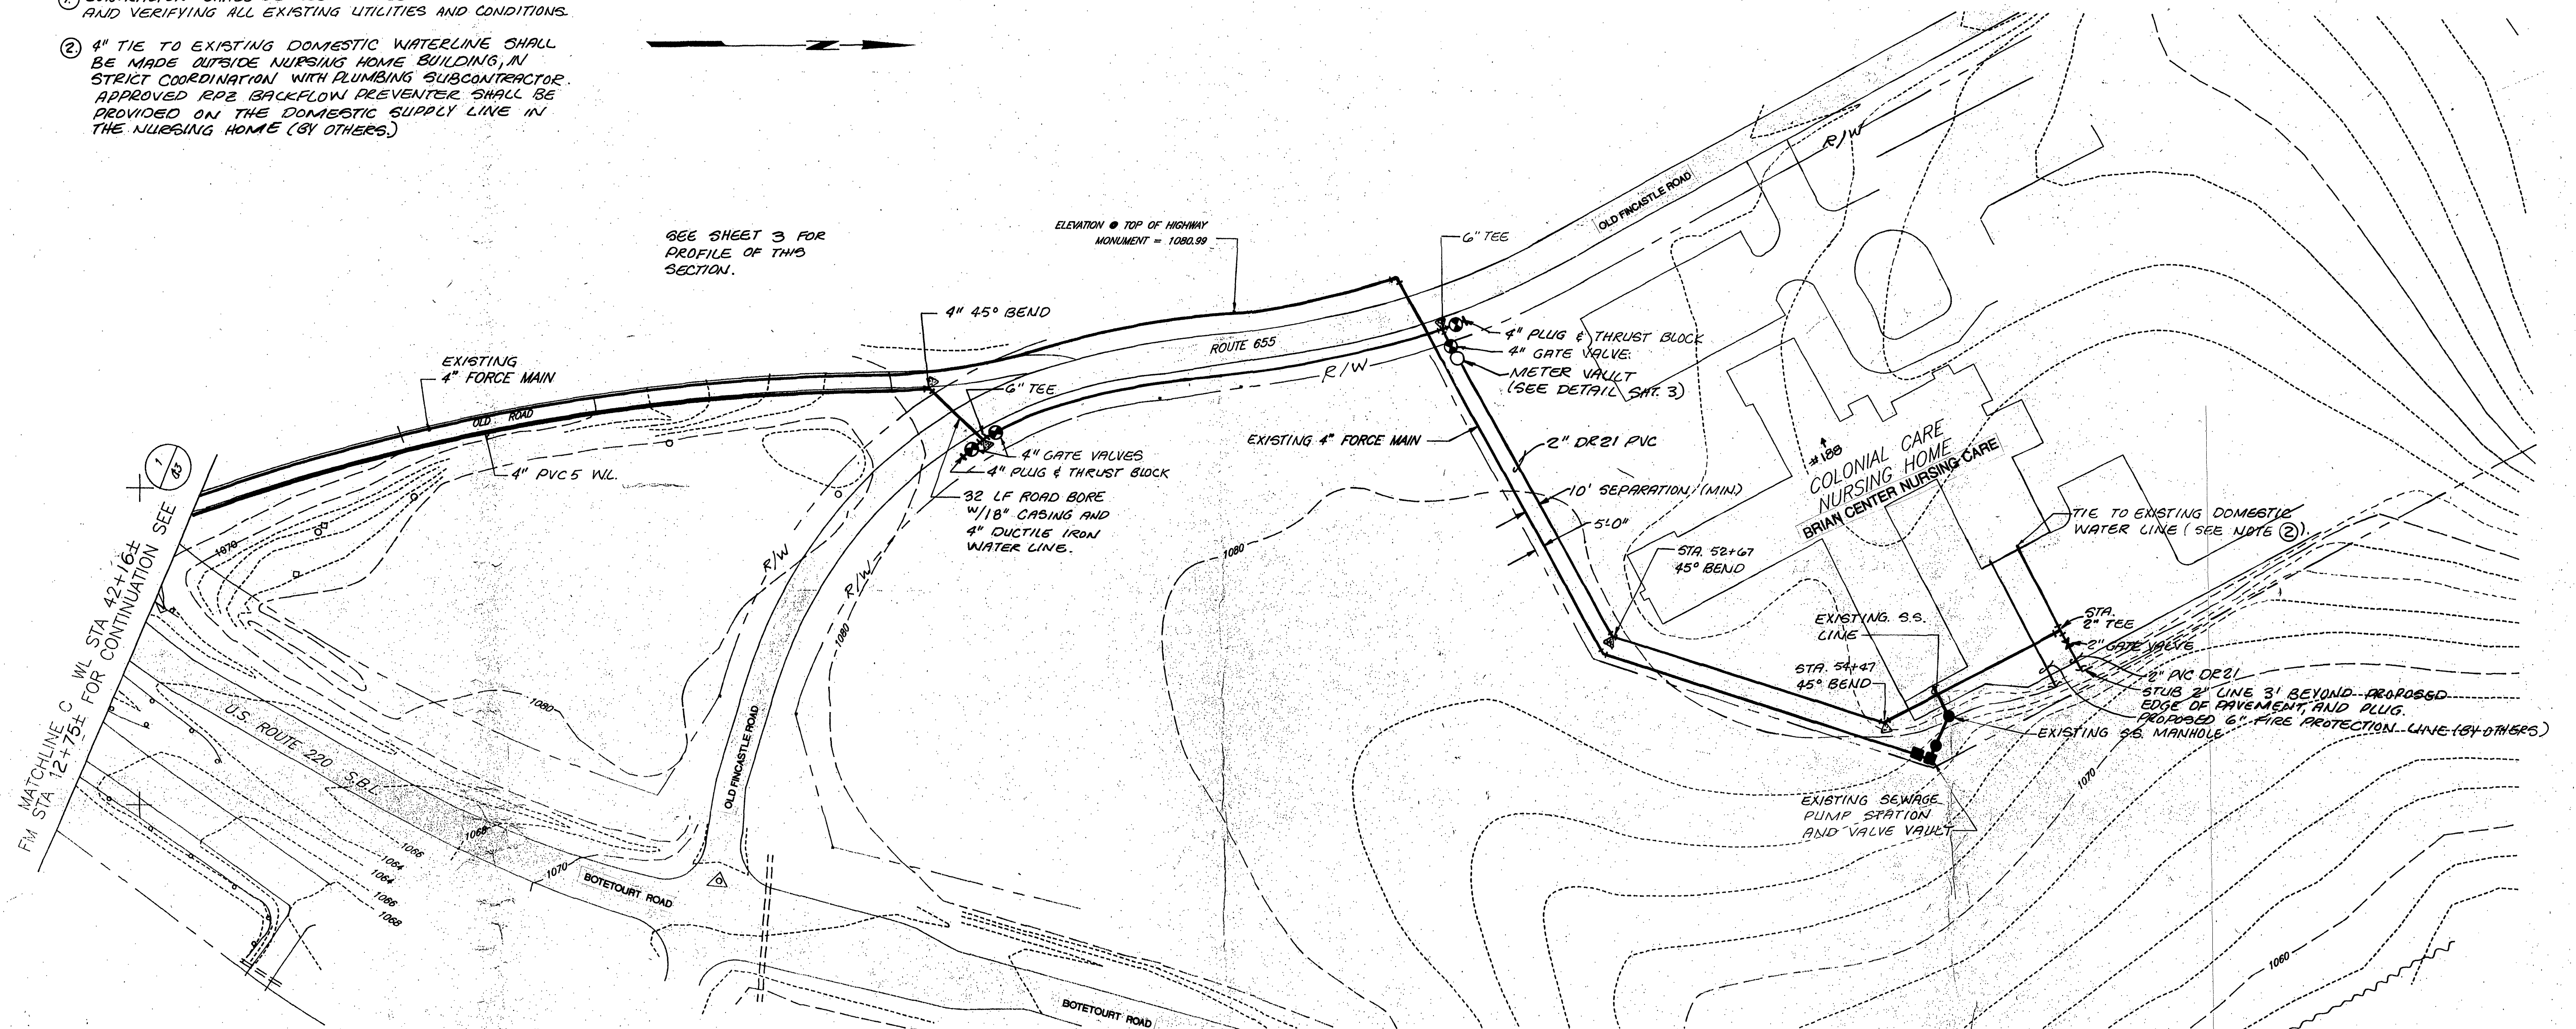


CLEAN WATER ENGINEERS, INC.

P.O. BOX 218
FINCASTLE, VIRGINIA 24090

ROUTE 1, BOX 78
HARRISONBURG, VIRGINIA 22801

COLONIAL CARE OF FINCASTLE
LIMITED PARTNERSHIP
BOTETOURT COUNTY VIRGINIA

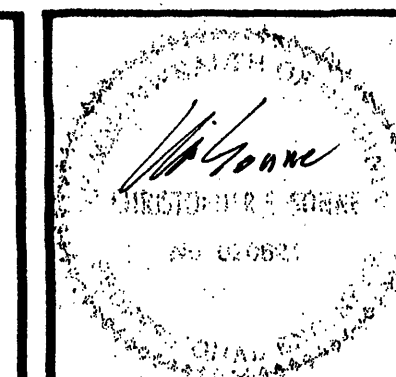

REVISIONS		
NO.	DATE	BY
1	4.5.90	TAP
2	4.25.90	TAP

DESIGNED: CES	SHEET: 2
DRAWN: LHJ	SCALE: 1"=50'
CHECKED: CES	DATE: MAY 1989
APPROVED: CES	PROJECT: 88114

WWW.ID#8UBFYD