

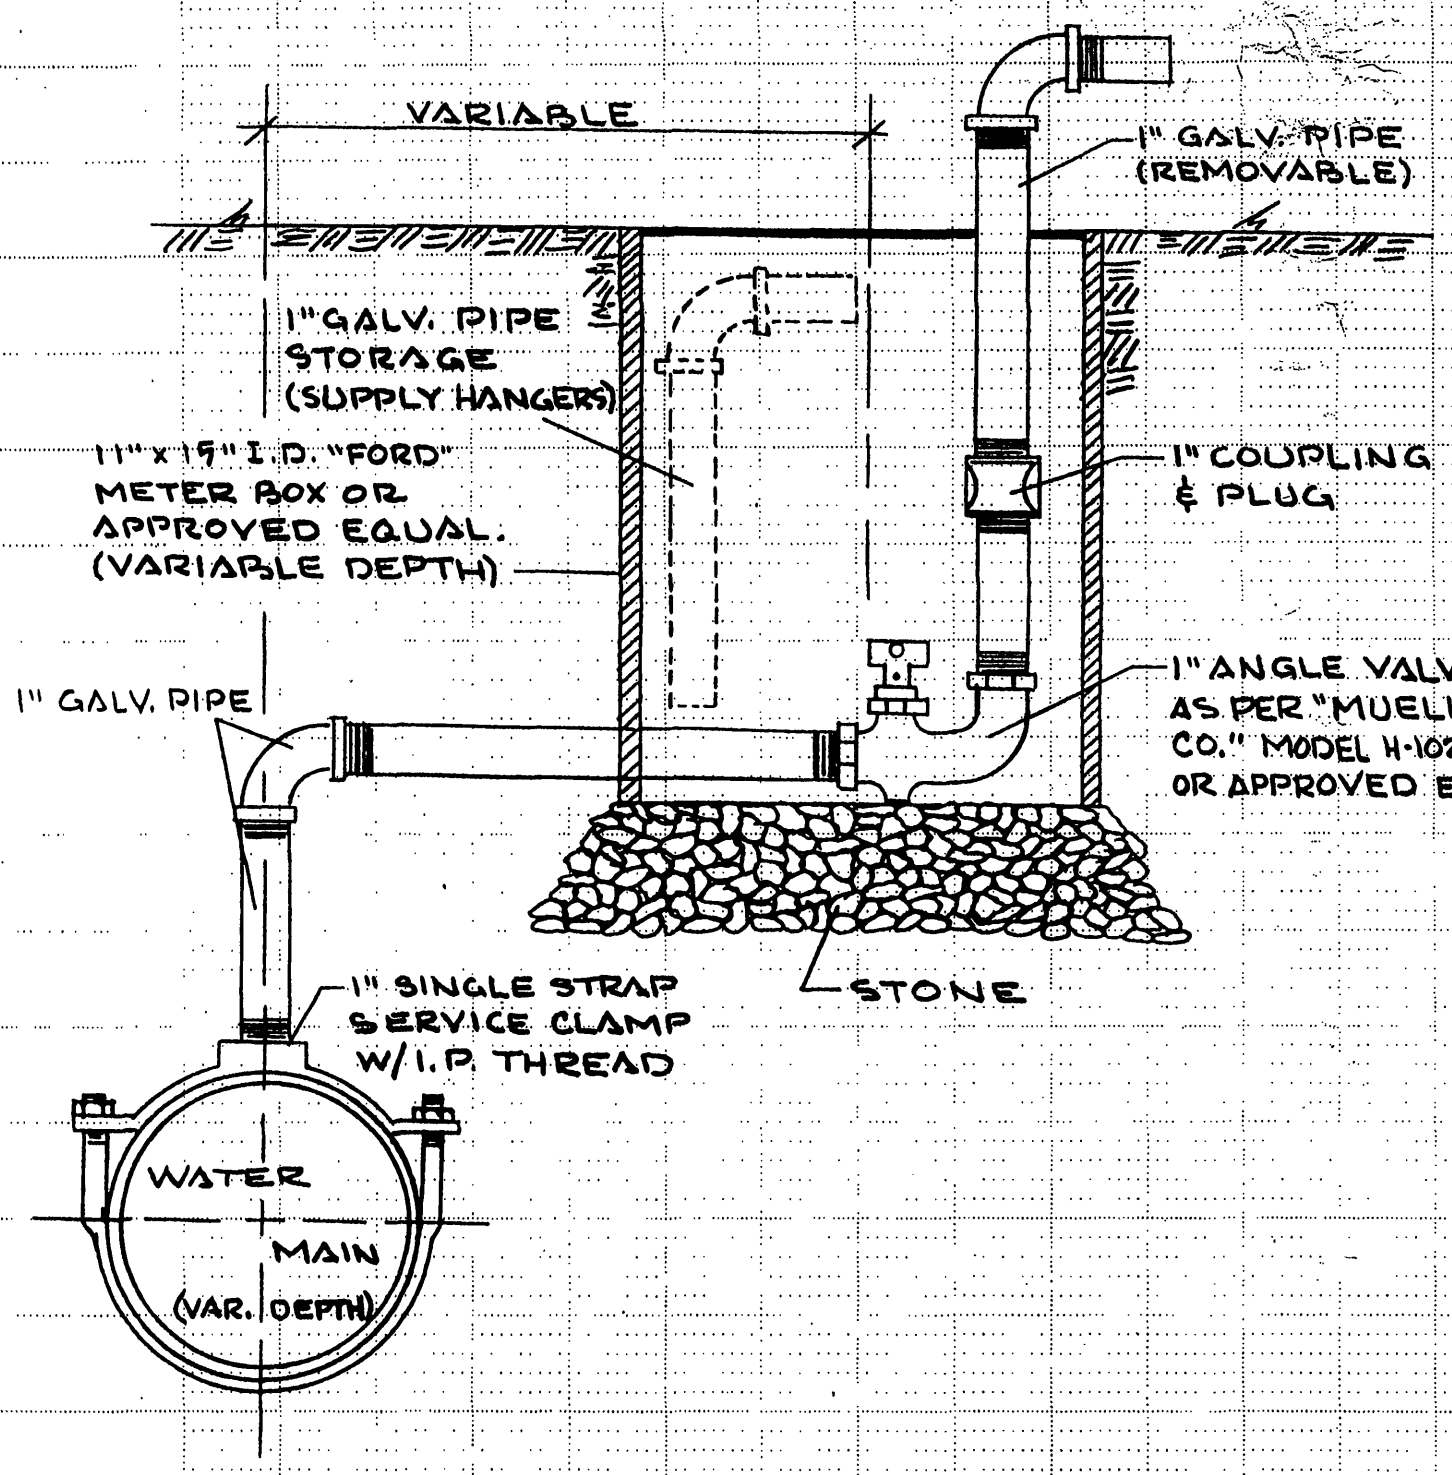


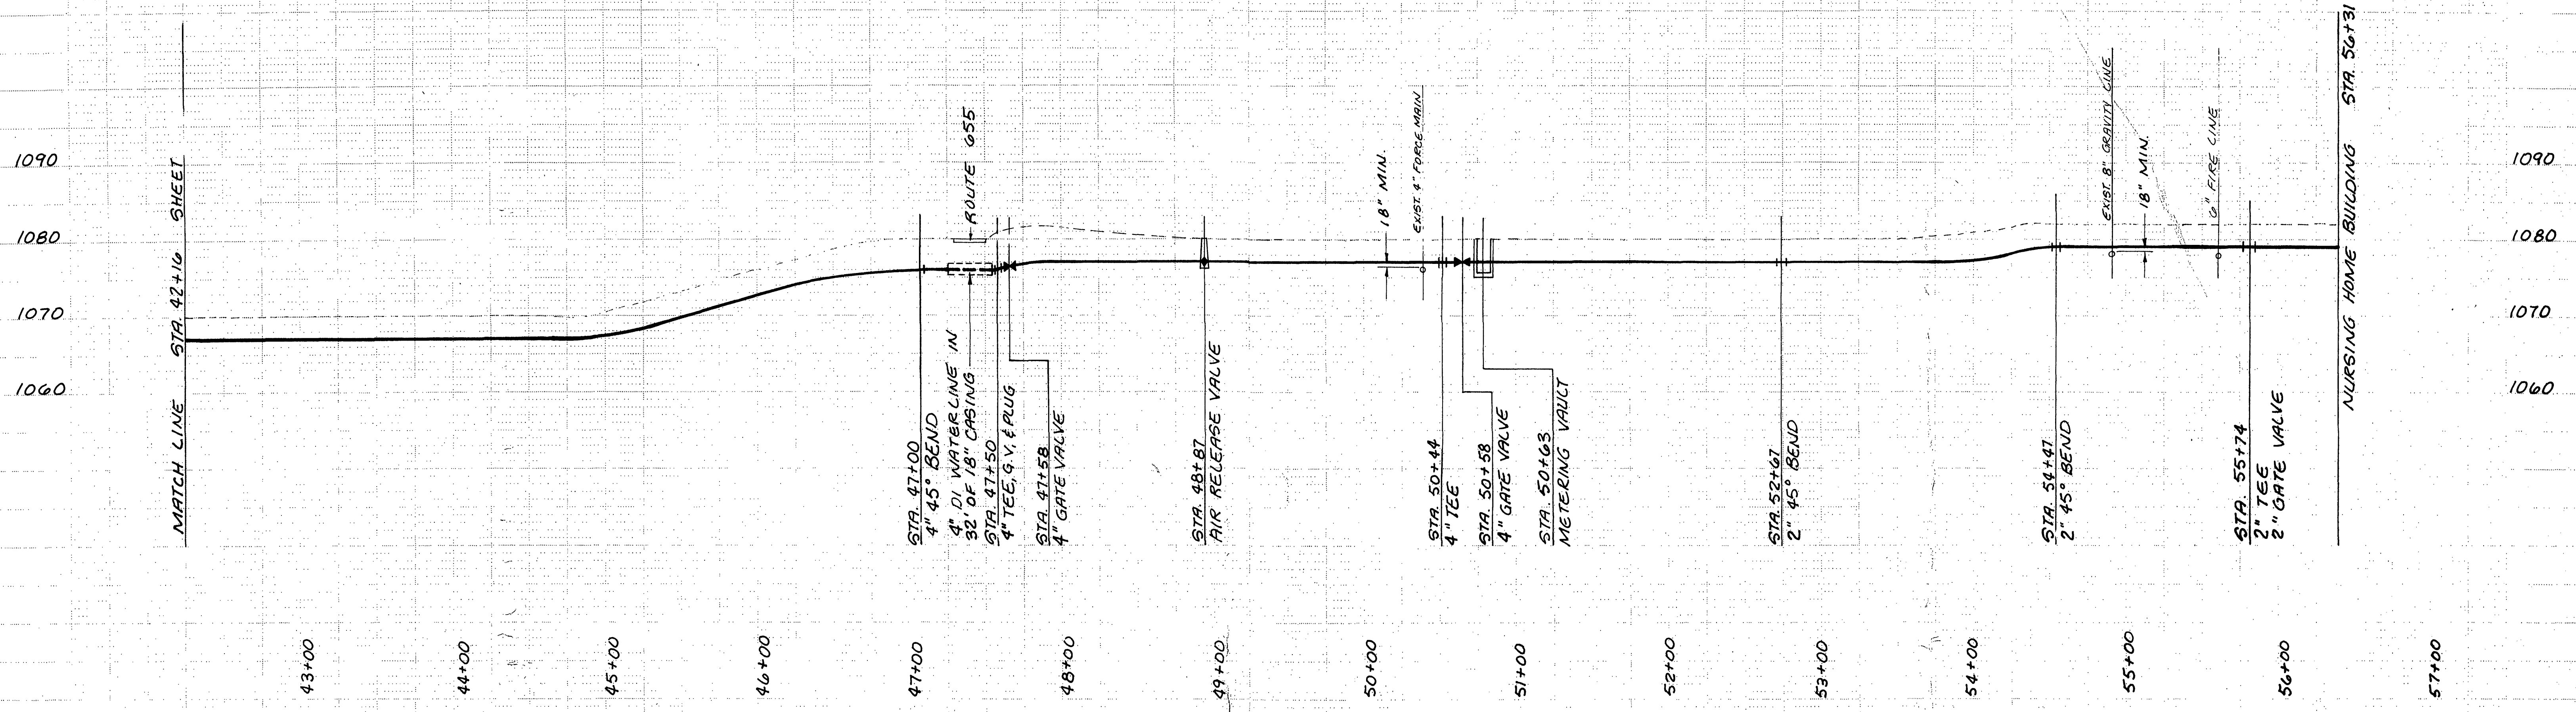


TYPICAL SAMPLE
TAP
NTS

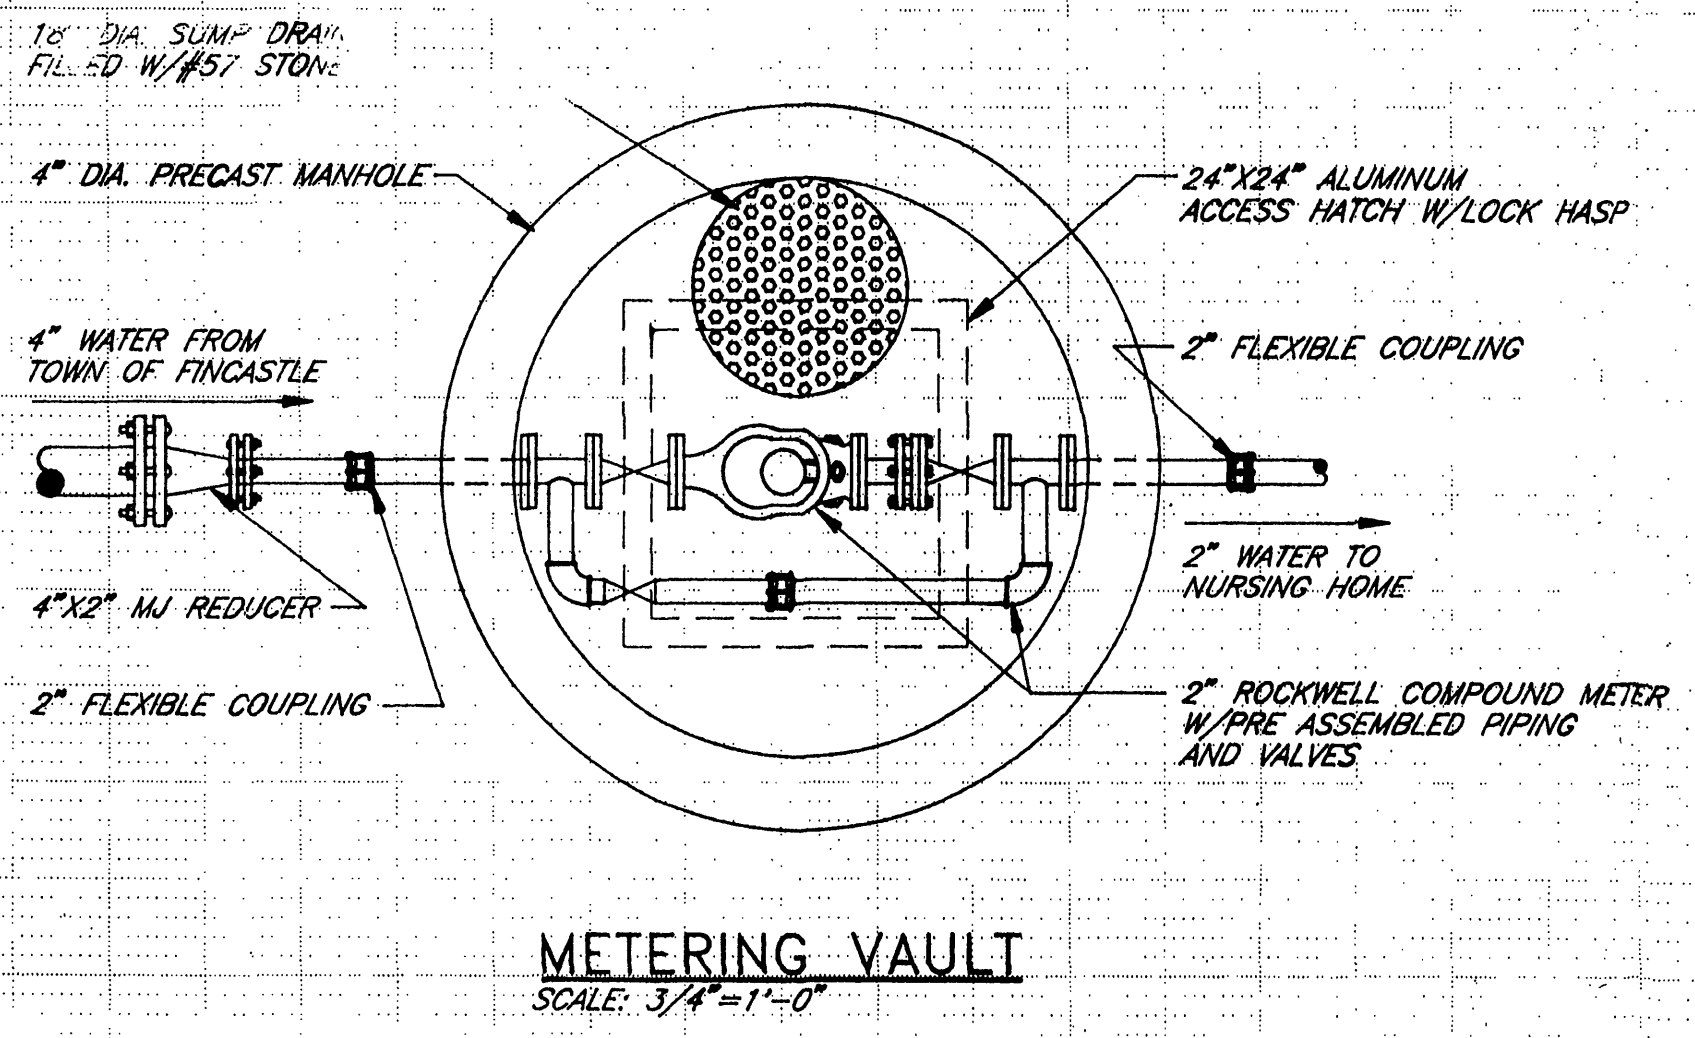


METERING VAULT
SCALE: 3/4\"/>

842' - 4" PVC5 WL , 573' - 2" PVC5 WL
THIS SHT THIS SHEET

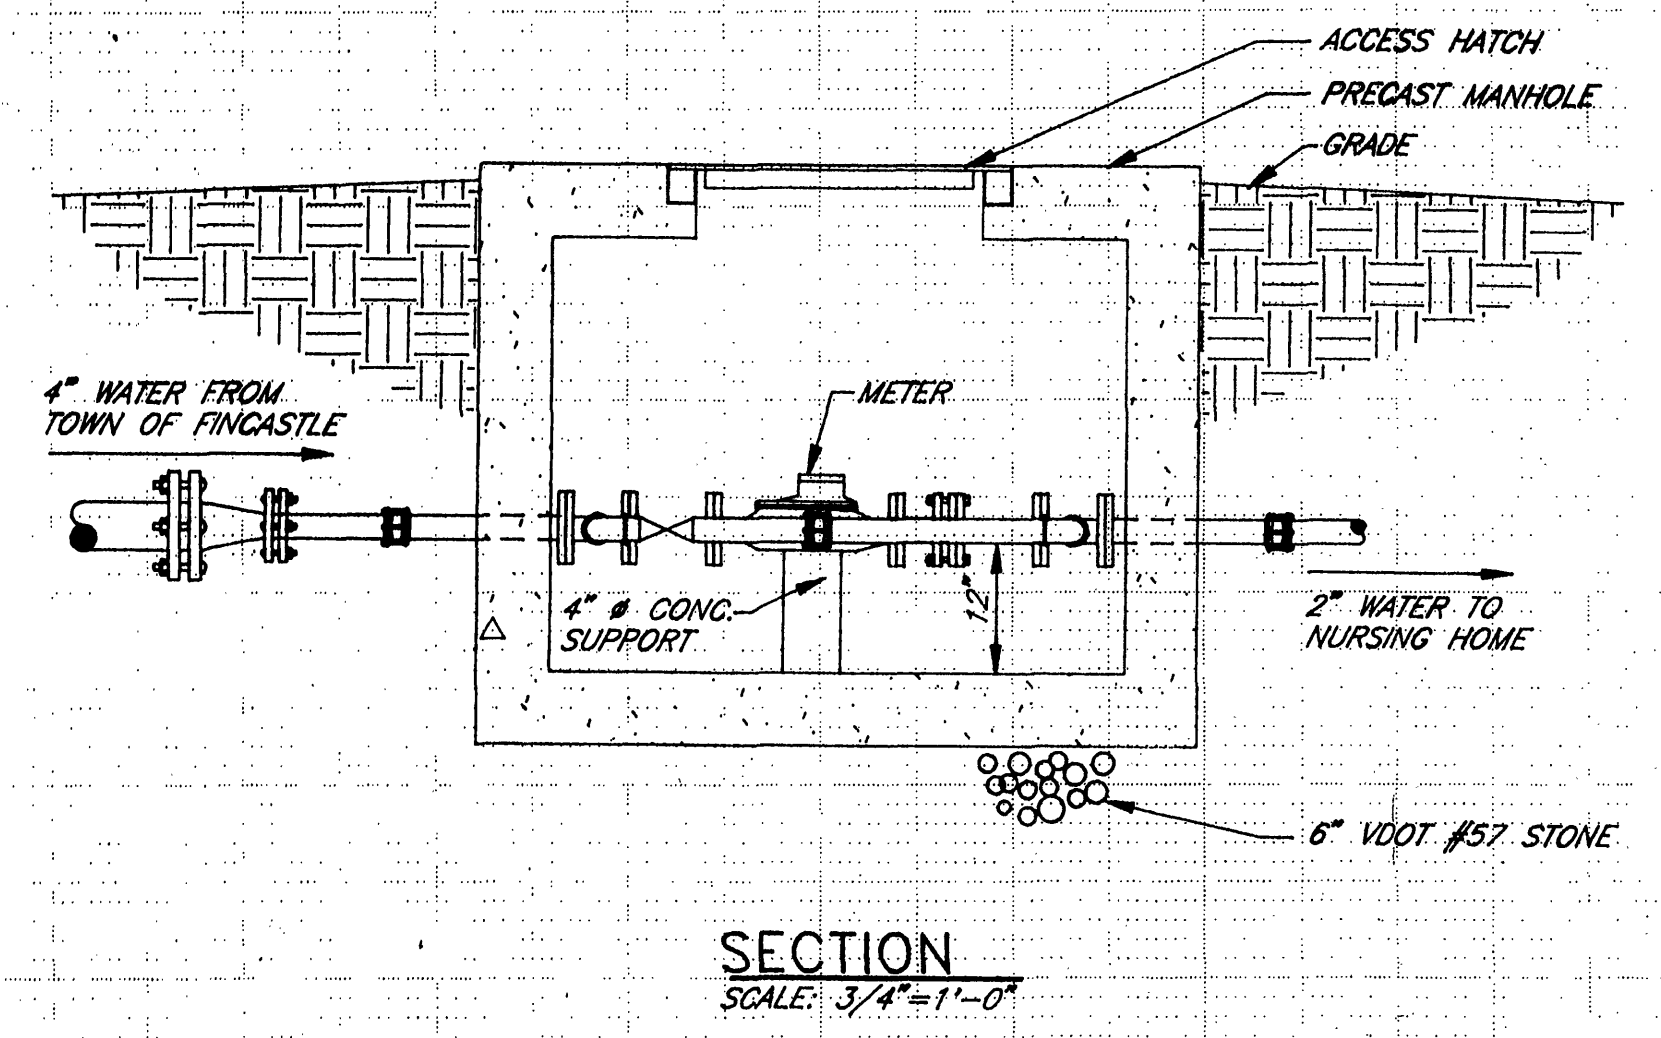

SECTION
SCALE: 3/4\"/>

- NOTES:
- ① DRAIN LINE FROM BILCO HATCH SHALL BE RUN TO SUMP PIT.
 - ② 2" COMPOUND METER AND BRONZED PIPING ASS'Y. SHALL BE DIELECTRICALLY SEPARATED FROM CAST IRON AND STEEL FLANGES AND PIPE SUPPORTS BY RUBBER GASKETS OR OTHER APPROVED METHODS.

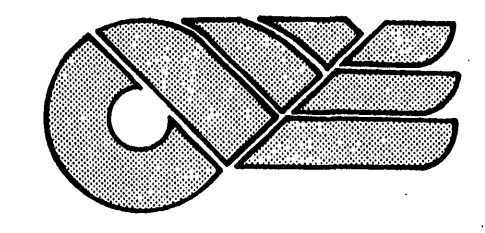

CLEAN WATER ENGINEERS, INC.

P.O. BOX 218
FINCASTLE, VIRGINIA 24090

P.O. BOX 3225
STAUNTON VIRGINIA, 24401

COLONIAL CARE OF FINCASTLE
LIMITED PARTNERSHIP
BOTETOURT COUNTY VIRGINIA

Signature

REVISIONS			DESIGNED:	SHEET:
NO.	DATE	BY	CES	3
1	4-5-90	TAP	DRAWN:	SCALE:
2	4-25-90	TAP	TAP	H: 1"= 50', V: 1"= 10'
			CHECKED:	DATE:
			CES	MARCH, 1990
			APPROVED:	PROJECT:
			CES	88114