
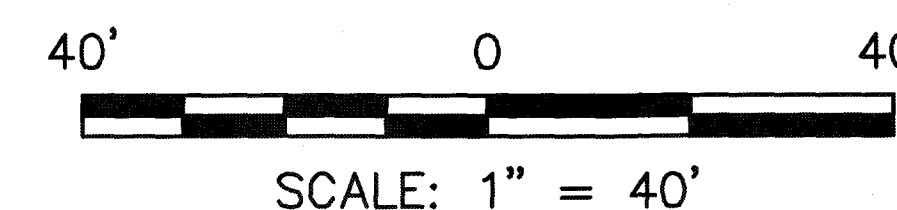
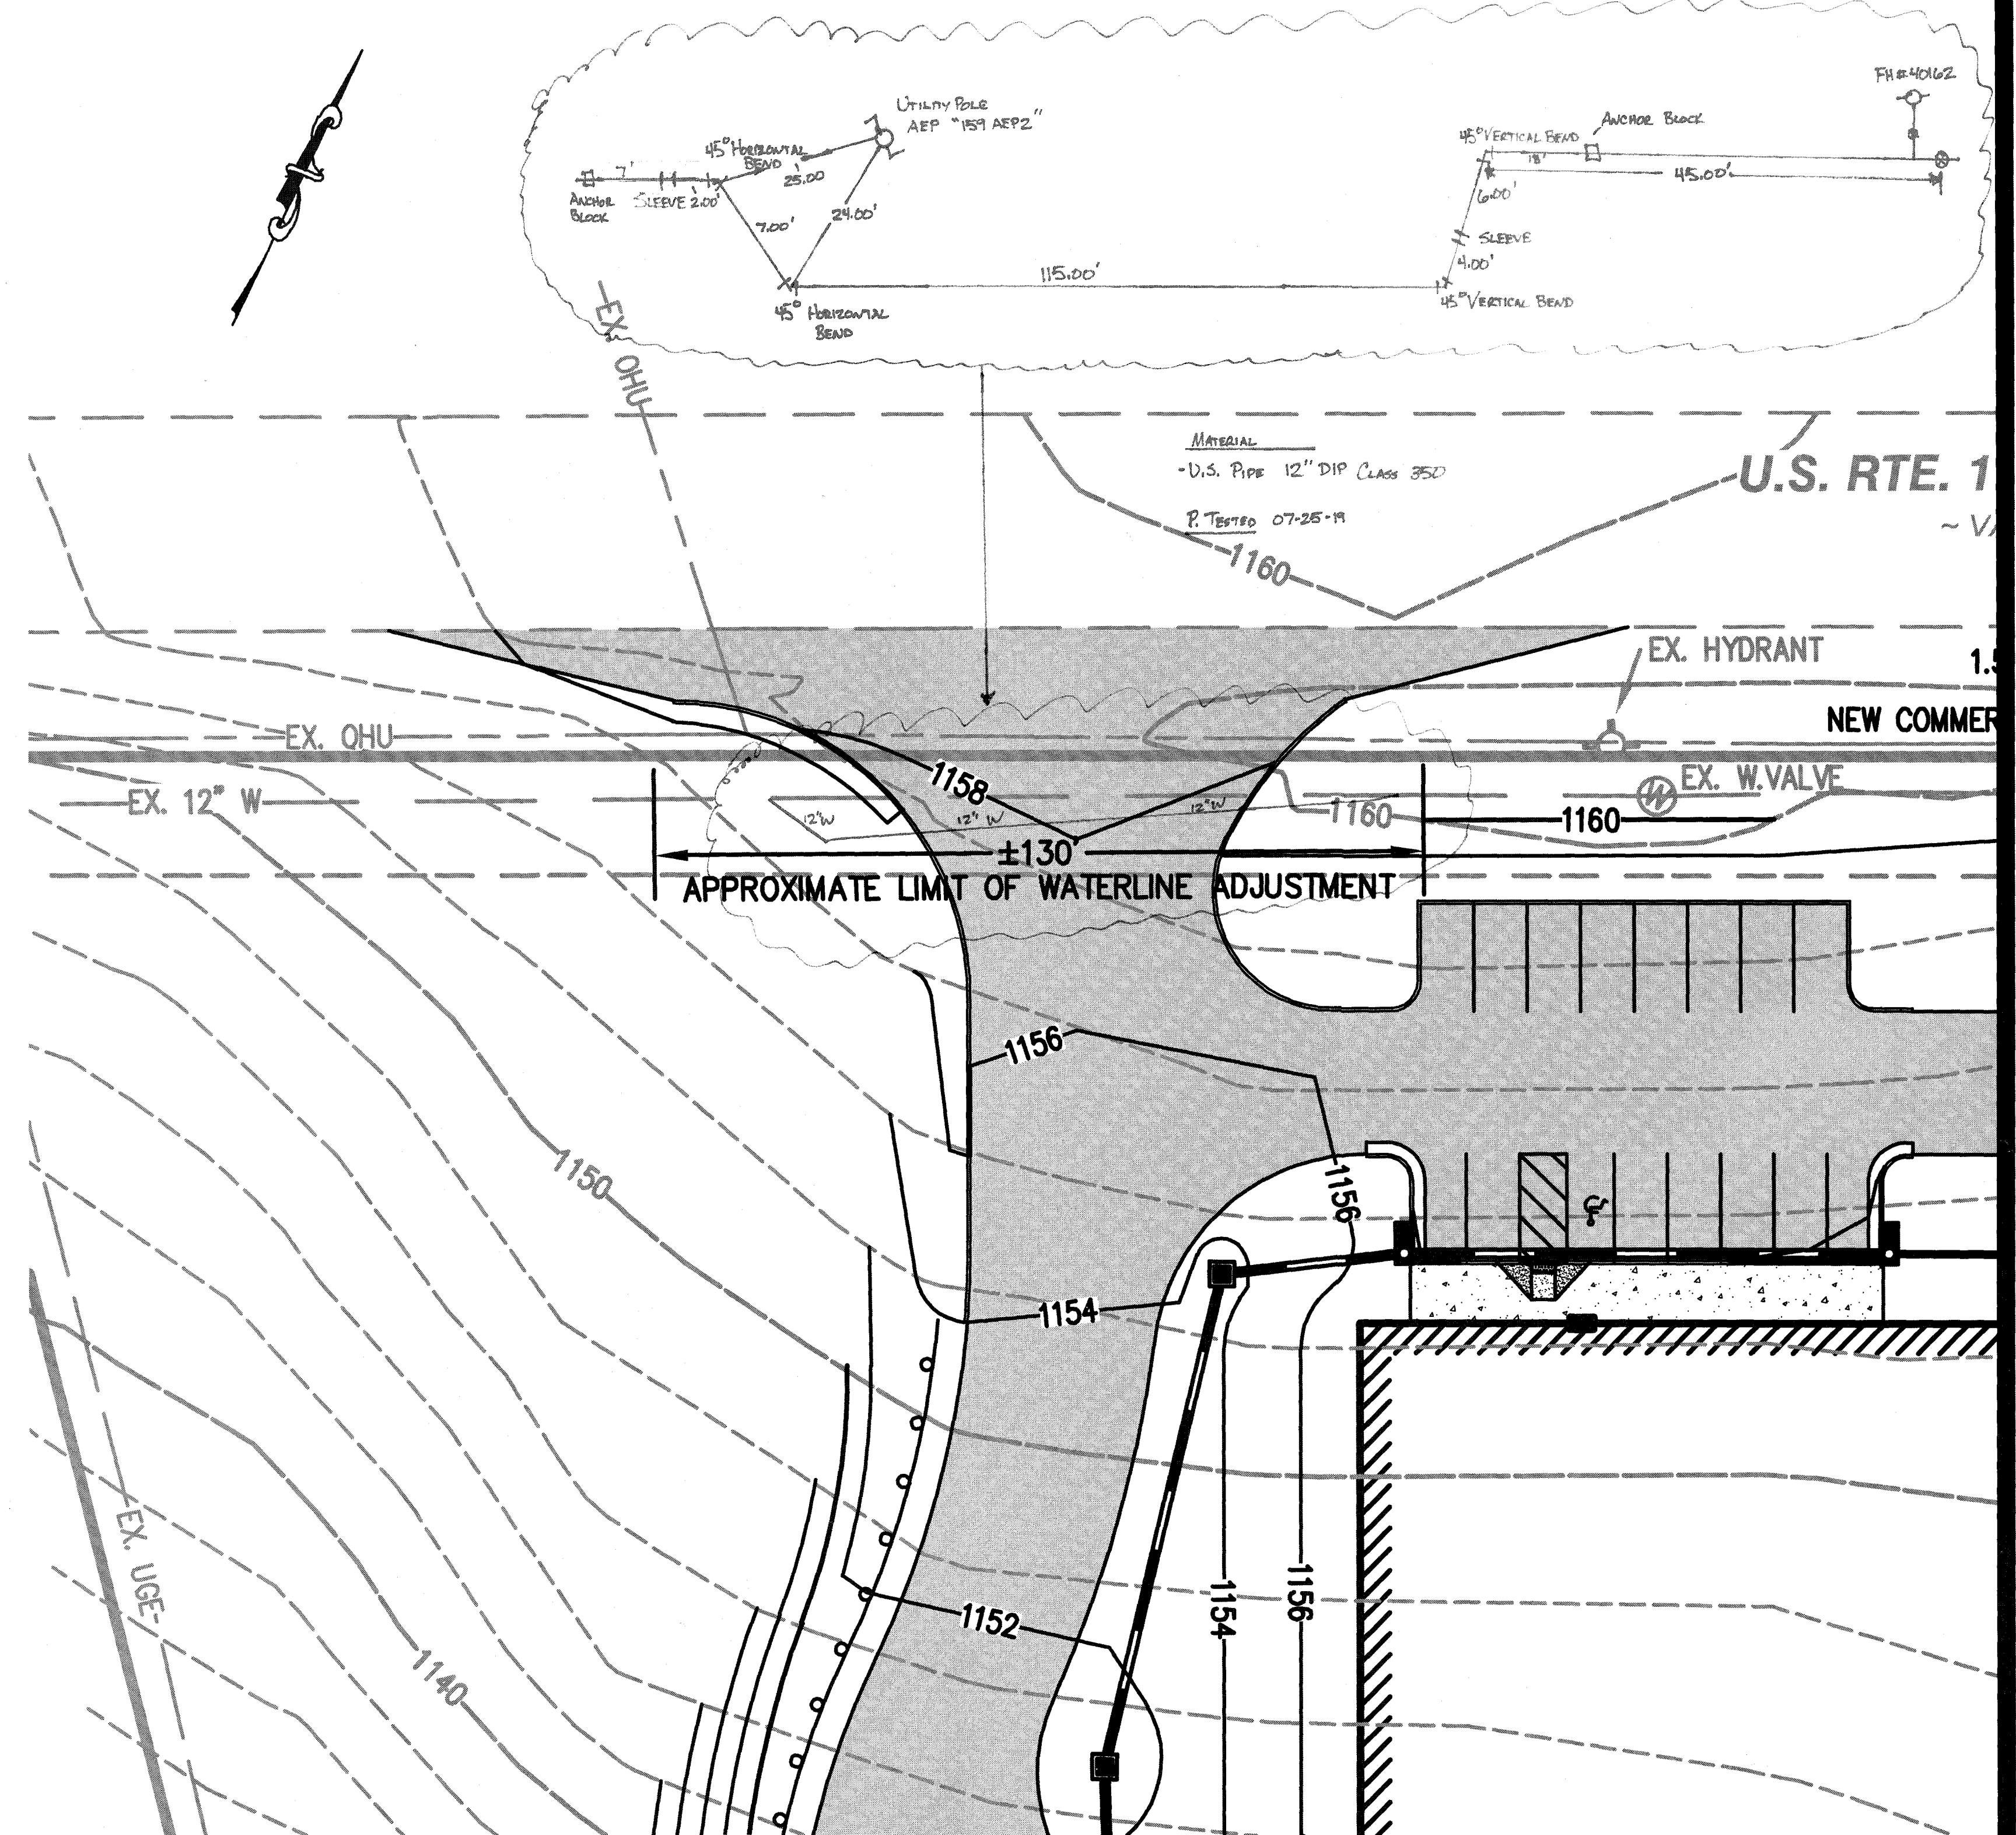



SCHEMATIC WATER LINE ADJUSTMENT PROFILE

NOTE: WATERLINE ADJUSTMENT DEPTH TO BE DETERMINED IN THE FIELD TO MAINTAIN A MINIMUM COVER OF 3 FEET OVER THE WATERLINE. COORDINATE ALL WORK WITH THE WESTERN VIRGINIA WATER AUTHORITY.

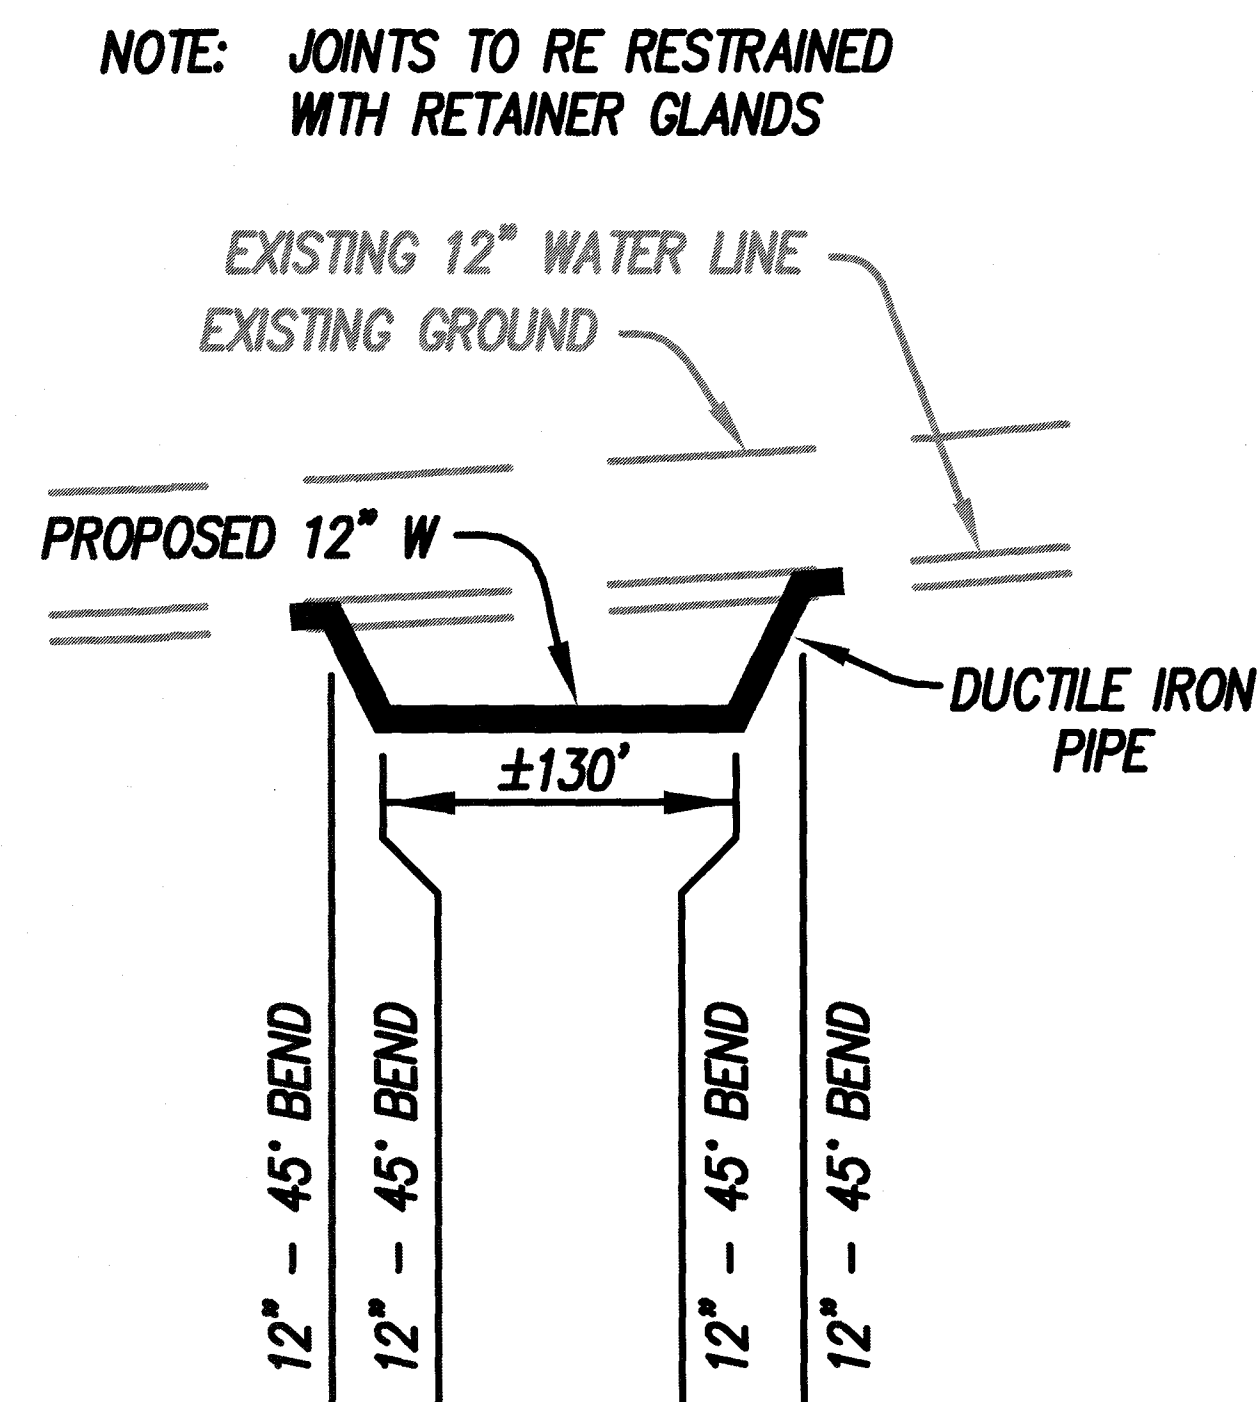

EXISTING 12" WATERLINE DEPTH ADJUSTMENT

LARE, Inc.

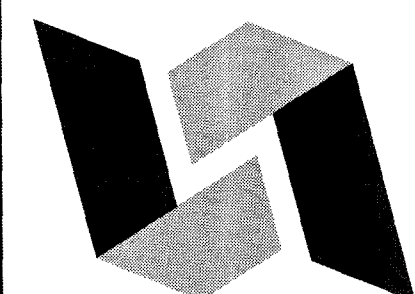

Lumsden Associates, P.C.
ENGINEERS | SURVEYORS | PLANNERS

4664 BRAMBLETON AVENUE
P.O. BOX 20669
ROANOKE, VIRGINIA 24018

PHONE: (540) 774-4411
FAX: (540) 772-9445
WWW.LUMSDENPC.COM

DATE:	May 7, 2019
COMM. NO.:	18-125
SCALE:	1" = 40'