




FOR RESIDENTIAL CONNECTIONS, LATERAL PIPES SHALL BE 4" DIA. PVC-SDR35 OR SCH. 40. FOR COMMERCIAL CONNECTIONS, THE LATERAL SIZE SHALL BE SPECIFIED ON THE PLANS BY THE ENGINEER.

TYPICAL SERVICE CONNECTION WITH CLEANOUT

NOT TO SCALE SEWER-007

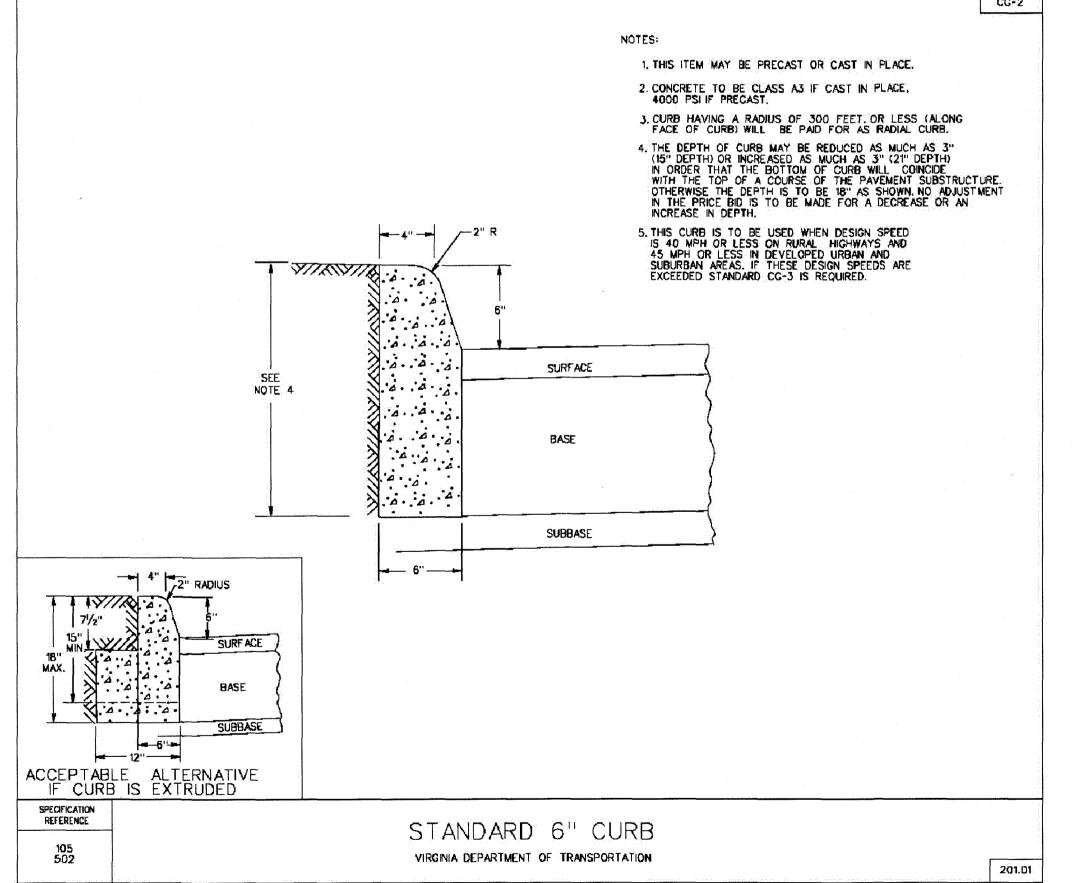

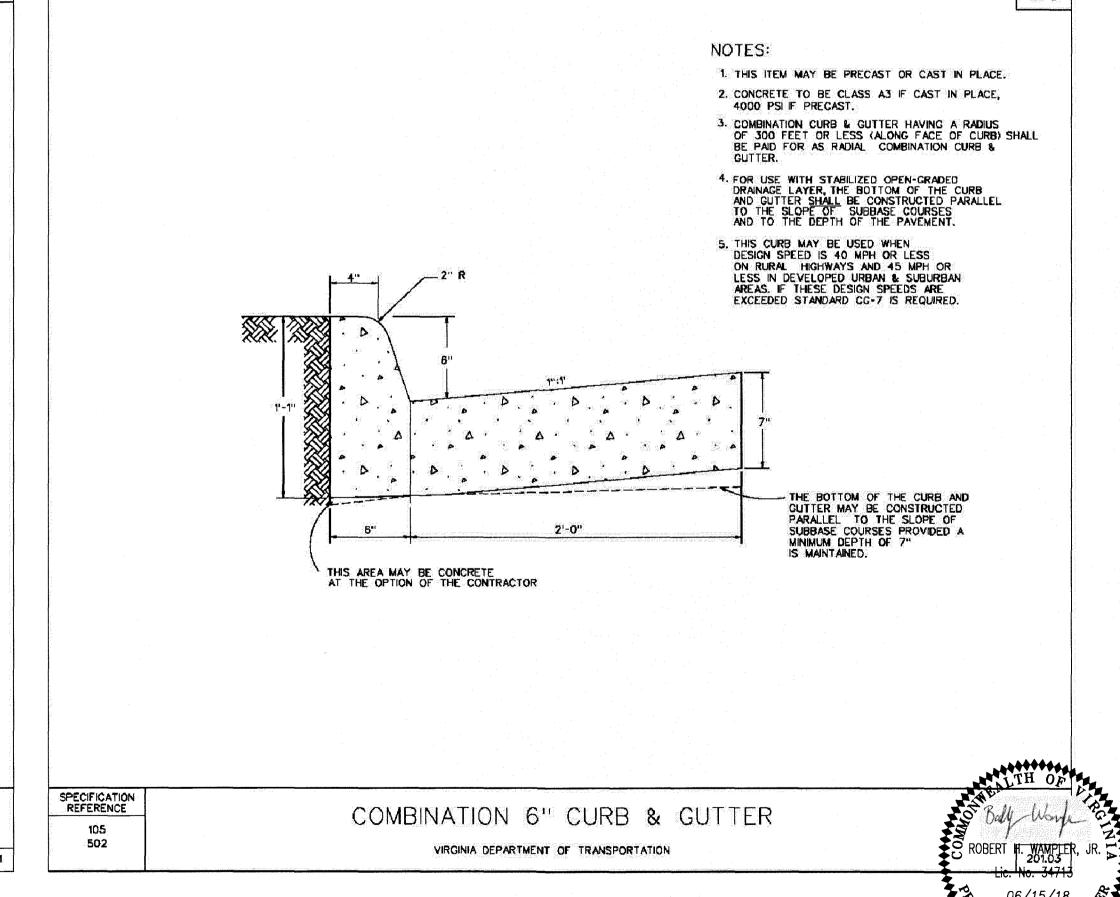

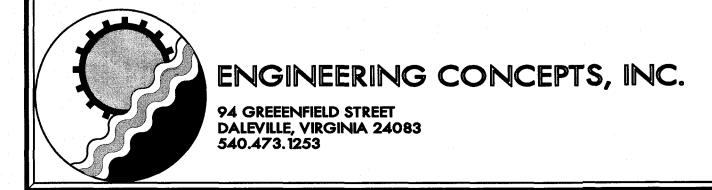

| | | · · · |
|-----------------|---------------------------------|---------------------|
| Drawn ACF | SITE DETAILS | NOT TO SCALE |
| Designed ECI | MEMBER ONE FEDERAL CREDIT UNION | DATE: JUNE 15, 2018 |
| Checked | DALEVILLE TOWN CENTER | PROJECT: 17063 |
| Approved | BOUTETOURT COUNTY, VA | C11 |