



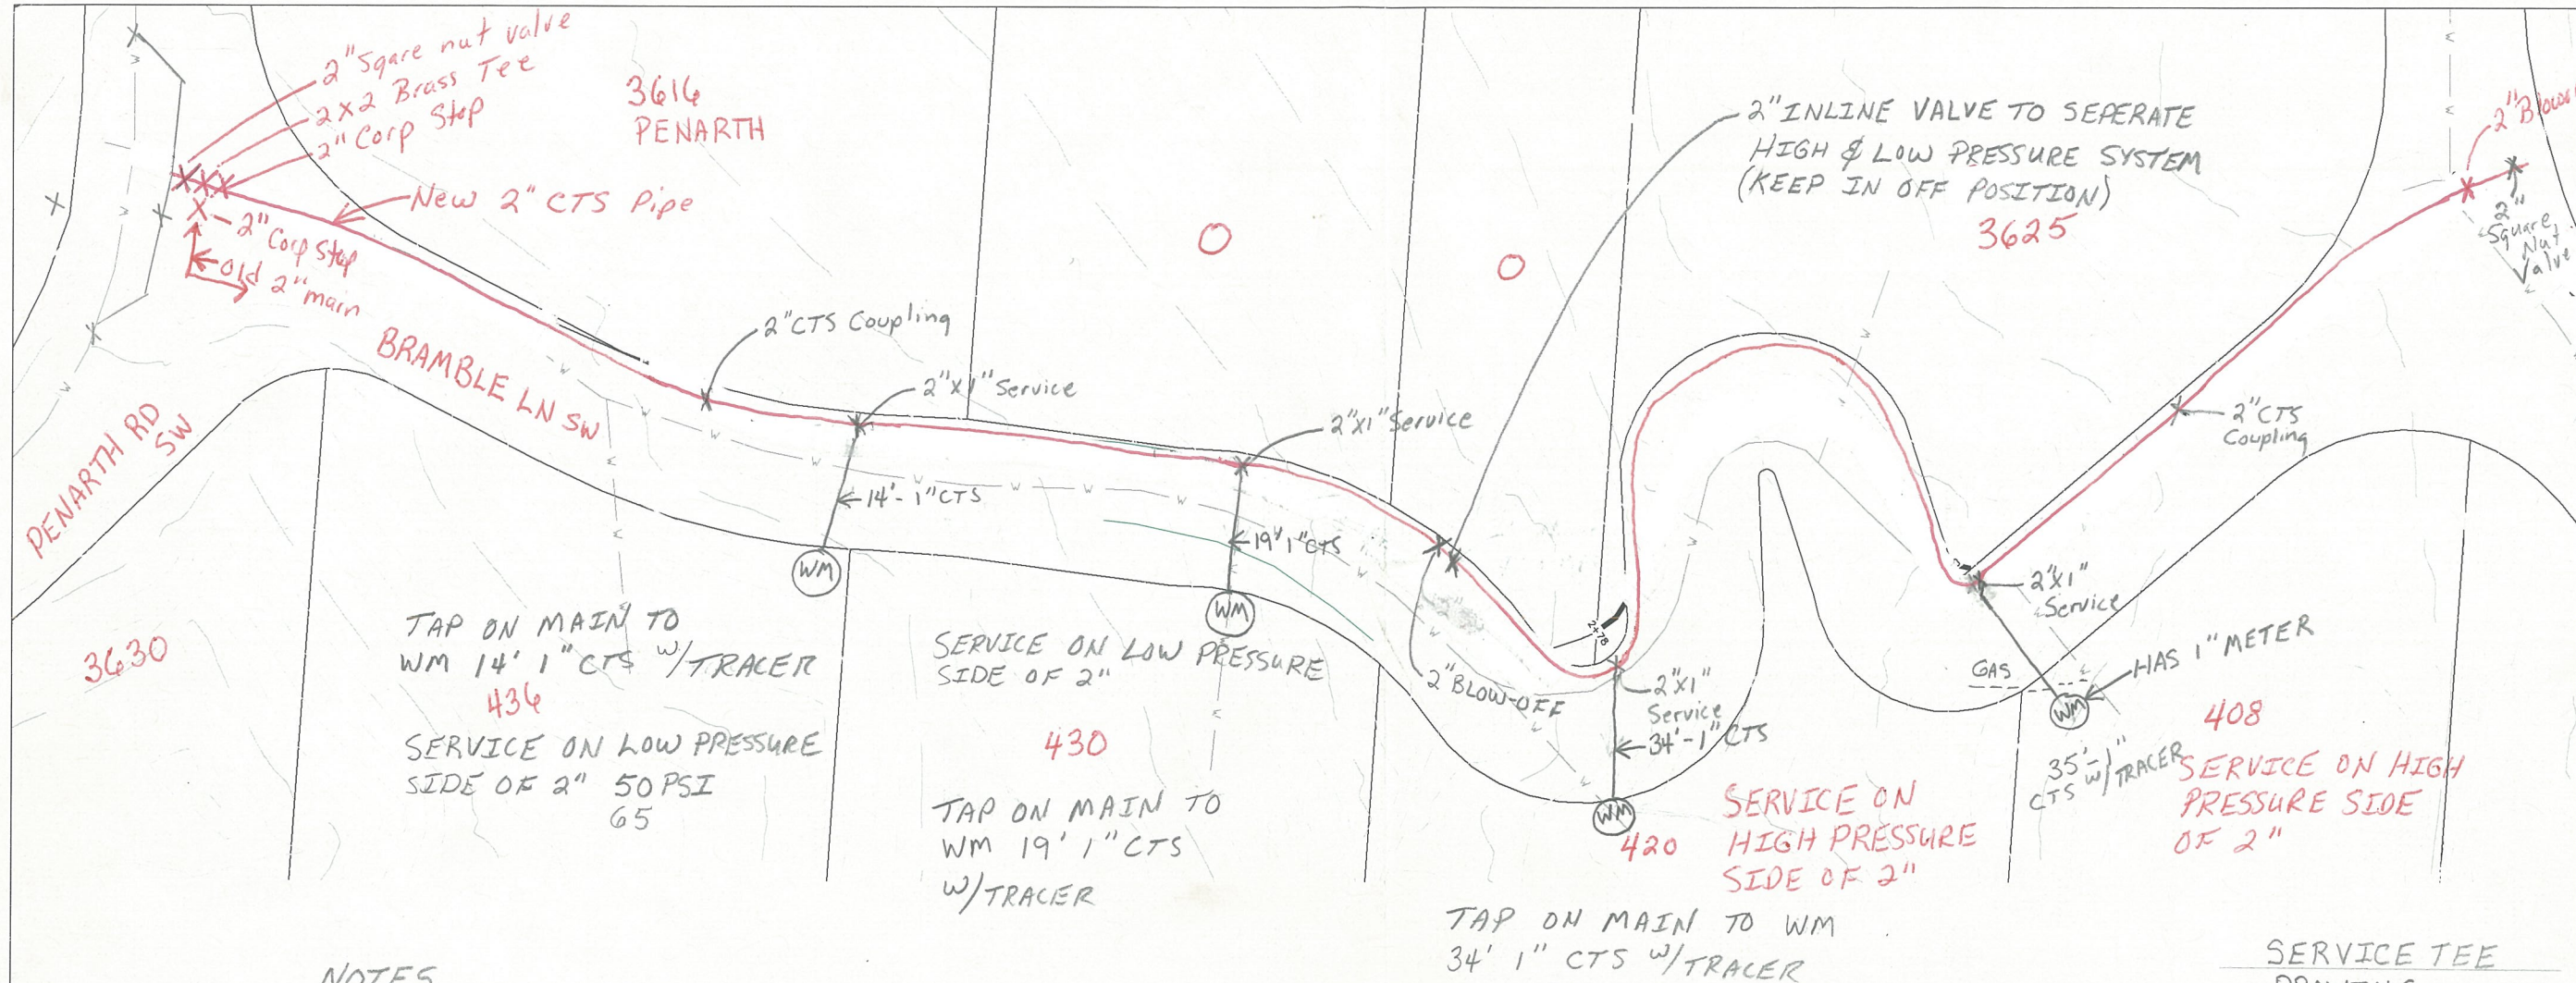


NOTES

NEW 2" CTS MAIN INSTALLED 10-6-16/10-13-16
 CIP1 Supt. BILLY THOMAS
 NEW MAIN INSTALLED 2' OFF EDGE OF ASPHALT
 FROM 2" VALVE AT PENARTH TO 1st COUPLING 130'
 436 SERVICE 170'
 430 SERVICE 233'
 2nd COUPLING 300'
 420 SERVICE 358'
 408 SERVICE 521'
 3rd COUPLING 582'
 TO 2" VALVE AT BRAMBLE & RIDGEWOOD 675'
 FROM FIRST TAP TO WM 14' LOW PRESSURE
 FROM SECOND TAP TO WM 19' LOW PRESSURE
 FROM THIRD TAP TO WM 34' (ON HIGH PRESSURE
 FROM FORTH TAP TO WM (ON HIGH PRESSURE

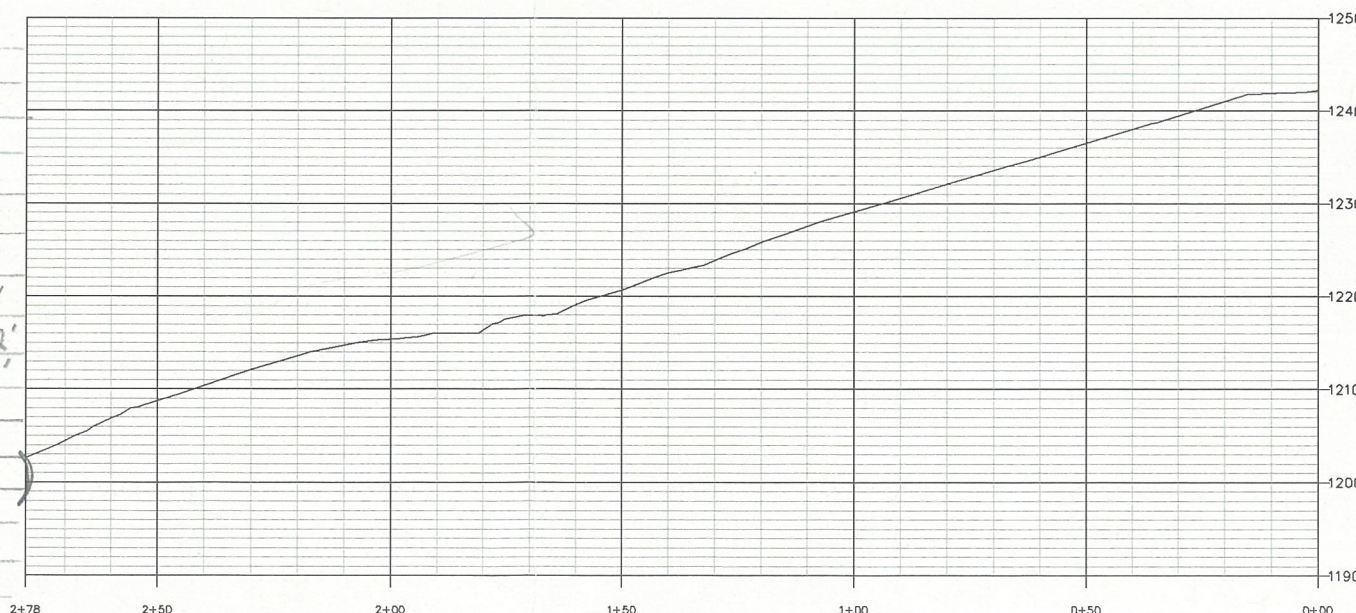

WATERLINE "A"
 SCALE
 VERTICAL: 1" = 10'
 HORIZONTAL: 1" = 20'

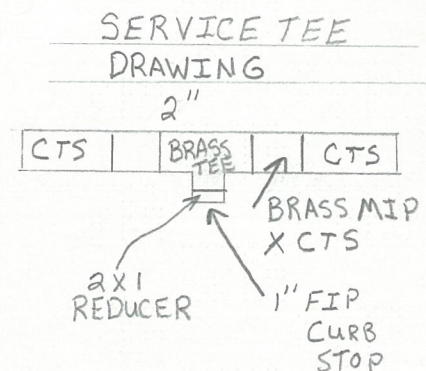

WATER AUTHORITY
 ENGINEERING SERVICES
 601 S JEFFERSON ST, SUITE 300
 ROANOKE, VA 24011
 540-853-5700

BRABLE WATER

PLAN & PROFILE

Rev	Description	Date	By

Designed: AAS

Drawn: AAS

Checked:

Approved:

Date: 8/31/16

Project:

1

Sheet 1 of 2