



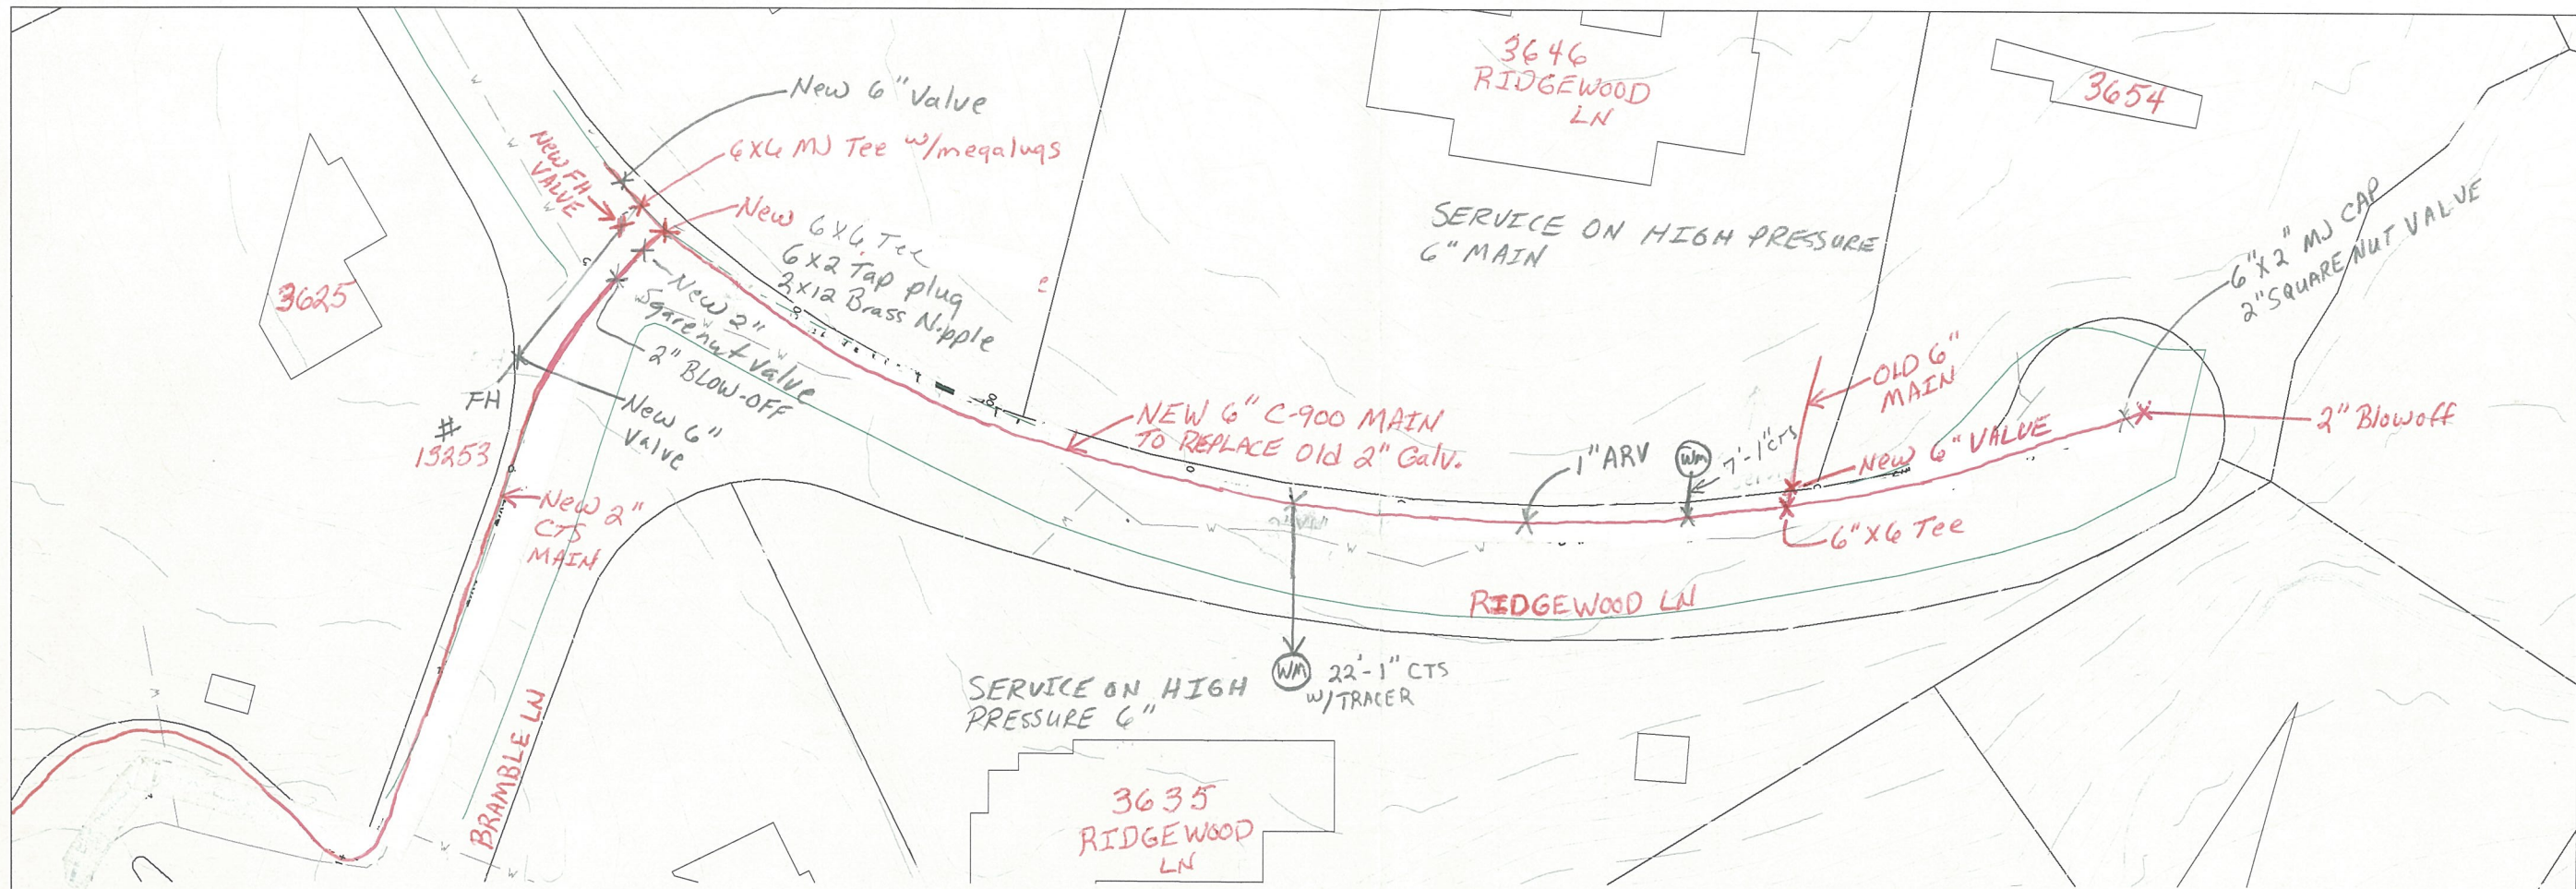


- NEW 6" VALVE TO SERVICE AT 3635 123'
- NEW 6" VALVE TO ARV 223'
- NEW 6" VALVE TO SERVICE AT 3646 260'
- NEW 6" VALVE TO NEW 6X6 MJ TEE & 6" VALVE LOCATED BETWEEN 3646 & 3654 296'
- NEW 6" VALVE TO SERVICE AT 3654 352'
- NEW 6" VALVE TO END OF LINE BLOW-OFF 356'
- NEW 6" C-900 MAIN IS LOCATED 2' OFF EDGE OF ASPHALT

NEW 6" MAIN INSTALLED
10-17-16 / 10-20-16
CIP1 SUPT. BILLY THOMAS

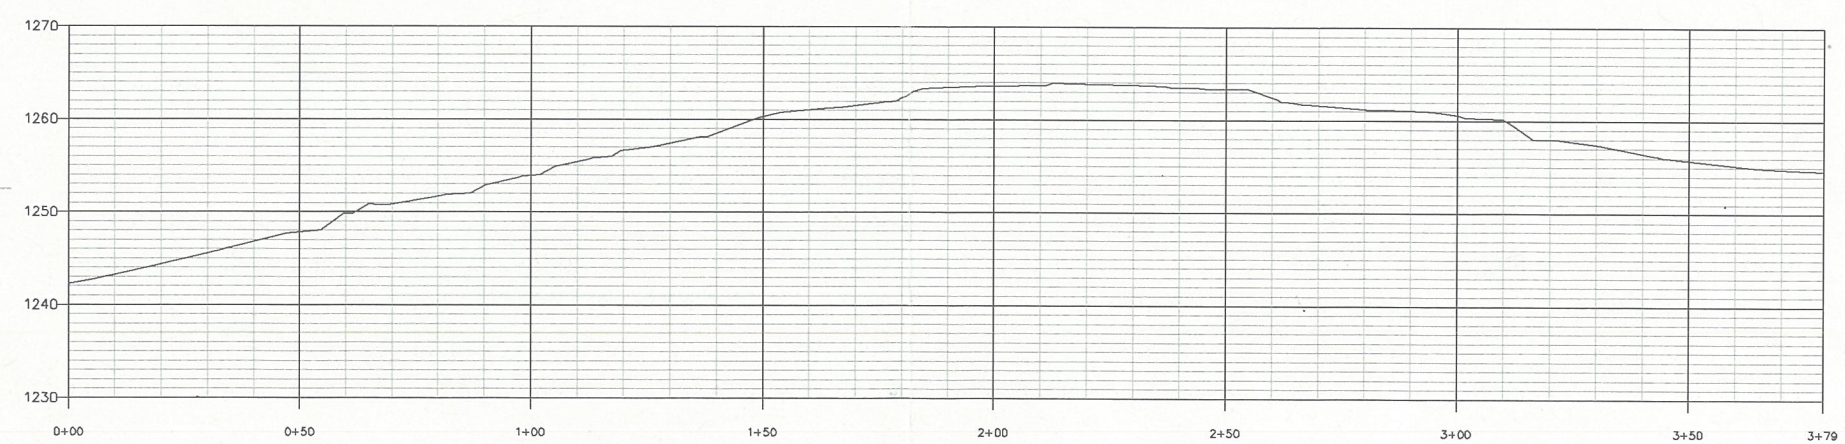

WATERLINE "B"
SCALE
VERTICAL: 1" = 10'
HORIZONTAL: 1" = 20'

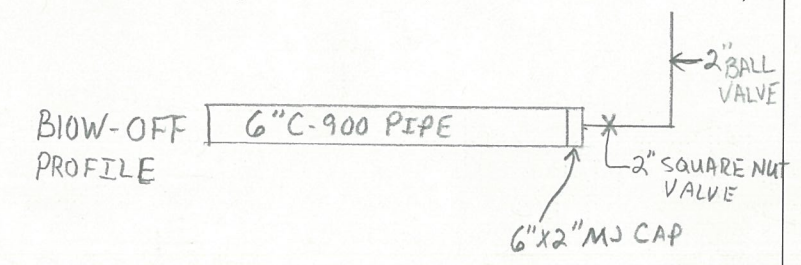

WESTERN VIRGINIA

WATER AUTHORITY

ENGINEERING SERVICES
601 S JEFFERSON ST, SUITE 300
ROANOKE, VA 24011
540-853-5700

BRAMBLE WATER

PLAN & PROFILE

Rev	Description	Date	By

Designed: AAS

Drawn: AAS

Checked:

Approved:

Date: 8/31/16

Project:

2

Sheet 2 of 2