


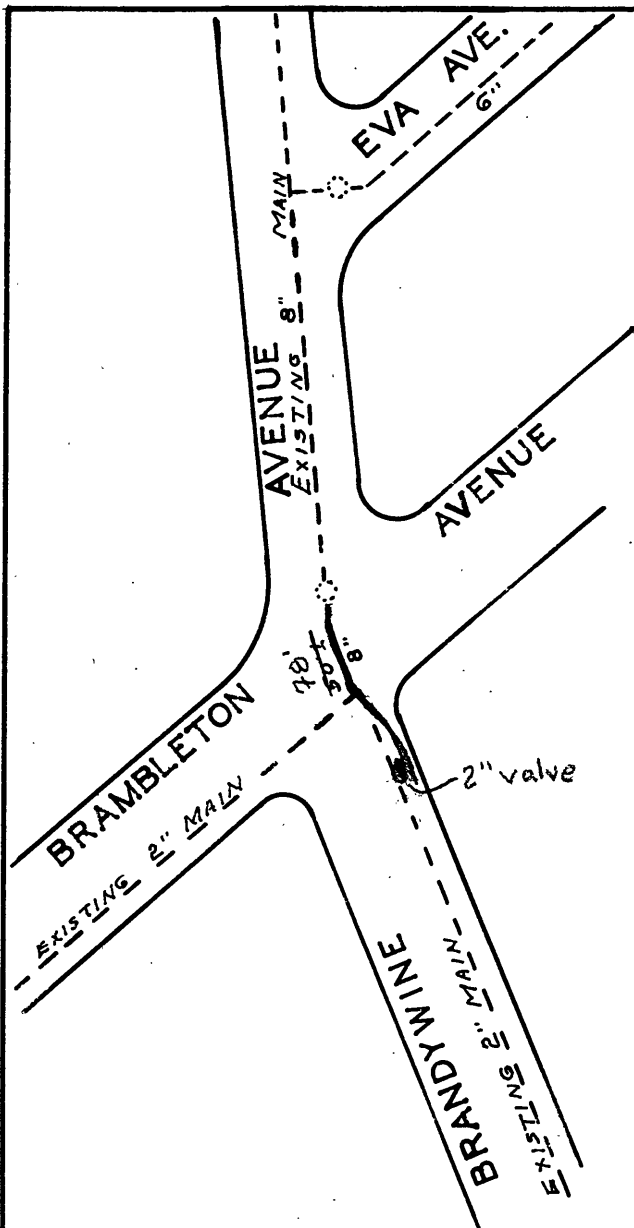

DATE STARTED		3-28-68			
DATE COMP.		4-28-68			
FEET	MAIN	SIZE	VALVE	VAULT	BOX
72'		8"			
3'		2"6	1		1
F. H. COMP.					
F. H. STUB ONLY					
SERV. INS. BY:					
MAINS INS. BY:		R.W.D.			
NO. 3/4" SERV. INS.					
CITY OR CO.		COUNTY			
DEPT. INSP.		L. E. T.			

WATER DEPARTMENT
CITY OF ROANOKE, VA.
BRANDYWINE AVENUE S.W.

SCALE- 1"=100'
DRAWN BY E.L.A. JANUARY, 11, 1968