
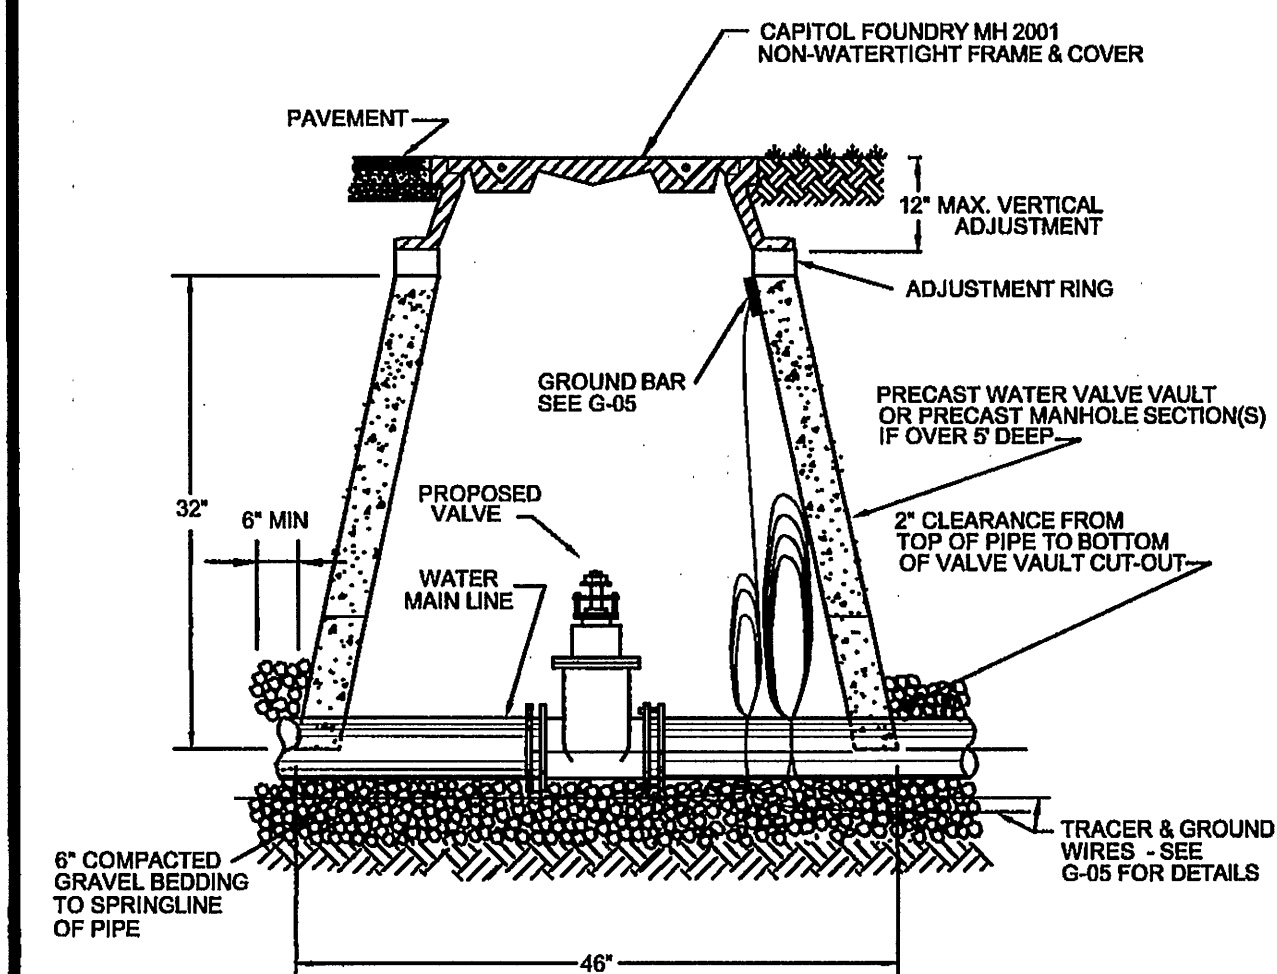



WESTERN VIRGINIA WATER AUTHORITY - CONSTRUCTION STANDARDS			
REVISION	DATE	DOUBLE RESIDENTIAL WATER SERVICE	W-04
07/01/04			
03/01/06			

[illegible]

1. FIRE HYDRANTS MAY BE USED AT LOWPOINTS IN PLACE OF BLOW-OFFS WHERE IT IS DEMONSTRATED THAT A MINIMUM FLUSHING VELOCITY OF 4 FT/S IS PROVIDED.
2. LINE AND "STREET ELS" BETWEEN CORPORATION STOP AND 2" GATE VALVE SHALL BE BRASS

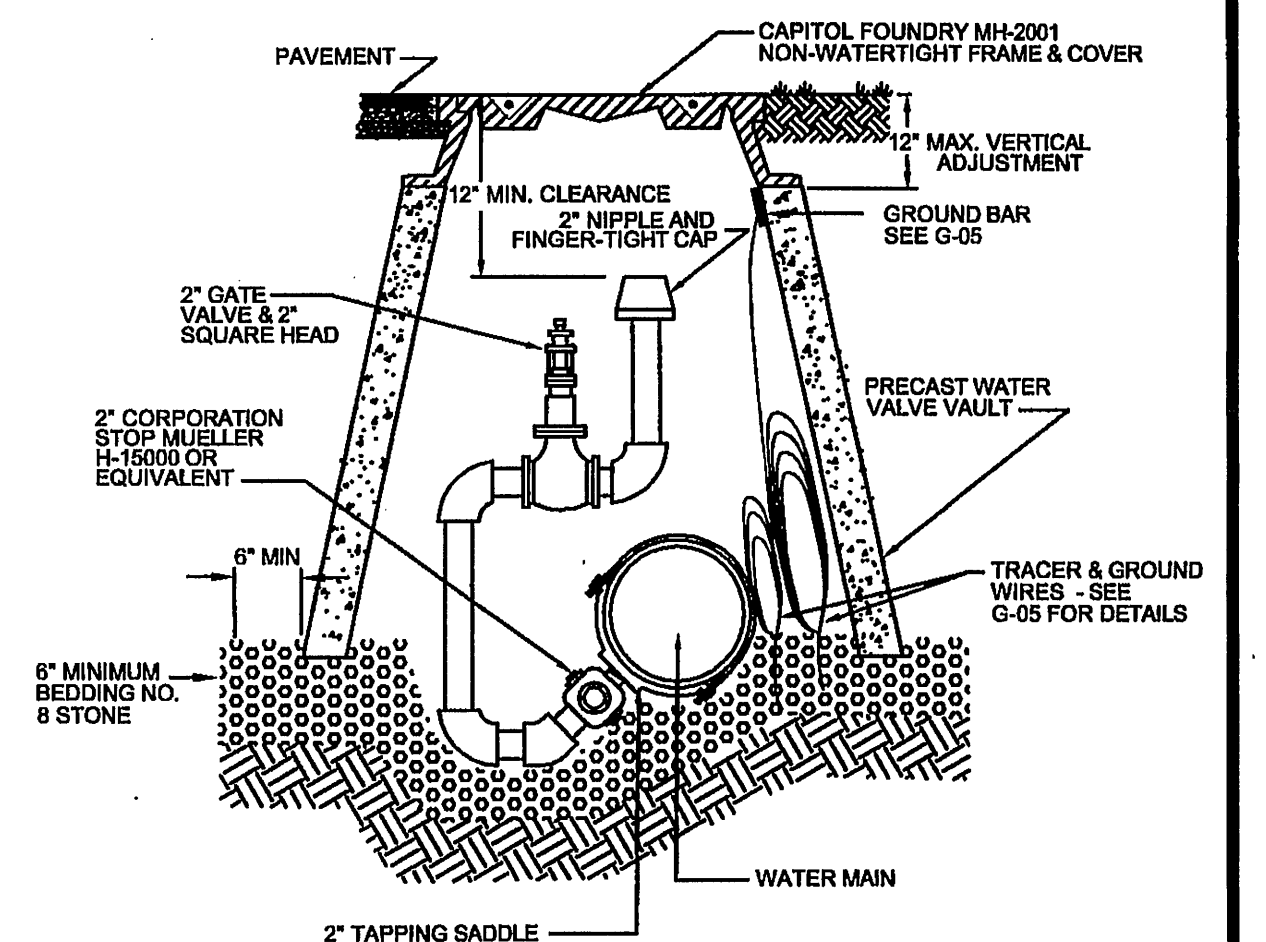

WESTERN VIRGINIA WATER AUTHORITY - CONSTRUCTION STANDARDS			
REVISION DATE	IN-LINE BLOW-OFF ASSEMBLY		W-11
07/01/04			
03/01/06			

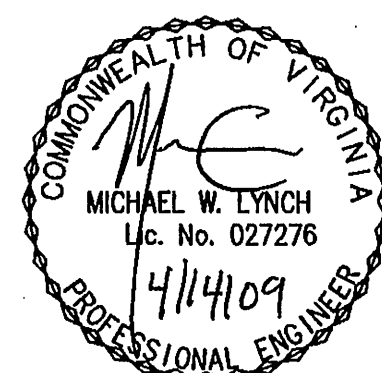

No.	Revision	By	Appd.	Date	Drawn	JSC	WATER DETAILS BRIDLE LANE WATERLINE REPLACMENT WESTERN VA. WATER AUTHORITY	SCALE: AS NOTED
1	WWVA COMMENTS	JSC	MWL	2/11/09	Designed	JSC		FEBRUARY 11, 2009
					Checked	MWL		PROJECT: 07053
					Approved	MWL		7