
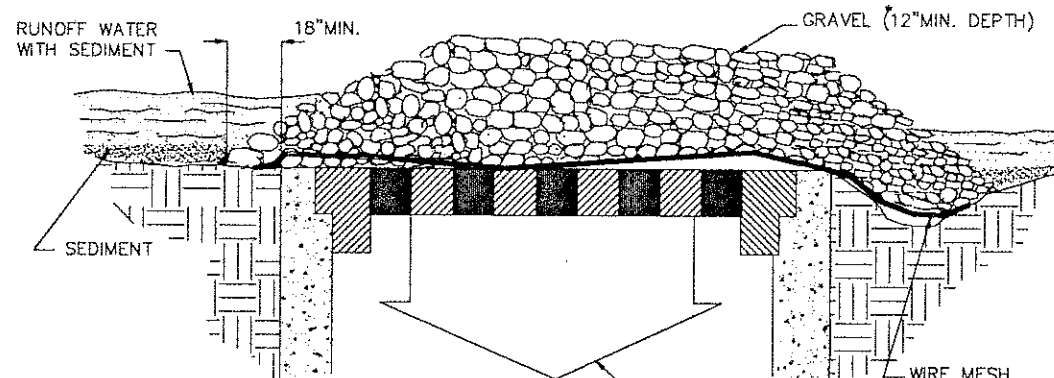
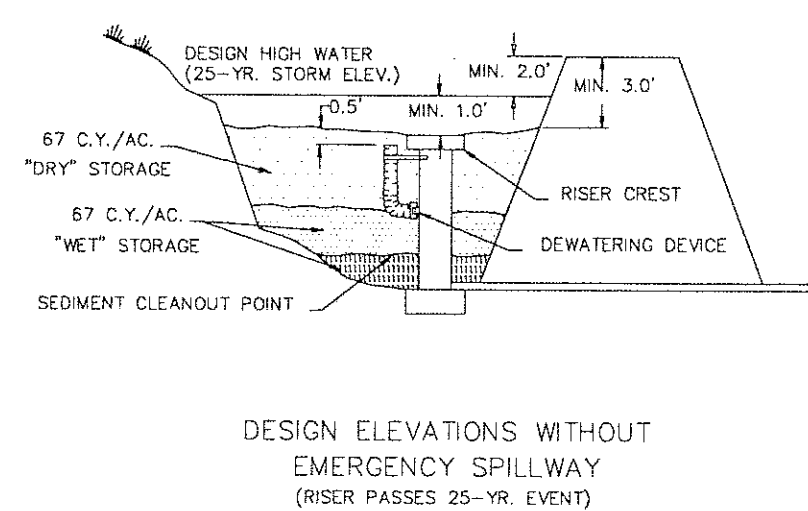


STORMWATER MANAGEMENT COST ESTIMATE				
ALL COSTS GIVEN ARE COMPLETE IN PLACE				
DESCRIPTION	UNIT	QUANTITY	UNIT COST	TOTAL COST
CLEARING & GRUBBING	LS	1.4 AC	\$2000.00	\$2000.00
EXCAVATION	CY	5000.00	\$2.00	\$10000.00
EMBANKMENT	CY	1300.00	\$2.00	\$2600.00
FENCING	LF	970.00	\$10.0	\$9700.00
STRUCTURES	LS	1	\$6000.00	\$6000.00
ACCESS ROAD				
AS-BUILTS	LS	1	\$2000.00	\$2000.00
SUB-TOTAL				\$32300.00
10% CONTINGENCY				\$3230.00
TOTAL PROJECT COST				\$35530.00

SEDIMENT BASIN SCHEMATIC ELEVATIONS

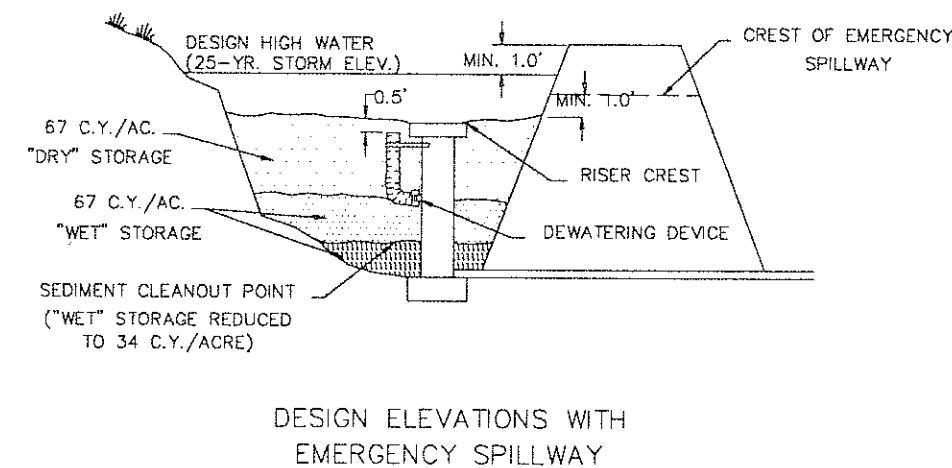

SPECIFIC APPLICATION
This method of inlet protection is applicable where heavy concentrated flows are expected, but not where ponding around the structure might cause excessive inconvenience or damage to adjacent structures and unprotected areas.

* Gravel shall be VDOT #3, #357 or #5 coarse aggregate.

(IP) GRAVEL AND WIRE MESH DROP INLET SEDIMENT FILTER

GENERAL NOTES


- DESIGN OF DETENTION BASINS SHALL CONFORM TO THE REQUIREMENTS OF THE COUNTY OF ROANOKE DRAINAGE STANDARDS (REF. SECTIONS 503.02, 503.03, AND 505.02). THE DESIGN OF THE FACILITY AND PREPARATION OF AS-BUILT PLANS SHALL BE BY A CERTIFIED PROFESSIONAL ENGINEER LICENSED TO PRACTICE IN THE COMMONWEALTH OF VIRGINIA.
- ACCESS TO THE FACILITY MUST BE PROVIDED IN ACCORDANCE WITH THE COUNTY OF ROANOKE DESIGN AND CONSTRUCTION STANDARDS FOR DETENTION PONDS, LATEST EDITION.
- IF THE FACILITY IS OVER FOUR (4) FEET DEEP, TAKES OVER TWO (2) HOURS TO DRAIN, OR THE INTERIOR SLOPE EXCEEDS 3 (H): 1 (V), PERMANENT FENCING MAY BE REQUIRED. ADDITIONALLY, IF THE FACILITY IS IN A CONGESTED AREA OR WILL IN ANY WAY POSE A HAZARD TO THE GENERAL PUBLIC, FENCING MAY BE REQUIRED. FENCING SHALL BE A MINIMUM OF SIX (6) FEET HIGH, A MINIMUM OF STANDARD NINE GAUGE LINK FENCE, AND MUST HAVE ONE OR MORE LOCKING DOUBLE GATES (MINIMUM TEN FEET WIDE) FOR ACCESS.
- DETENTION PONDS SHALL BE BONDED IN ACCORDANCE WITH THE ROANOKE COUNTY BONDING POLICY FOR SUBDIVISION AND SITE DEVELOPMENT. A SEPARATE BOND FOR THE DETENTION FACILITY WILL BE REQUIRED AND ADMINISTERED APART FROM THE SUBDIVISION DEVELOPMENT BOND. REFERENCE ESTIMATE - THIS SHEET.
- REFERENCE THE COUNTY OF ROANOKE DESIGN AND CONSTRUCTION STANDARDS FOR DETENTION PONDS, LATEST EDITION, FOR ACCEPTANCE AND MAINTENANCE OF THE FACILITY. CERTIFIED AS-BUILTS ARE REQUIRED AND MUST INCLUDE:
 - DIMENSIONS OF THE FACILITY
 - VOLUME @ MAXIMUM DEPTH
 - ELEVATIONS OF STRUCTURES, SPILLWAYS, AND TOP
 - MATERIALS VERIFICATION INCLUDING RESULTS OF DENSITY TESTS CONDUCTED BY AN INDEPENDENT SOIL TESTING LABORATORY
 - LOCATION AND ELEVATION OF BENCHMARK.
- ONE FOOT MINIMUM FREEBOARD REQUIRED FOR THE 100 YR WATER SURFACE ELEVATION.

CONSTRUCTION NOTES


- SITE PREPARATION SHALL BE IN ACCORDANCE WITH THE COUNTY OF ROANOKE DESIGN AND CONSTRUCTION STANDARDS FOR DETENTION PONDS, LATEST EDITION.
- SLOPES STEEPER THAN 3 TO 1 (HORIZONTAL TO VERTICAL) SHALL BE BENCH OR STEPPED PRIOR TO PLACING FILL ON THEM.
- ON-SITE FILL MATERIAL OR BORROW FILL MATERIAL MAY BE UTILIZED. FILL MATERIAL SOILS, IN GENERAL:
 - SHALL BE COMPACTABLE
 - SHALL BE WITHIN AN ACCEPTABLE RANGE OF MOISTURE CONTENT WHICH IS READILY CONTROLLED
 - SHALL NOT BE HIGHLY SUSCEPTIBLE TO VOLUME CHANGE (SHRINKAGE OR SWELL) OR SETTLEMENT
- FILL MATERIALS CONTAINING ROCKS LARGER THAN SIX (6) INCHES (15.2 CM) SHALL NOT BE USED. THE UPPERMOST TWO (2) FEET (61 CM) SHALL NOT HAVE ANY ROCK LARGER THAN TWO (2) INCHES (5.1 CM) IN DIAMETER.
- THE APPROVED FILL SHALL BE PLACED IN EIGHT (8) INCH (20 CM) LOOSE LIFTS. EACH LIFT SHALL BE SPREAD IN UNIFORM LAYERS. FILL SOIL SHALL BE UTILIZED ONLY WITHIN A MOISTURE RANGE OF +/- 5% OF THE OPTIMUM MOISTURE CONTENT. COMPACTION OF THE FILL SHALL BE PERFORMED WITH APPROVED EQUIPMENT. COMPACTION OF THE LAYERS SHALL BE CONTINUOUS AND UNIFORM.
- EMBANKMENT MATERIAL IN FILL AREAS SHALL BE PLACED IN LIFTS NOT EXCEEDING EIGHT (8) INCHES AND SHALL BE COMPACTED TO A MINIMUM 95% DENSITY IN ACCORDANCE WITH SECTION 303 OF THE VIRGINIA DEPARTMENT OF TRANSPORTATION ROAD AND BRIDGE SPECIFICATIONS.
- FIELD DENSITY TESTS ARE TO BE CONDUCTED BY AN INDEPENDENT SOILS TESTING LABORATORY UNDER THE DIRECTION OF A QUALIFIED GEOTECHNICAL ENGINEER. THE RESULTS OF THESE TESTS SHALL BE SUBMITTED TO THE COUNTY OF ROANOKE WITH AS-BUILT PLANS AS A CONDITION OF ACCEPTANCE OF THE FACILITY BY THE COUNTY. FIELD DENSITY TESTS, AS DIRECTED BY THE ENGINEER SHALL BE PERFORMED PERIODICALLY TO DETERMINE THE DEGREE OF COMPACTION. ANY AREAS FAILING TO MEET THE ABOVE REQUIREMENTS SHALL BE REWORKED AND/OR RECOMPACTED UNTIL THE REQUIRED DEGREE OF COMPACTION IS ACHIEVED.
- ANTI-SEEP COLLARS SHALL BE INSTALLED IN ACCORDANCE WITH THE REQUIREMENTS OF THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION.
- ALL DISTURBED AREAS SHALL BE COVERED WITH FOUR (4) INCHES OF TOPSOIL AND SEED.
- THE MINIMUM SLOPE OF THE BASIN FLOOR SHALL BE ONE (1) PERCENT GRADED TO DRAIN TO THE PRINCIPAL SPILLWAY.

SPECIFIC APPLICATION


This method of inlet protection is applicable where heavy flows are expected and where an overflow capability and ease of maintenance are desirable.

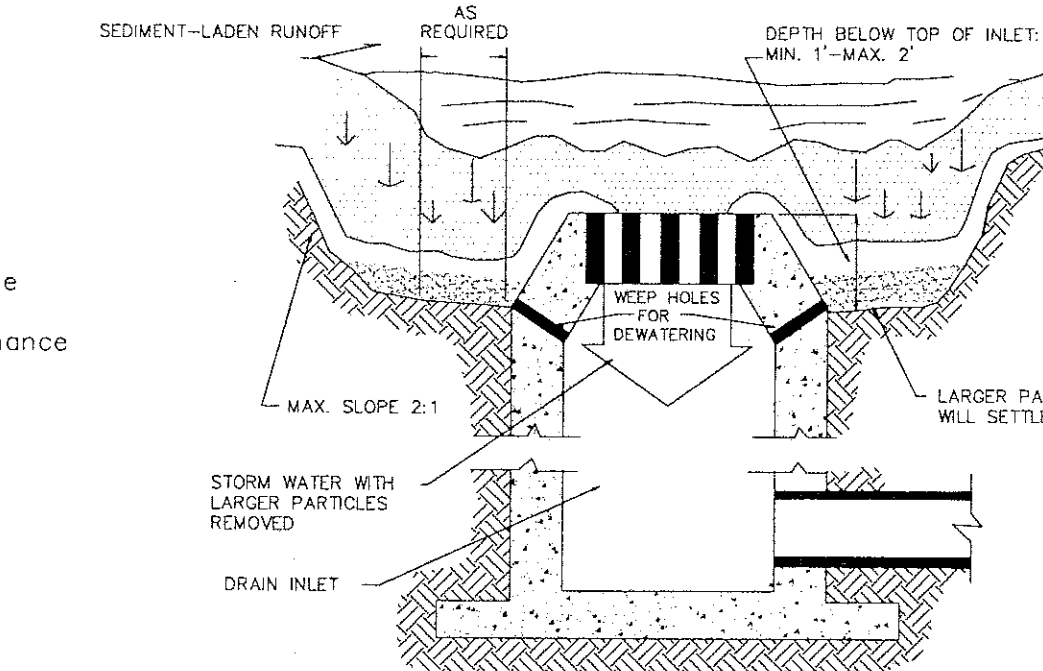


(IP) EXCAVATED DROP INLET SEDIMENT TRAP

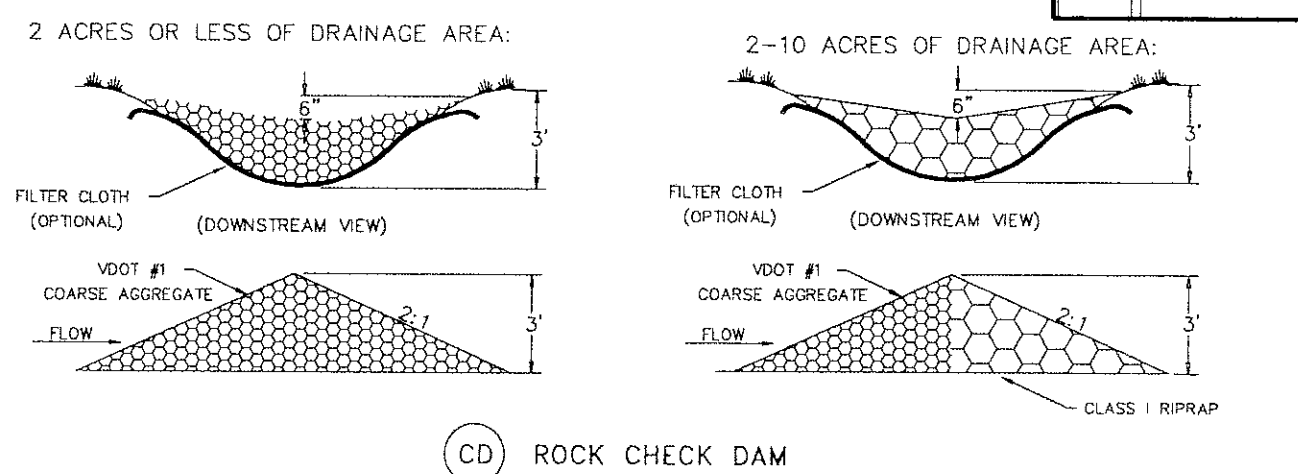

(CD) ROCK CHECK DAM

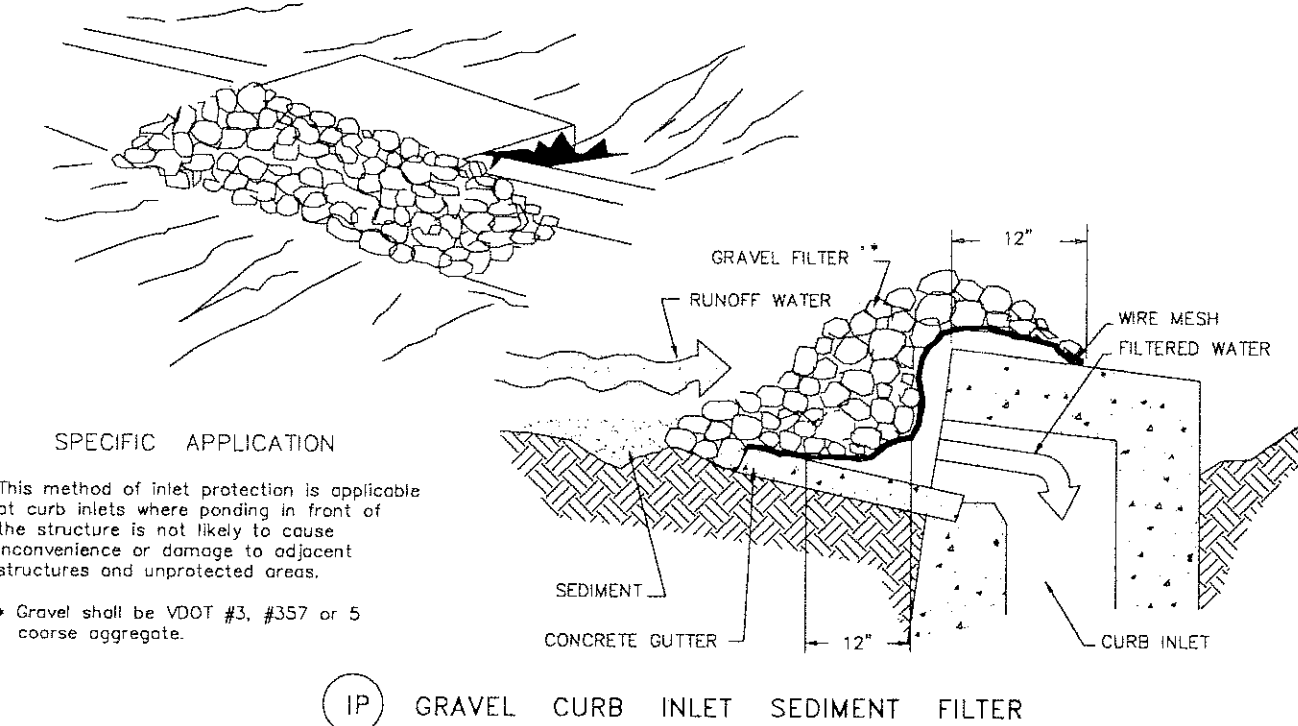


(IP) GRAVEL CURB INLET SEDIMENT FILTER

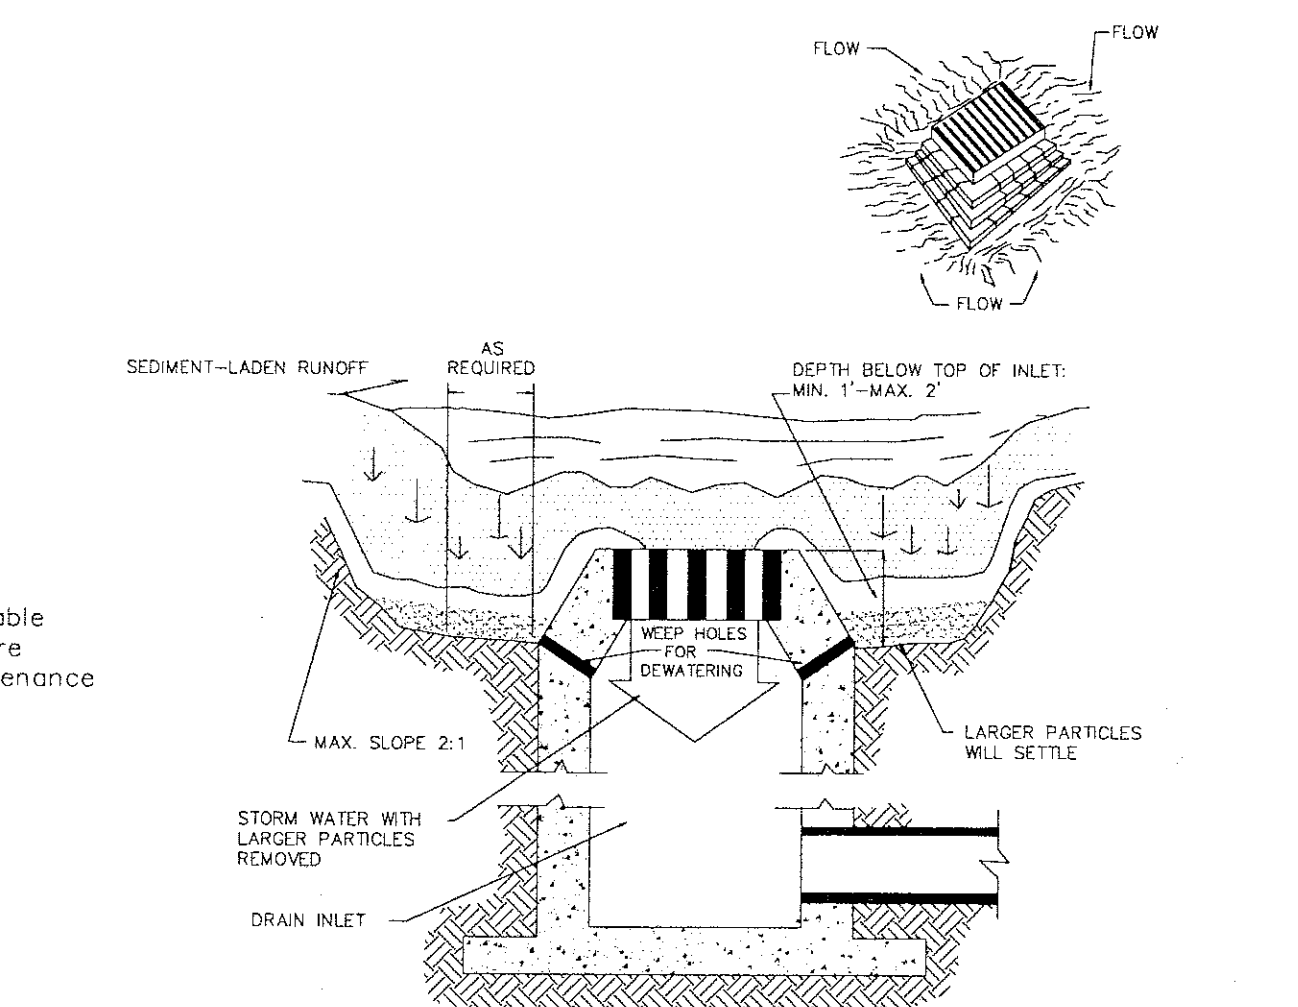

(IP) EXCAVATED DROP INLET SEDIMENT TRAP

NO.	TITLE	KEY	SYMBOL	NO.	TITLE	KEY	SYMBOL
3.01	SAFETY FENCE	SAF	[Symbol]	3.20	ROCK CHECK DAMS	CD	[Symbol]
3.02	TEMPORARY GRAVEL CONSTRUCTION ENTRANCE	CE	[Symbol]	3.21	LEVEL SPREADER	LS	[Symbol]
3.03	CONSTRUCTION ROAD STABILIZATION	CRS	[Symbol]	3.22	VEGETATIVE STREAMBANK STABILIZATION	VSS	[Symbol]
3.04	STRAW BALE BARRIER	STB	[Symbol]	3.23	STRUCTURAL STREAMBANK STABILIZATION	SSS	[Symbol]
3.05	SILT FENCE	SF	[Symbol]	3.24	TEMPORARY VEHICULAR STREAM CROSSING	VSC	[Symbol]
3.06	BRUSH BARRIER	BB	[Symbol]	3.25	UTILITY STREAM CROSSING	USC	[Symbol]
3.07	STORM DRAIN INLET PROTECTION	IP	[Symbol]	3.26	DEWATERING STRUCTURE	DS	[Symbol]
3.08	CULVERT INLET PROTECTION	CIP	[Symbol]	3.27	TURBIDITY CURTAIN	TC	[Symbol]
3.09	TEMPORARY DIVERSION DIKE	DD	[Symbol]	3.28	SUBSURFACE DRAIN	SD	[Symbol]
3.10	TEMPORARY FILL DIVERSION	FD	[Symbol]	3.29	SURFACE ROUGHENING	SR	[Symbol]
3.11	TEMPORARY RIGHT-OF-WAY DIVERSION	RWD	[Symbol]	3.30	TOPSOILING	TO	[Symbol]
3.12	DIVERSION	DV	[Symbol]	3.31	TEMPORARY SEEDING	TS	[Symbol]
3.13	TEMPORARY SEDIMENT TRAP	ST	[Symbol]	3.32	PERMANENT SEEDING	PS	[Symbol]
3.14	TEMPORARY SEDIMENT BASIN	SB	[Symbol]	3.33	SODDING	SO	[Symbol]
3.15	TEMPORARY SLOPE DRAIN	TS	[Symbol]	3.34	BERMUDA GRASS AND ZOYSIAURASS ESTABLISHMENT	BZ	[Symbol]
3.16	PAVED FLUME	PF	[Symbol]	3.35	MULCHING	MU	[Symbol]
3.17	STORMWATER CONVEYANCE CHANNEL	SCC	[Symbol]	3.36	SOIL STABILIZATION BLANKETS AND MATTING	BS	[Symbol]
3.18	OUTLET PROTECTION	OP	[Symbol]	3.37	TREES, SHRUBS, VINES AND GROUND COVERS	VEG	[Symbol]
3.19	RIPRAP	RR	[Symbol]	3.38	TREE PRESERVATION AND PROTECTION	TP	[Symbol]
				3.39	DUST CONTROL	DC	[Symbol]


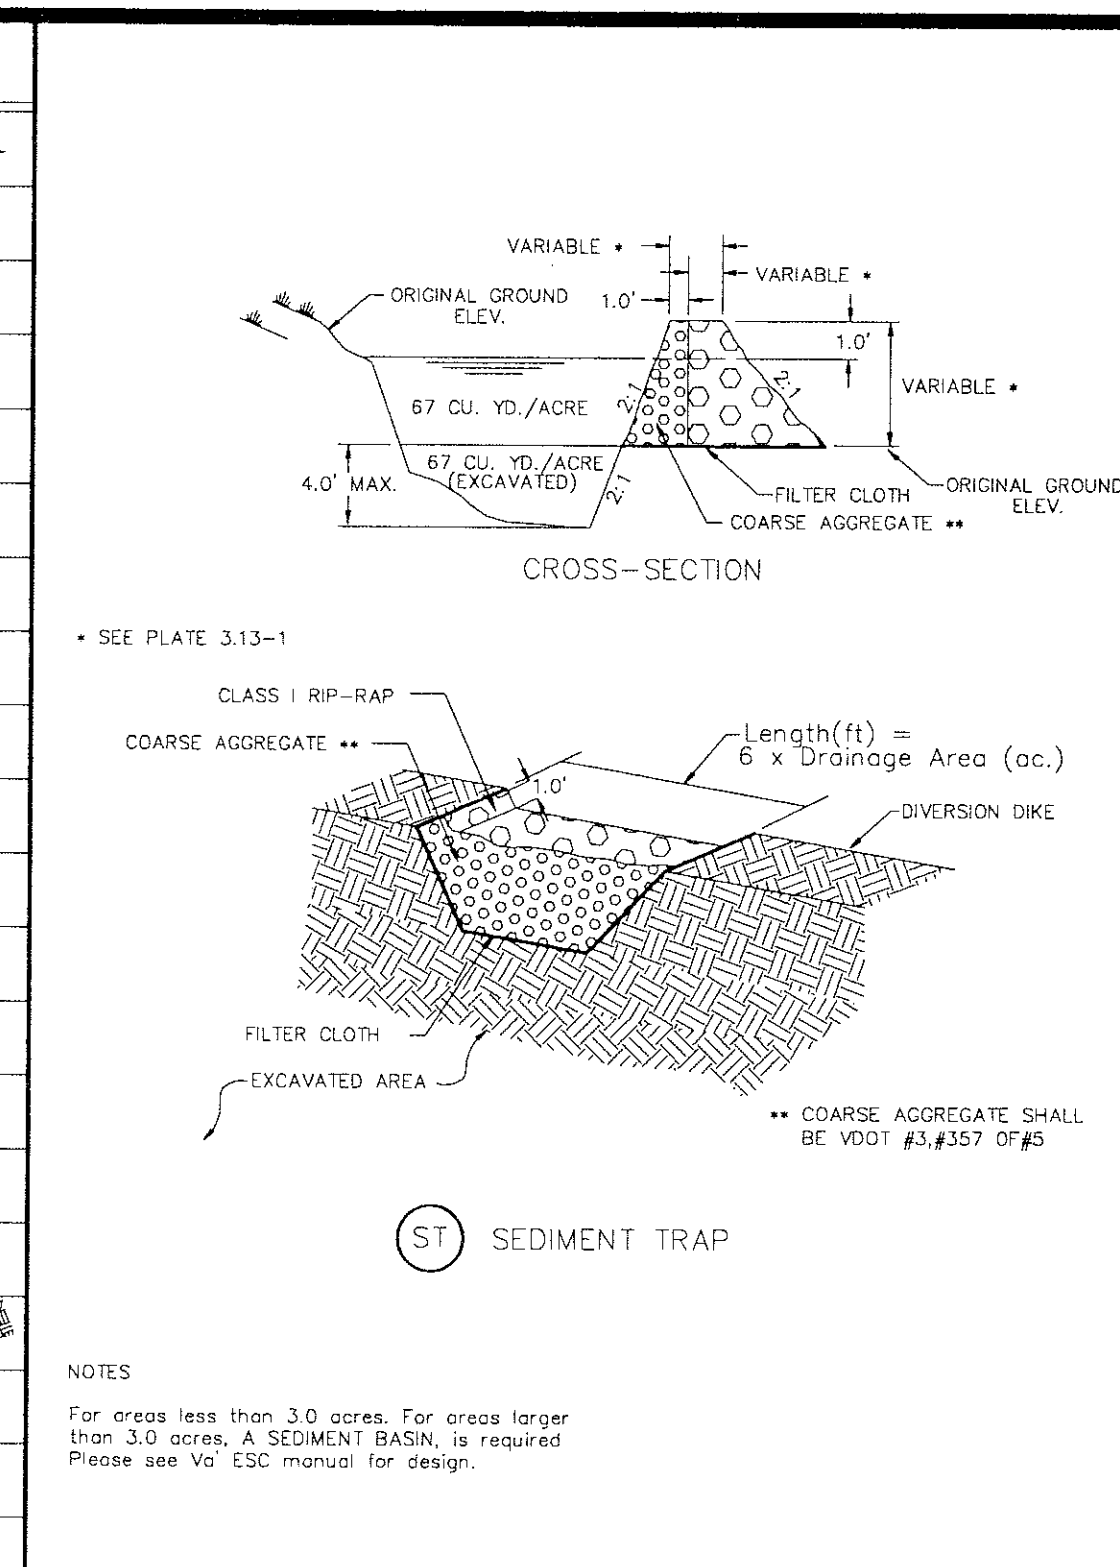


NOTES


For areas less than 3.0 acres. For areas larger than 3.0 acres, A SEDIMENT BASIN, is required. Please see Vol. ESC manual for design.

TEMPORARY SEDIMENT TRAP DATA

STRUCTURE	DRAINAGE AREA (ACRES)	STORAGE (C.Y.)	WEIR LENGTH (FT.)	WEIR HEIGHT (FT.)	BERM HEIGHT (FT.)
1	1.23	164.8	164.8	7.4	3
3	1.44	193.4	193.4	8.6	3
4	1.30	174.2	174.2	7.8	4
5	2.08	278.8	278.8	12.5	6
6	2.74	367.6	367.6	16.4	5
7	2.08	278.8	278.8	12.5	6
8	0.78	104.0	104.0	4.7	3
9	1.30	174.2	174.2	7.8	4

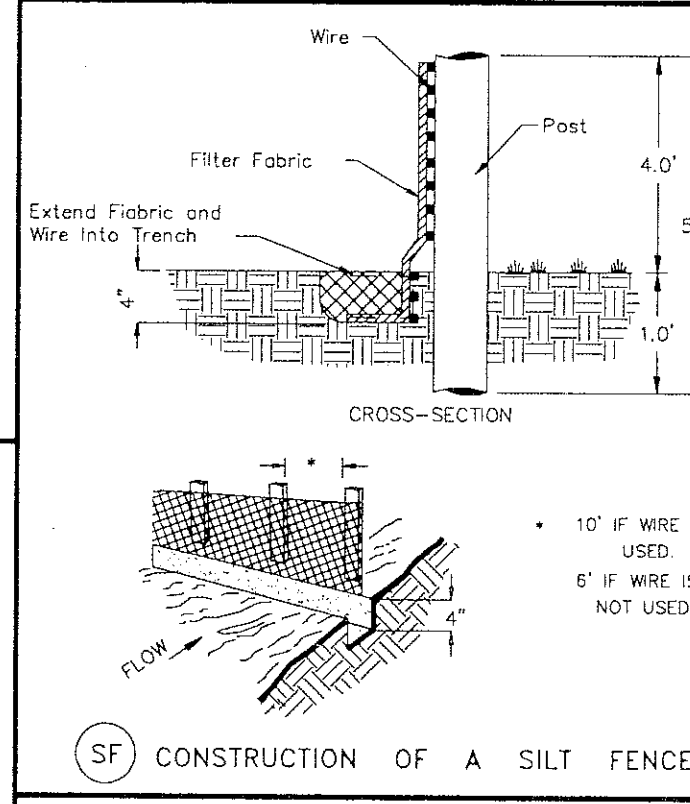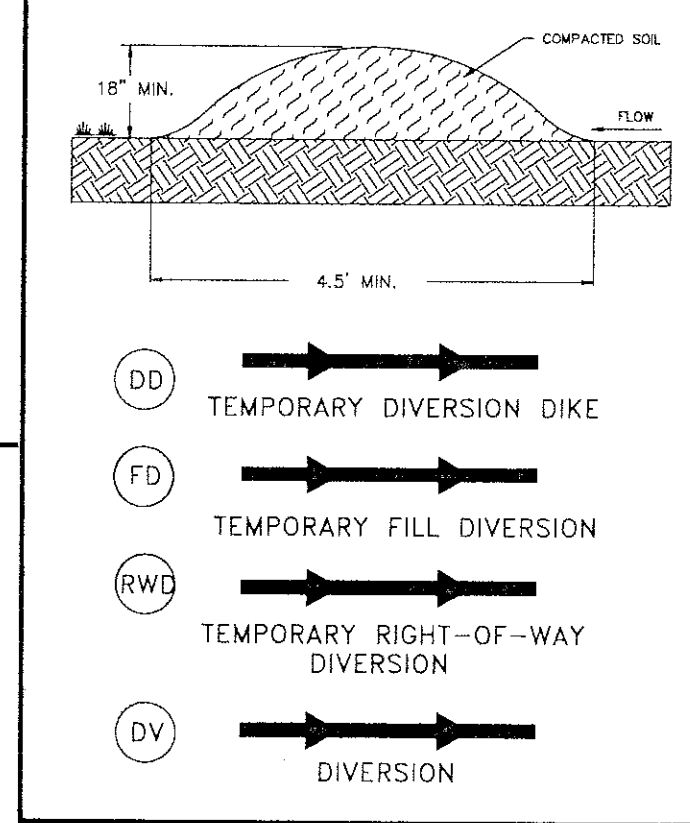

(SF) CONSTRUCTION OF A SILT FENCE

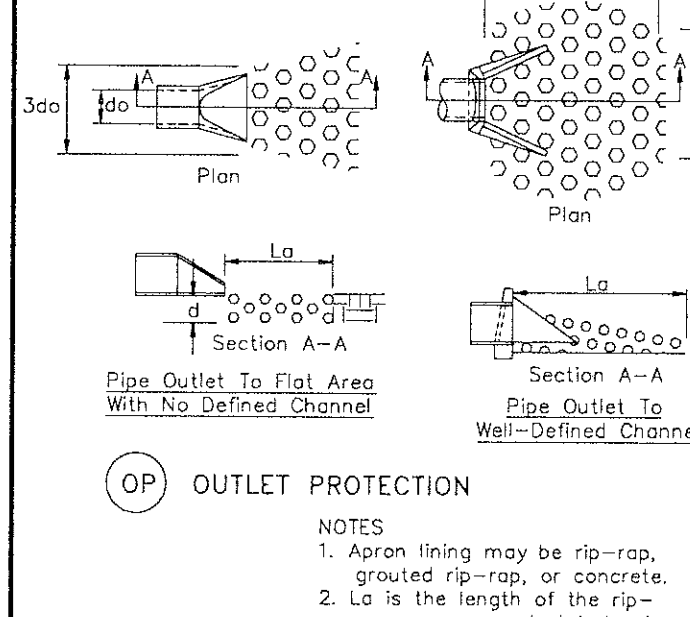

(CE) TEMPORARY GRAVEL CONSTRUCTION ENTRANCE

EROSION-SILTATION CONTROL COST ESTIMATE				
ALL COSTS GIVEN ARE COMPLETE IN PLACE				
DESCRIPTION	UNIT	QUANTITY	UNIT COST	TOTAL COST
CONSTRUCTION ENTRANCE	EA	1	\$280.00	\$280.00
SILT FENCE	LF	1690	\$3.00	\$5070.00
INLET PROTECTION	EA	36	\$75.00	\$2700.00
TEMPORARY DIVERSION DIKE	LF	2180	\$4.00	\$8720.00
TEMPORARY FILL DIVERSION	LF			
SEDIMENT TRAP	EA	8	\$1200.00	\$9600.00
CHECK DAM	EA			
PERMANENT SEEDING	1000 SF	500	\$31.00	\$15500.00
OUTLET PROTECTION	EA	7	\$400.00	\$2800.00
SEDIMENT BASIN	EA	1	\$2500.00	\$2500.00
CULVERT INLET PROTECTION	EA	4	\$400.00	\$1600.00
SUB-TOTAL				\$48720.00
10% CONTINGENCY				\$4872.00
TOTAL PROJECT COST				\$53592.00

GENERAL EROSION AND SEDIMENT CONTROL NOTES

- ALL SOIL EROSION & SEDIMENT CONTROL MEASURES SHALL BE ACCOMPLISHED IN STRICT ACCORDANCE WITH THE STANDARDS AND SPECIFICATIONS CONTAINED IN THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION.
- THE APPROVING AUTHORITY MAY ADD TO, DELETE, RELOCATE, CHANGE, OR OTHERWISE MODIFY CERTAIN EROSION AND SEDIMENT CONTROL MEASURES WHERE FIELD CONDITIONS ARE ENCOUNTERED THAT WARRANT SUCH MODIFICATIONS.
- ALL SOIL EROSION AND SEDIMENT CONTROL MEASURES AS SHOWN ON THE PLAN SHALL BE PLACED IN ADVANCE OF THE WORK BEING PERFORMED, AS FAR AS PRACTICAL.
- IN NO CASE DURING CONSTRUCTION SHALL WATER RUNOFF BE DIVERTED OR ALLOWED TO FLOW TO LOCATIONS WHERE ADEQUATE PROTECTION HAS NOT BEEN PROVIDED.
- IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO LEAVE THE SITE ADEQUATELY PROTECTED AGAINST EROSION, SEDIMENTATION, OR ANY DAMAGE TO ANY ADJACENT PROPERTY AT THE END OF EACH DAY'S WORK.
- FOR THE EROSION CONTROL KEY SYMBOLS SHOWN ON THE PLANS, REFER TO THE VIRGINIA UNIFORM CODING SYSTEM FOR EROSION AND SEDIMENT CONTROL PRACTICES CONTAINED IN THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION. THESE SYMBOLS AND KEYS ARE TO BE UTILIZED ON ALL EROSION CONTROL PLANS SUBMITTED TO ROANOKE COUNTY.

(PS) PERMANENT SEEDING MIXTURE

- TYPE A**
- 15 OCTOBER TO 1 FEBRUARY
K-31 FESCUE @ 5 LB / 1000 SF
BORZY WINTER RYE @ 1/2 LB / 1000 SF
- 1 FEBRUARY TO 1 JUNE
K-31 FESCUE @ 5 LB / 1000 SF
ANNUAL RYE @ 1/2 LB / 1000 SF
- 1 JUNE TO 1 SEPTEMBER
K-31 FESCUE @ 5 LB / 1000 SF
GERMAN MILLET @ 1/2 LB / 1000 SF
- 1 SEPTEMBER TO 15 OCTOBER
K-31 FESCUE @ 5 LB / 1000 SF
ANNUAL RYE @ 1/2 LB / 1000 SF
- TYPE B (SLOPES 3:1 OR STEEPER)**
- 15 MARCH TO 1 MAY
CROWN VETCH @ 1/2 LB / 1000 SF
PERENNIAL RYEGRASS @ 1/2 LB / 1000 SF
RED TOP @ 1/8 LB / 1000 SF
- 15 AUGUST TO 1 OCTOBER
CROWN VETCH @ 1/2 LB / 1000 SF
PERENNIAL RYEGRASS @ 1/2 LB / 1000 SF
RED TOP @ 1/8 LB / 1000 SF
- LIME:** 140 LB / 1000 SF PULVERIZED AGRICULTURAL LIMESTONE
- FERTILIZER:** 5-20-10 @ 25 LB / 1000 SF
38-0-0 @ 7 LB / 1000 SF
- MULCH:** IF REQUIRED, SHALL BE USED OVER ALL SEEDING AREAS AND SHALL BE APPLIED IN ACCORDANCE WITH SECTION 1.75 OF THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION.
- SOIL CONDITIONING:** INCORPORATION OF LIME AND FERTILIZER, SELECTION OF CERTIFIED SEED, MULCHING, MAINTENANCE OF NEW SEEDINGS, AND RESEEDING SHALL BE IN ACCORDANCE WITH SPECIFICATIONS CONTAINED WITHIN THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION. ADDITIONAL SEEDING TO BE PERFORMED AS REQUIRED BY THE INSPECTOR.
- SEED APPLICATION:** APPLY SEED UNIFORMLY WITH A CYCLONE SEEDER, DRILL, CULTIPACKER SEEDER, OR HYDROSEEDER ON A FIRM, FRIABLE, SEEDBED. MAXIMUM SEEDING DEPTH SHALL BE 1/4 INCH.

TOTAL DISTURBED AREA = 11.5 AC. = 500,000 SQ. FT.

1	ENGR. & INSPEC.	04-10-93
2	ENGR. & INSPEC.	08-05-93
3	ENGR. & INSPEC.	10-27-93
4		
5		
6		
NO.	REVISIONS	DATE

RC-6446