


DATE STARTED 2-5-92				
DATE COMP. 2-21-92				
FEET MAIN	SIZE	VALVE	VAULT	BOX
783'	6"			
F. H. COMP.				
F. H. STUB ONLY ♂				
SERV. INS. BY: C.O. DAME				
MAIN INS. BY: C.O. DAME				
NO. 3/4" SERV. INS. 4 (FOUR)				
CITY OR CO. CITY				
DEPT. INSP. U.L.S.				

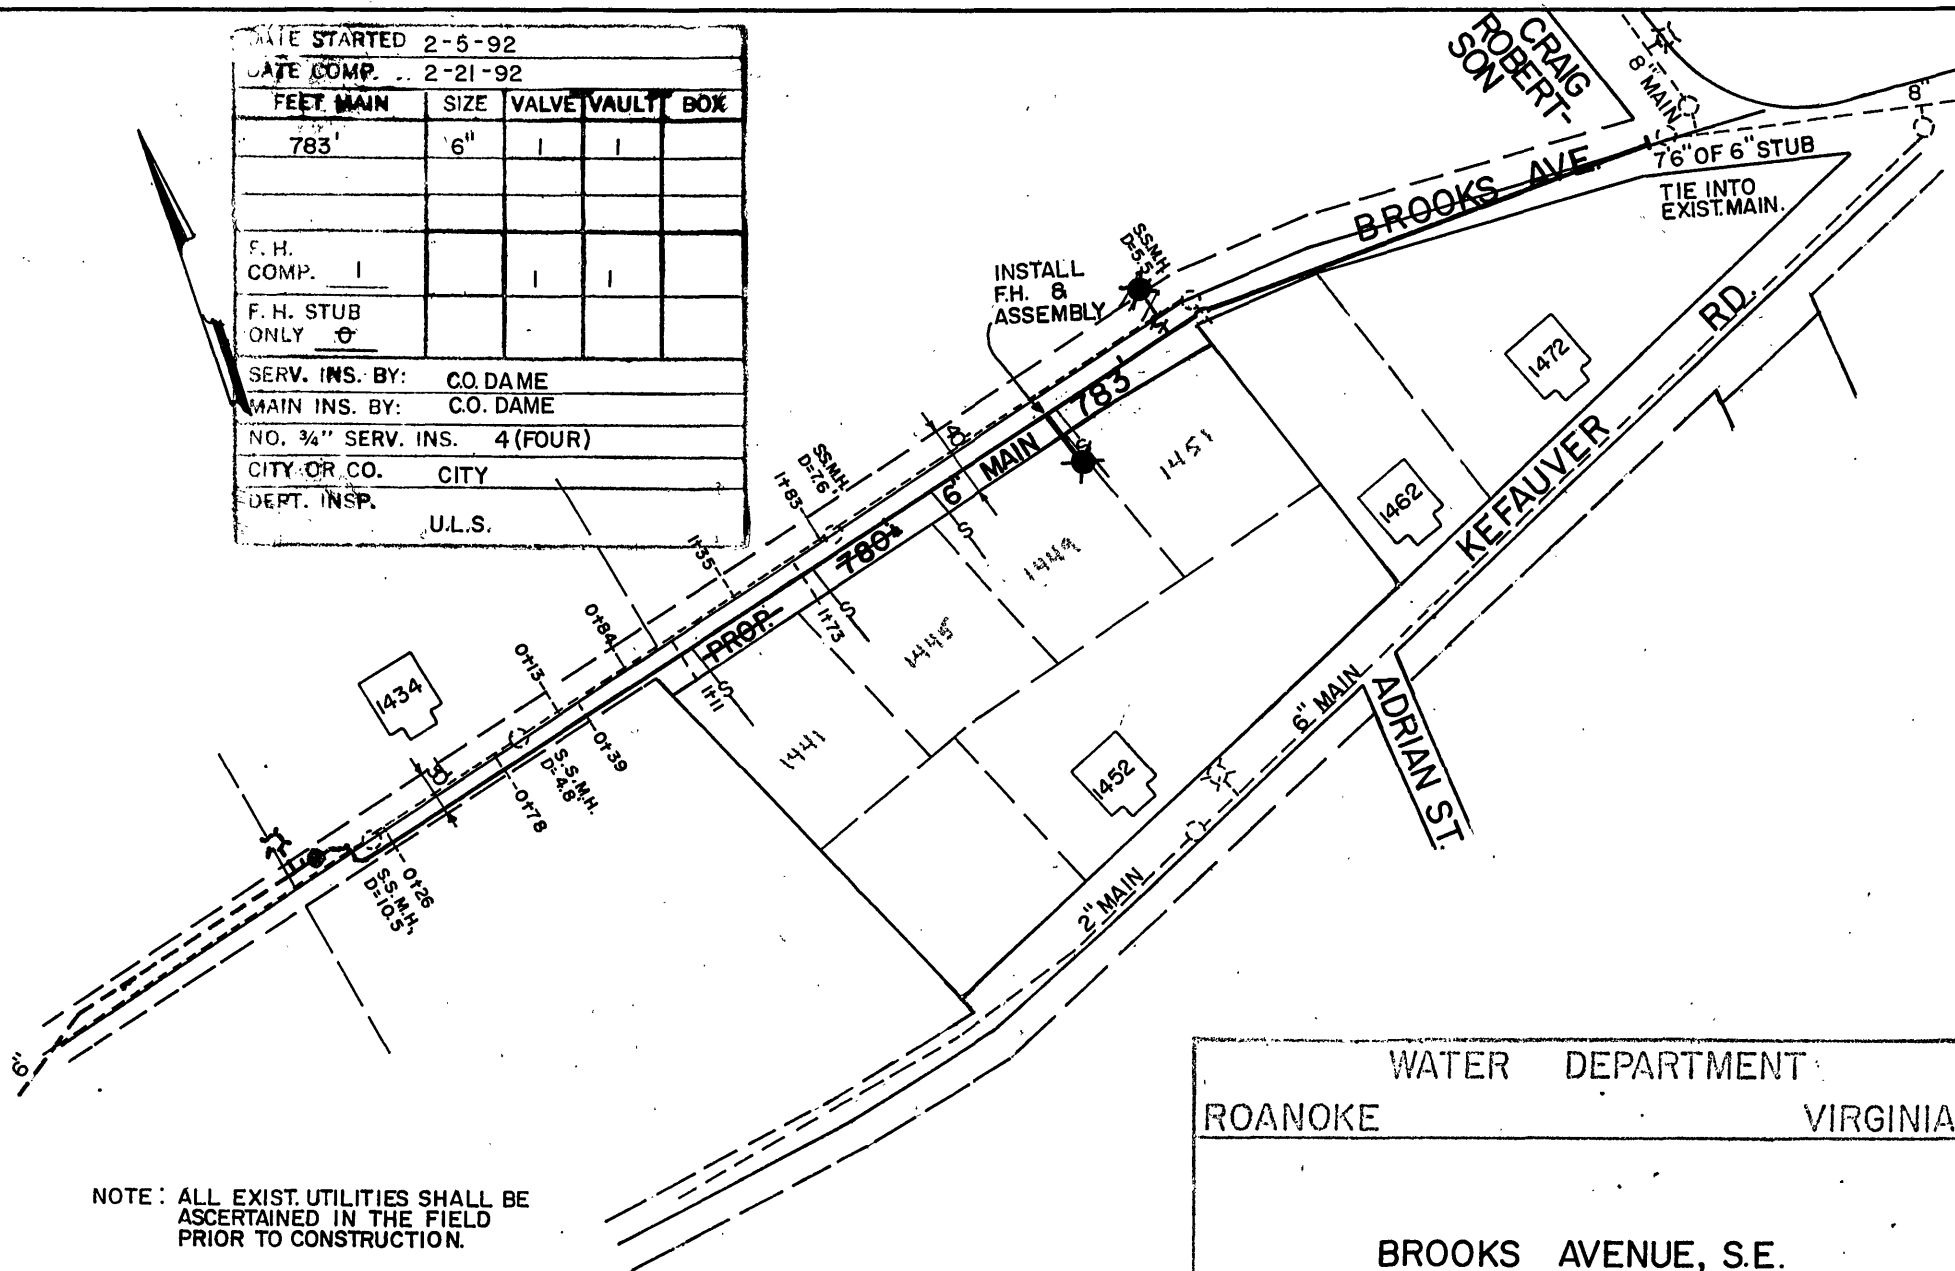

NOTE: ALL EXIST. UTILITIES SHALL BE ASCERTAINED IN THE FIELD PRIOR TO CONSTRUCTION.

John H. Bullock
MANAGER UTILITY LINE SERVICES

WATER DEPARTMENT
ROANOKE VIRGINIA

BROOKS AVENUE, S.E.

SCALE: 1"=100'

DATE: 11-19-91

DIST. MAP: 437

PLAN NO.: 91-11

M. Craig Fluss 12/19/91
DIRECTOR UTILITIES & OPERATIONS DATE
William J. Clark 12-18-91
DIRECTOR OF PUBLIC WORKS DATE