


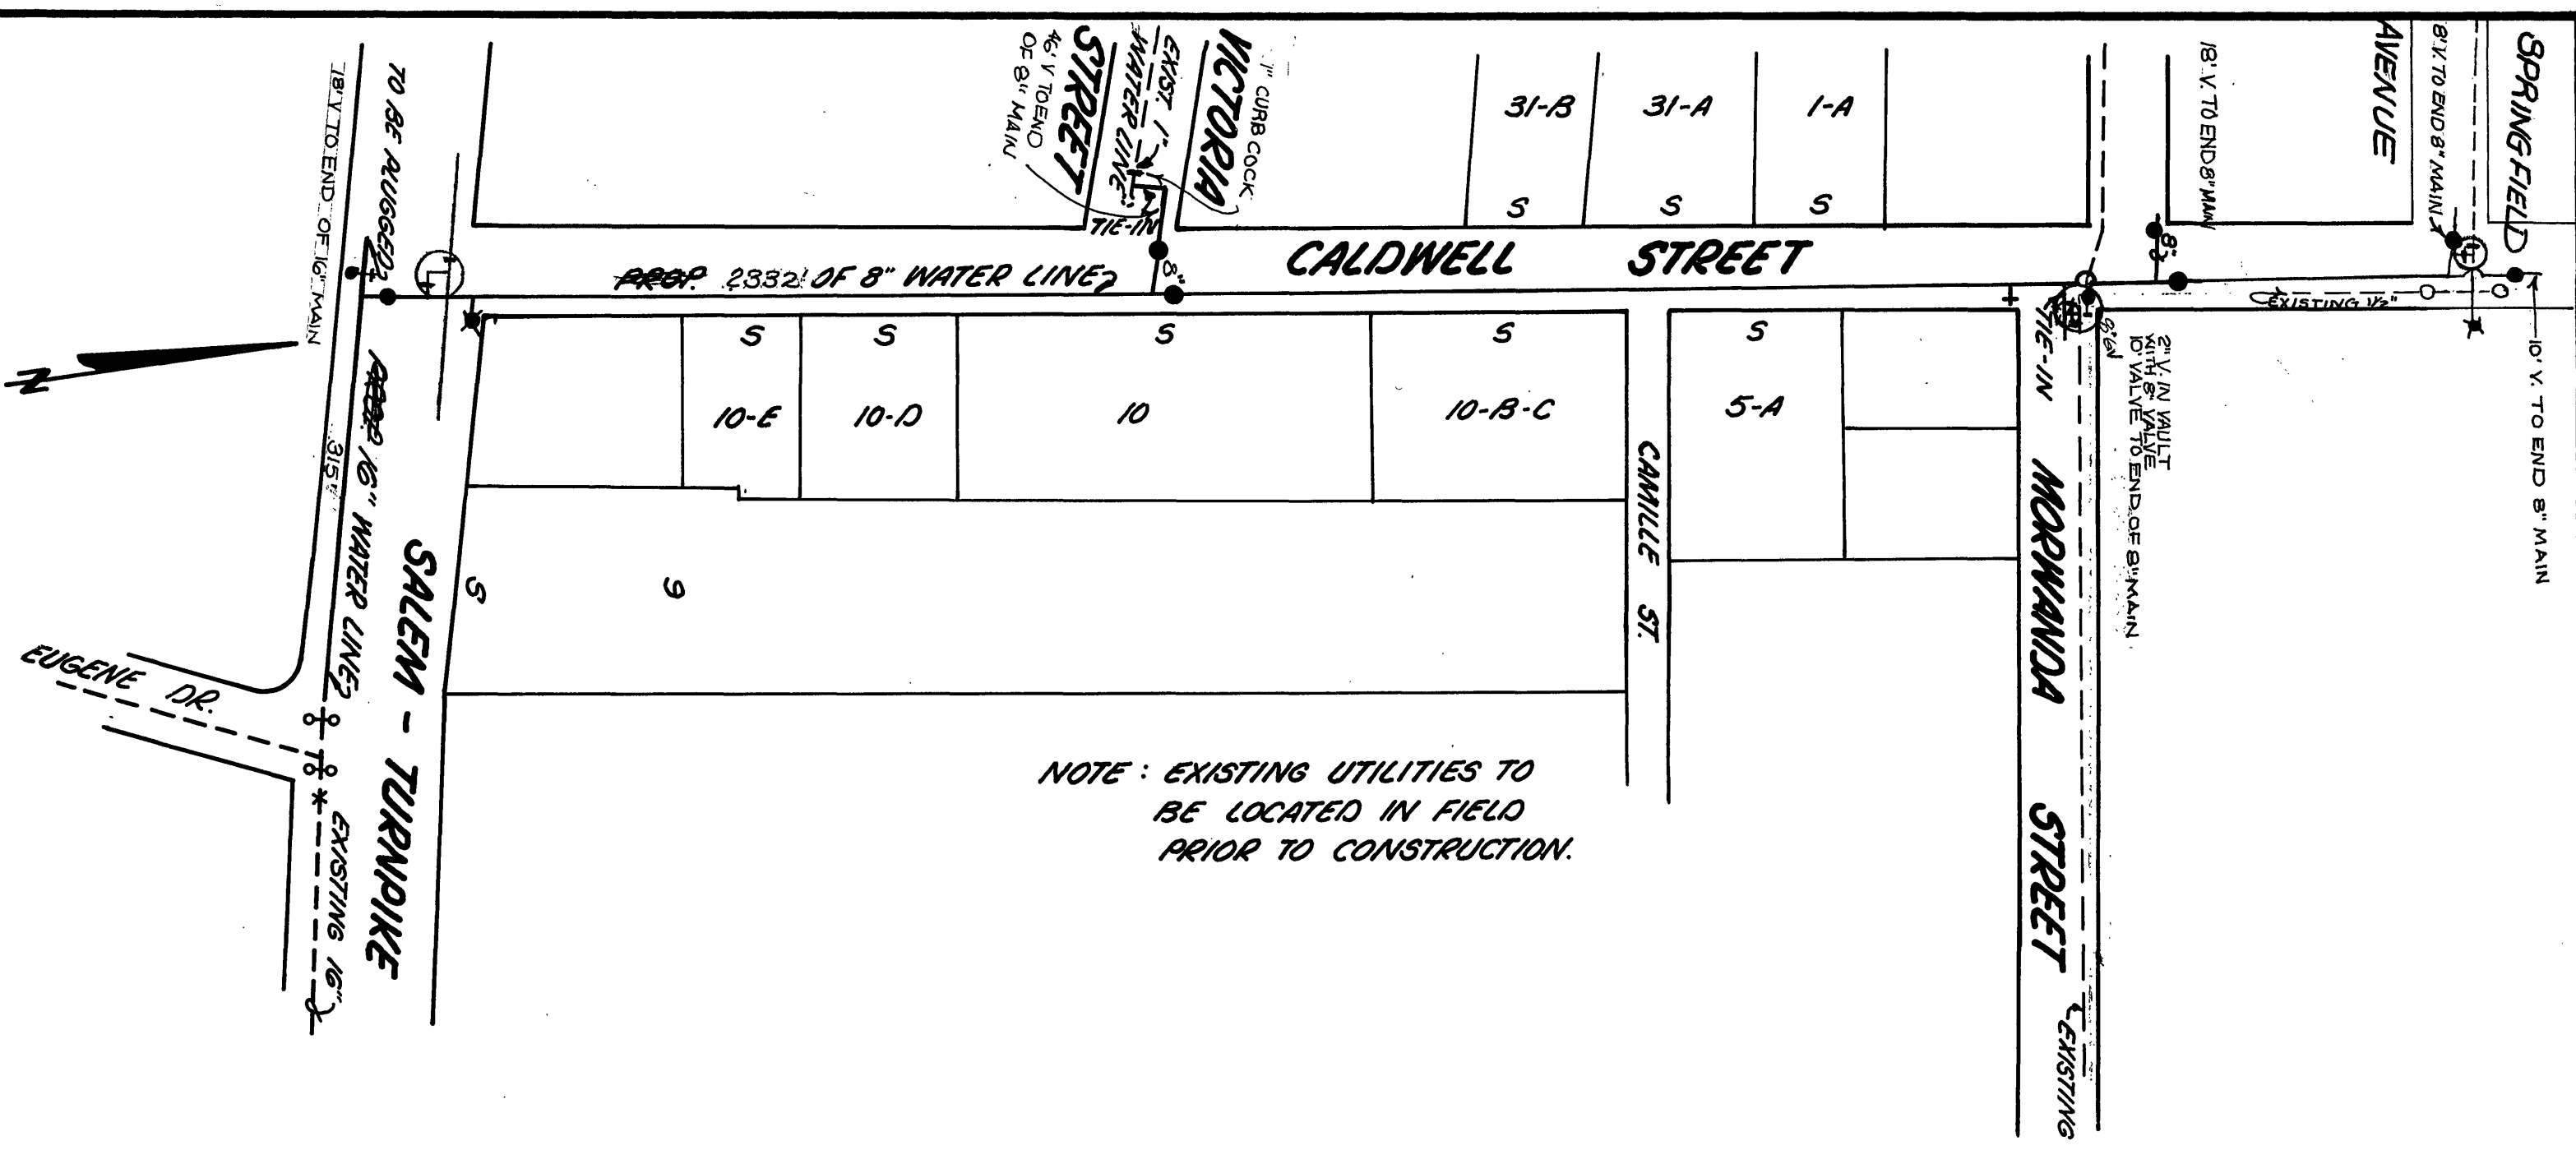

NOTE: EXISTING UTILITIES TO
BE LOCATED IN FIELD
PRIOR TO CONSTRUCTION.

DATE STARTED		6-14-76			
DATE COMP.		5-27-77			
FEET MAIN		SIZE	VALVE	VAULT	BOX
315'		16"	1	1	1#1
2332'		8"	8	8	
6'		2"	3	1	
F. H. COMP. <u>3</u>					
F. H. STUB ONLY _____					
SERV. INS. BY:					
MAIN INS. BY: <u>U. L. F.</u>					
NO. ¾" SERV. INS.					
CITY OR CO.					
DEPT. INSP. <u>J. W. M.</u>					

G. B. Br...
DIRECTOR UTILITIES & OPERATIONS

Thomas J. Brady
CITY ENGINEER OF ROANOKE, VA.

Richard D. Johnson
DIRECTOR OF PUBLIC WORKS

Lorain Mendenhall
AGENT FOR ROANOKE PLANNING COMM.

MAY 24, 1976
DATE

5-24-76
DATE

5-25-76
DATE

5-24-76
DATE

WATER DEPARTMENT
CITY OF ROANOKE, VA.
SCALE: 1"=100'
DRWN. BY: S.B.G., 5-24-76
CALDWELL ST.