


5 APP

CHICAGO BRIDGE & IRON COMPANY
BILL OF MATERIAL

BLUE PRINTS					
SET	DEPT.	PRT.	SET	DEPT.	PRT.
1	S.O.		7	INSP.	
2	T.S.		8	PACKED	
3	PLATE		9	STORE DM	
4	SHAPE		10	SHIPPED	
5	FITTER				
6	MACH'S			TOTAL	

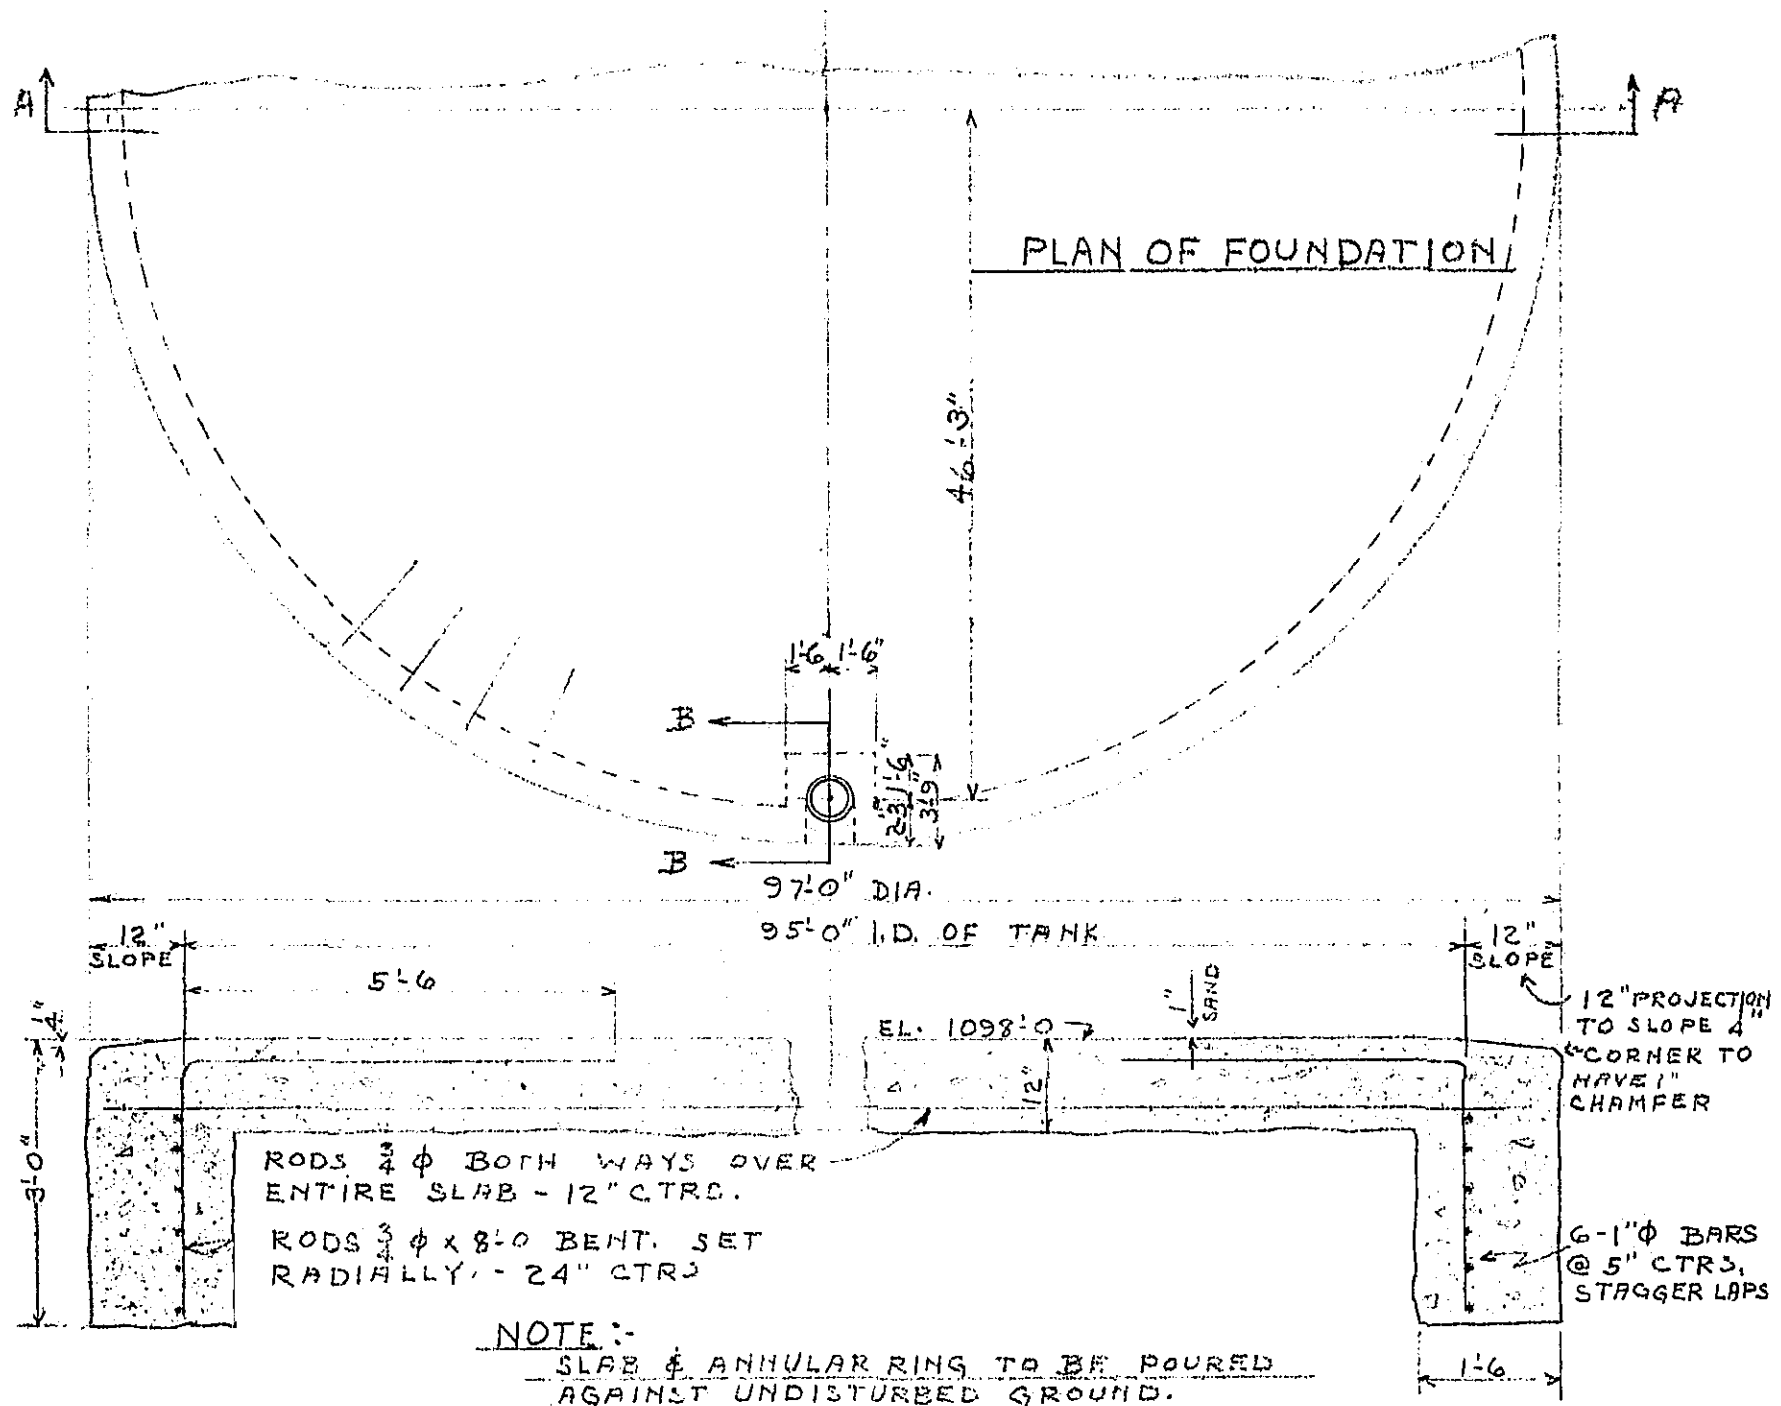

SECTION A-A


ENLARGED

NOTE CAREFULLY

BE SURE BOTTOM OF FOUNDATION IS UPON FIRM SOIL THAT WILL SAFELY SUSTAIN A LOAD OF 4000#/ ϕ . NO PART OF FOUNDATION SHOULD REST ON FILLED OR TAMPED SOIL. - BE SURE BOTTOM OF FOUNDATION IS BELOW FROST LINE. MAKE FOUNDATION DEEPER THAN PLAN INDICATES, IF NECESSARY, TO OBTAIN RESULTS EXPRESSED ABOVE. C.B. & I CO'S. GUARANTEE DOES NOT COVER THE SUPPORTING POWER OF THE SOIL, UNDER THE FOUNDATIONS.

MIXTURE - PER CUSTOMERS SPECIFICATIONS CONTRACT "J" PAGE #9

FOUNDATIONS TO BE BUILT BY RALPH E. MILLS CO. CONCRETE & REINFORCING STEEL FURNISHED BY RALPH E. MILLS CO.

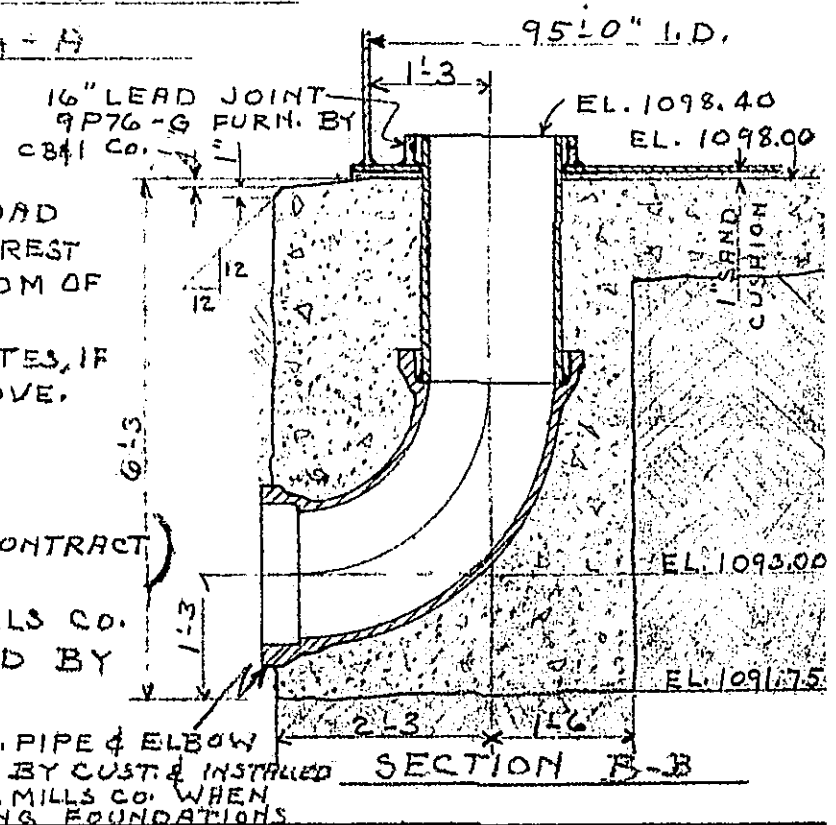

Carroll Ave Tank

4-4871	G	F	CITY OF ROANOKE, WATER DEPT.	TBR	H.L.S.	TBR	1/14/46
CONTRACT	FABRICATE AT	SHEET NO	CUSTOMER	MADE	CHK'D	BY	DATE LINE REVISIONS