


CARVING COVE RESERVOIR

SPILLWAY ELEV. 1170

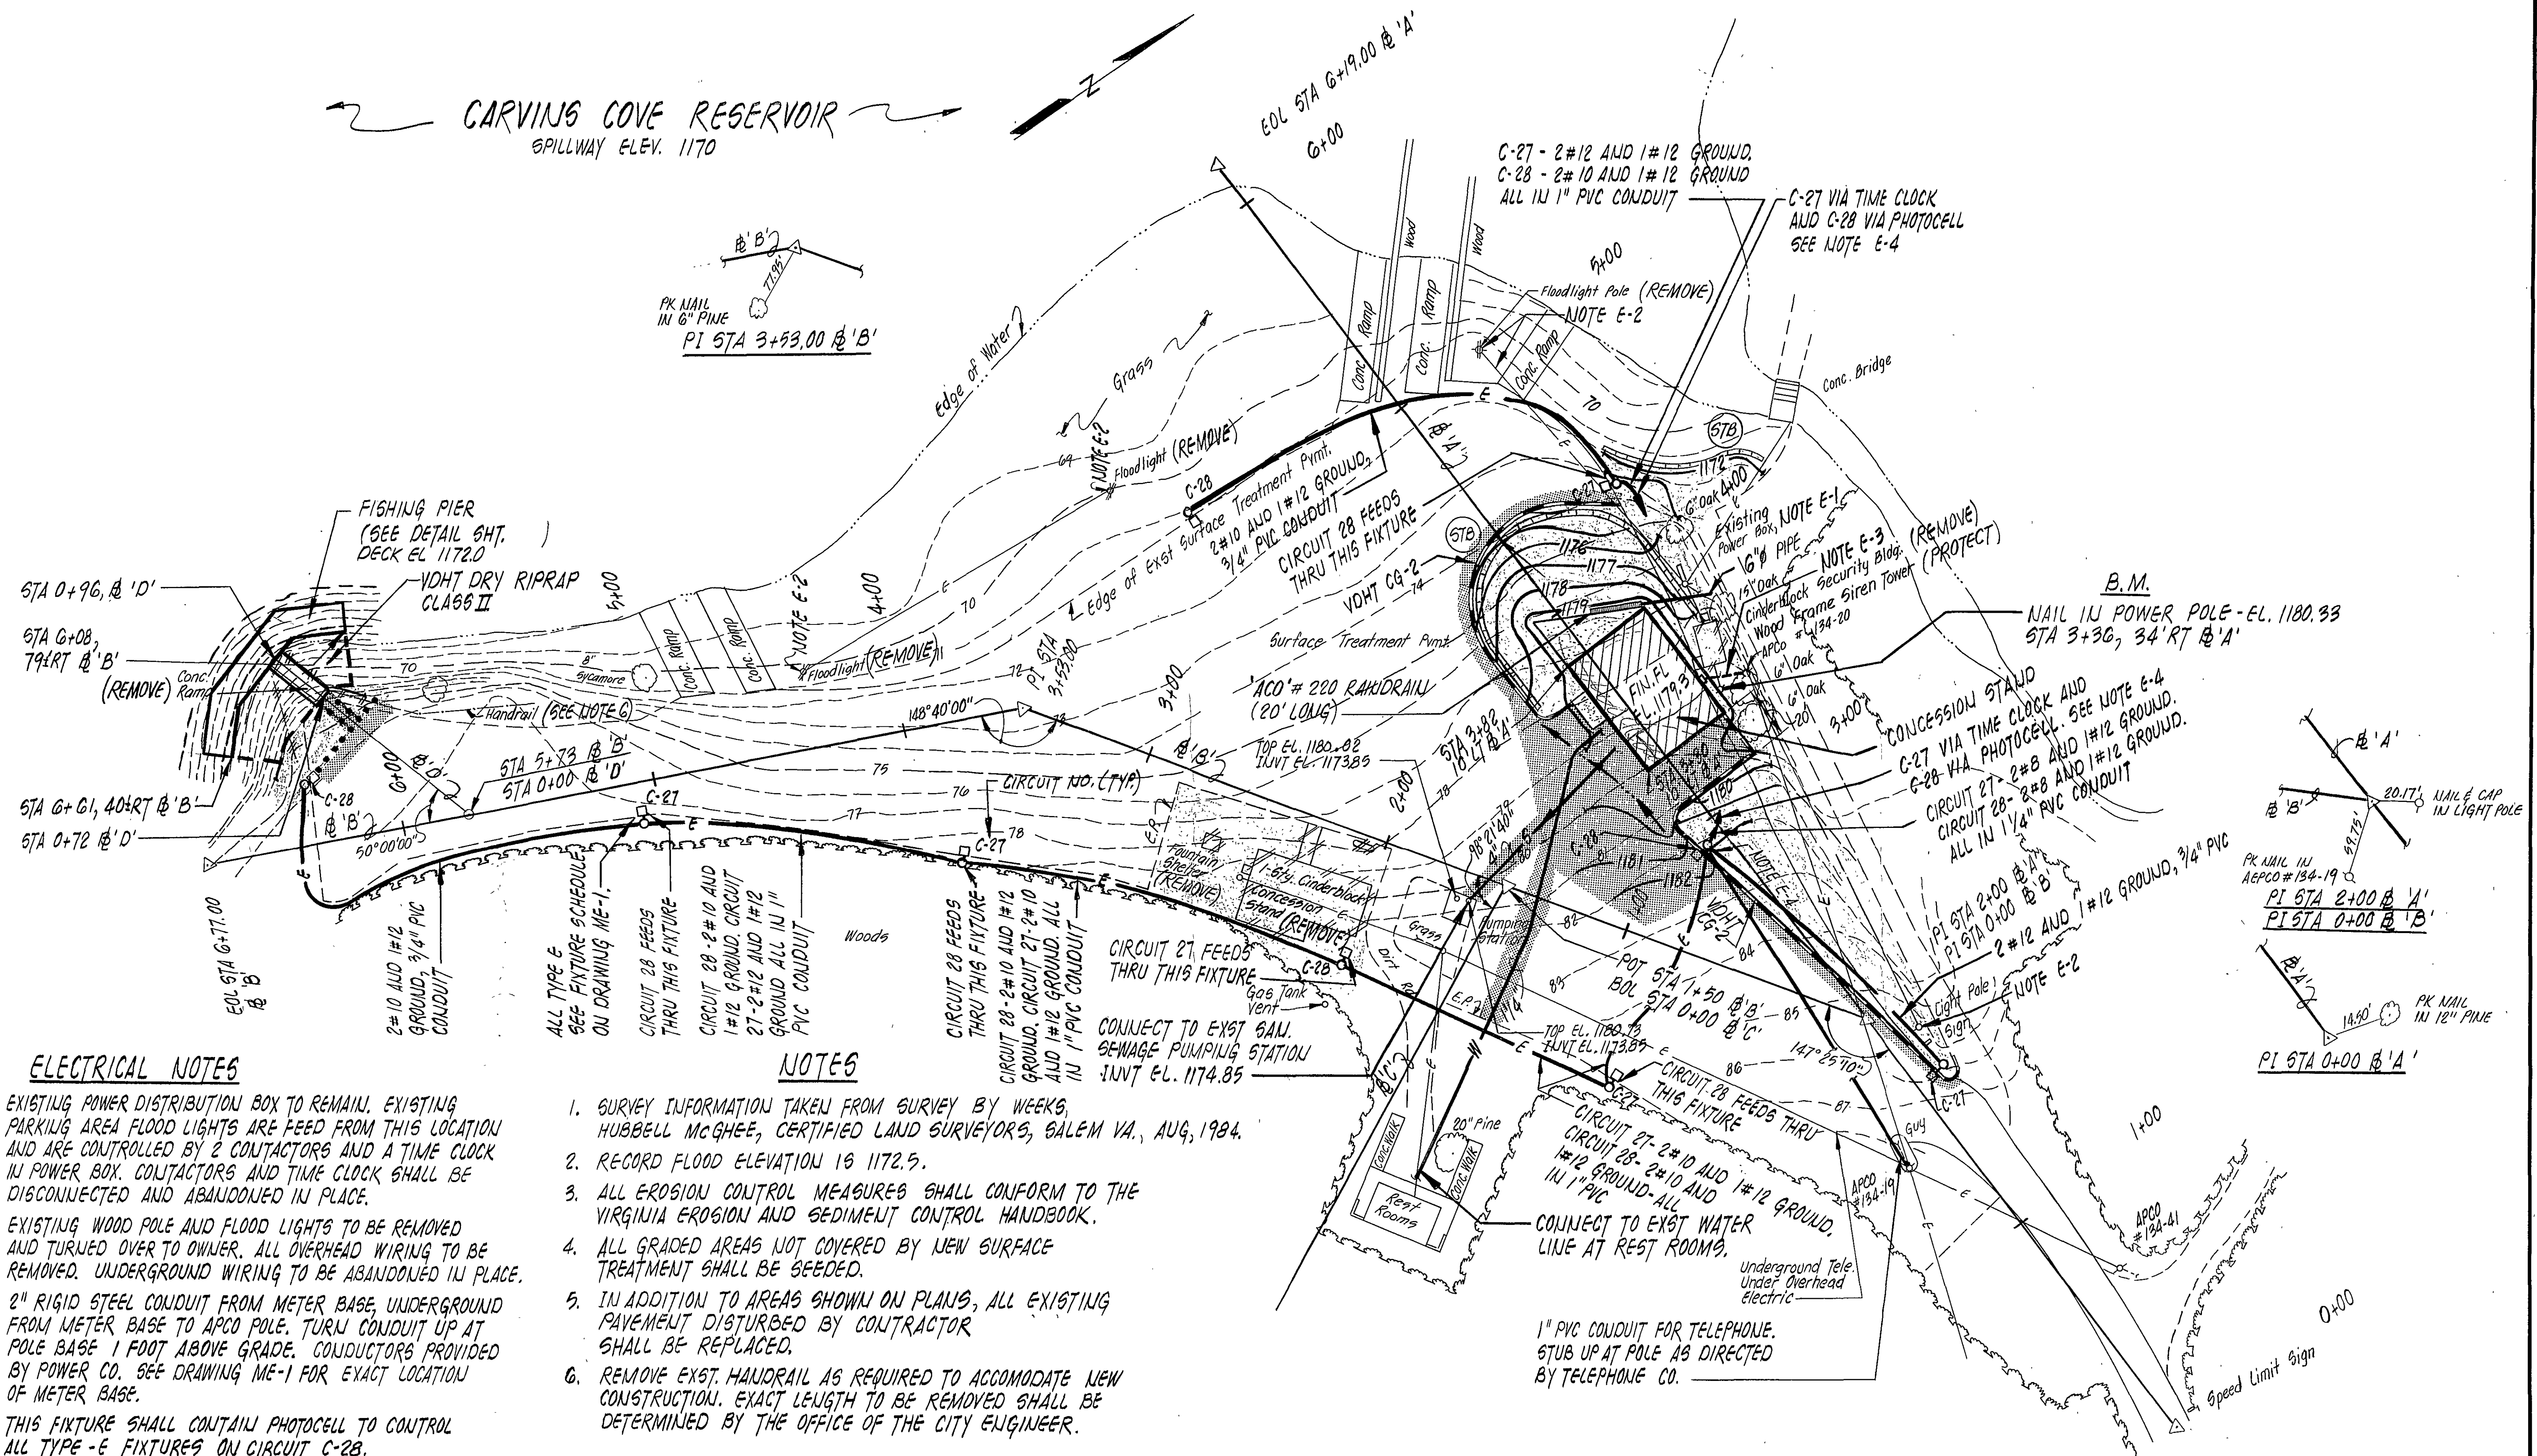

ELECTRICAL NOTES

- E-1 EXISTING POWER DISTRIBUTION BOX TO REMAIN. EXISTING PARKING AREA FLOOD LIGHTS ARE FEED FROM THIS LOCATION AND ARE CONTROLLED BY 2 CONTACTORS AND A TIME CLOCK IN POWER BOX. CONTACTORS AND TIME CLOCK SHALL BE DISCONNECTED AND ABANDONED IN PLACE.
- E-2 EXISTING WOOD POLE AND FLOOD LIGHTS TO BE REMOVED AND TURNED OVER TO OWNER. ALL OVERHEAD WIRING TO BE REMOVED. UNDERGROUND WIRING TO BE ABANDONED IN PLACE.
- E-3 2" RIGID STEEL CONDUIT FROM METER BASE UNDERGROUND FROM METER BASE TO APCO POLE. TURN CONDUIT UP AT POLE BASE 1 FOOT ABOVE GRADE. CONDUCTORS PROVIDED BY POWER CO. SEE DRAWING ME-1 FOR EXACT LOCATION OF METER BASE.
- E-4 THIS FIXTURE SHALL CONTAIN PHOTOCELL TO CONTROL ALL TYPE -E FIXTURES ON CIRCUIT C-28.

NOTES

1. SURVEY INFORMATION TAKEN FROM SURVEY BY WEEKS, HUBBELL MCGHEE, CERTIFIED LAND SURVEYORS, SALEM VA., AUG, 1984.
2. RECORD FLOOD ELEVATION IS 1172.5.
3. ALL EROSION CONTROL MEASURES SHALL CONFORM TO THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK.
4. ALL GRADED AREAS NOT COVERED BY NEW SURFACE TREATMENT SHALL BE SEEDED.
5. IN ADDITION TO AREAS SHOWN ON PLANS, ALL EXISTING PAVEMENT DISTURBED BY CONTRACTOR SHALL BE REPLACED.
6. REMOVE EXST. HANDRAIL AS REQUIRED TO ACCOMMODATE NEW CONSTRUCTION. EXACT LENGTH TO BE REMOVED SHALL BE DETERMINED BY THE OFFICE OF THE CITY ENGINEER.

NEW CONCESSION STAND NOT INSTALLED.
EXISTING CONCESSION LEFT IN PLACE.

REVISION	DATE	DESCRIPTION	BY	APP.
DESIGNED		CARVING COVE CONCESSION STAND & PIER		
DRAWN				
CHECKED				
APPROVED				
SUBMITTED				
Mattern & Craig CONSULTING ENGINEERS		SCALE: 1"= 30'	COMM. 480	
		DATE:	SHEET 3	