


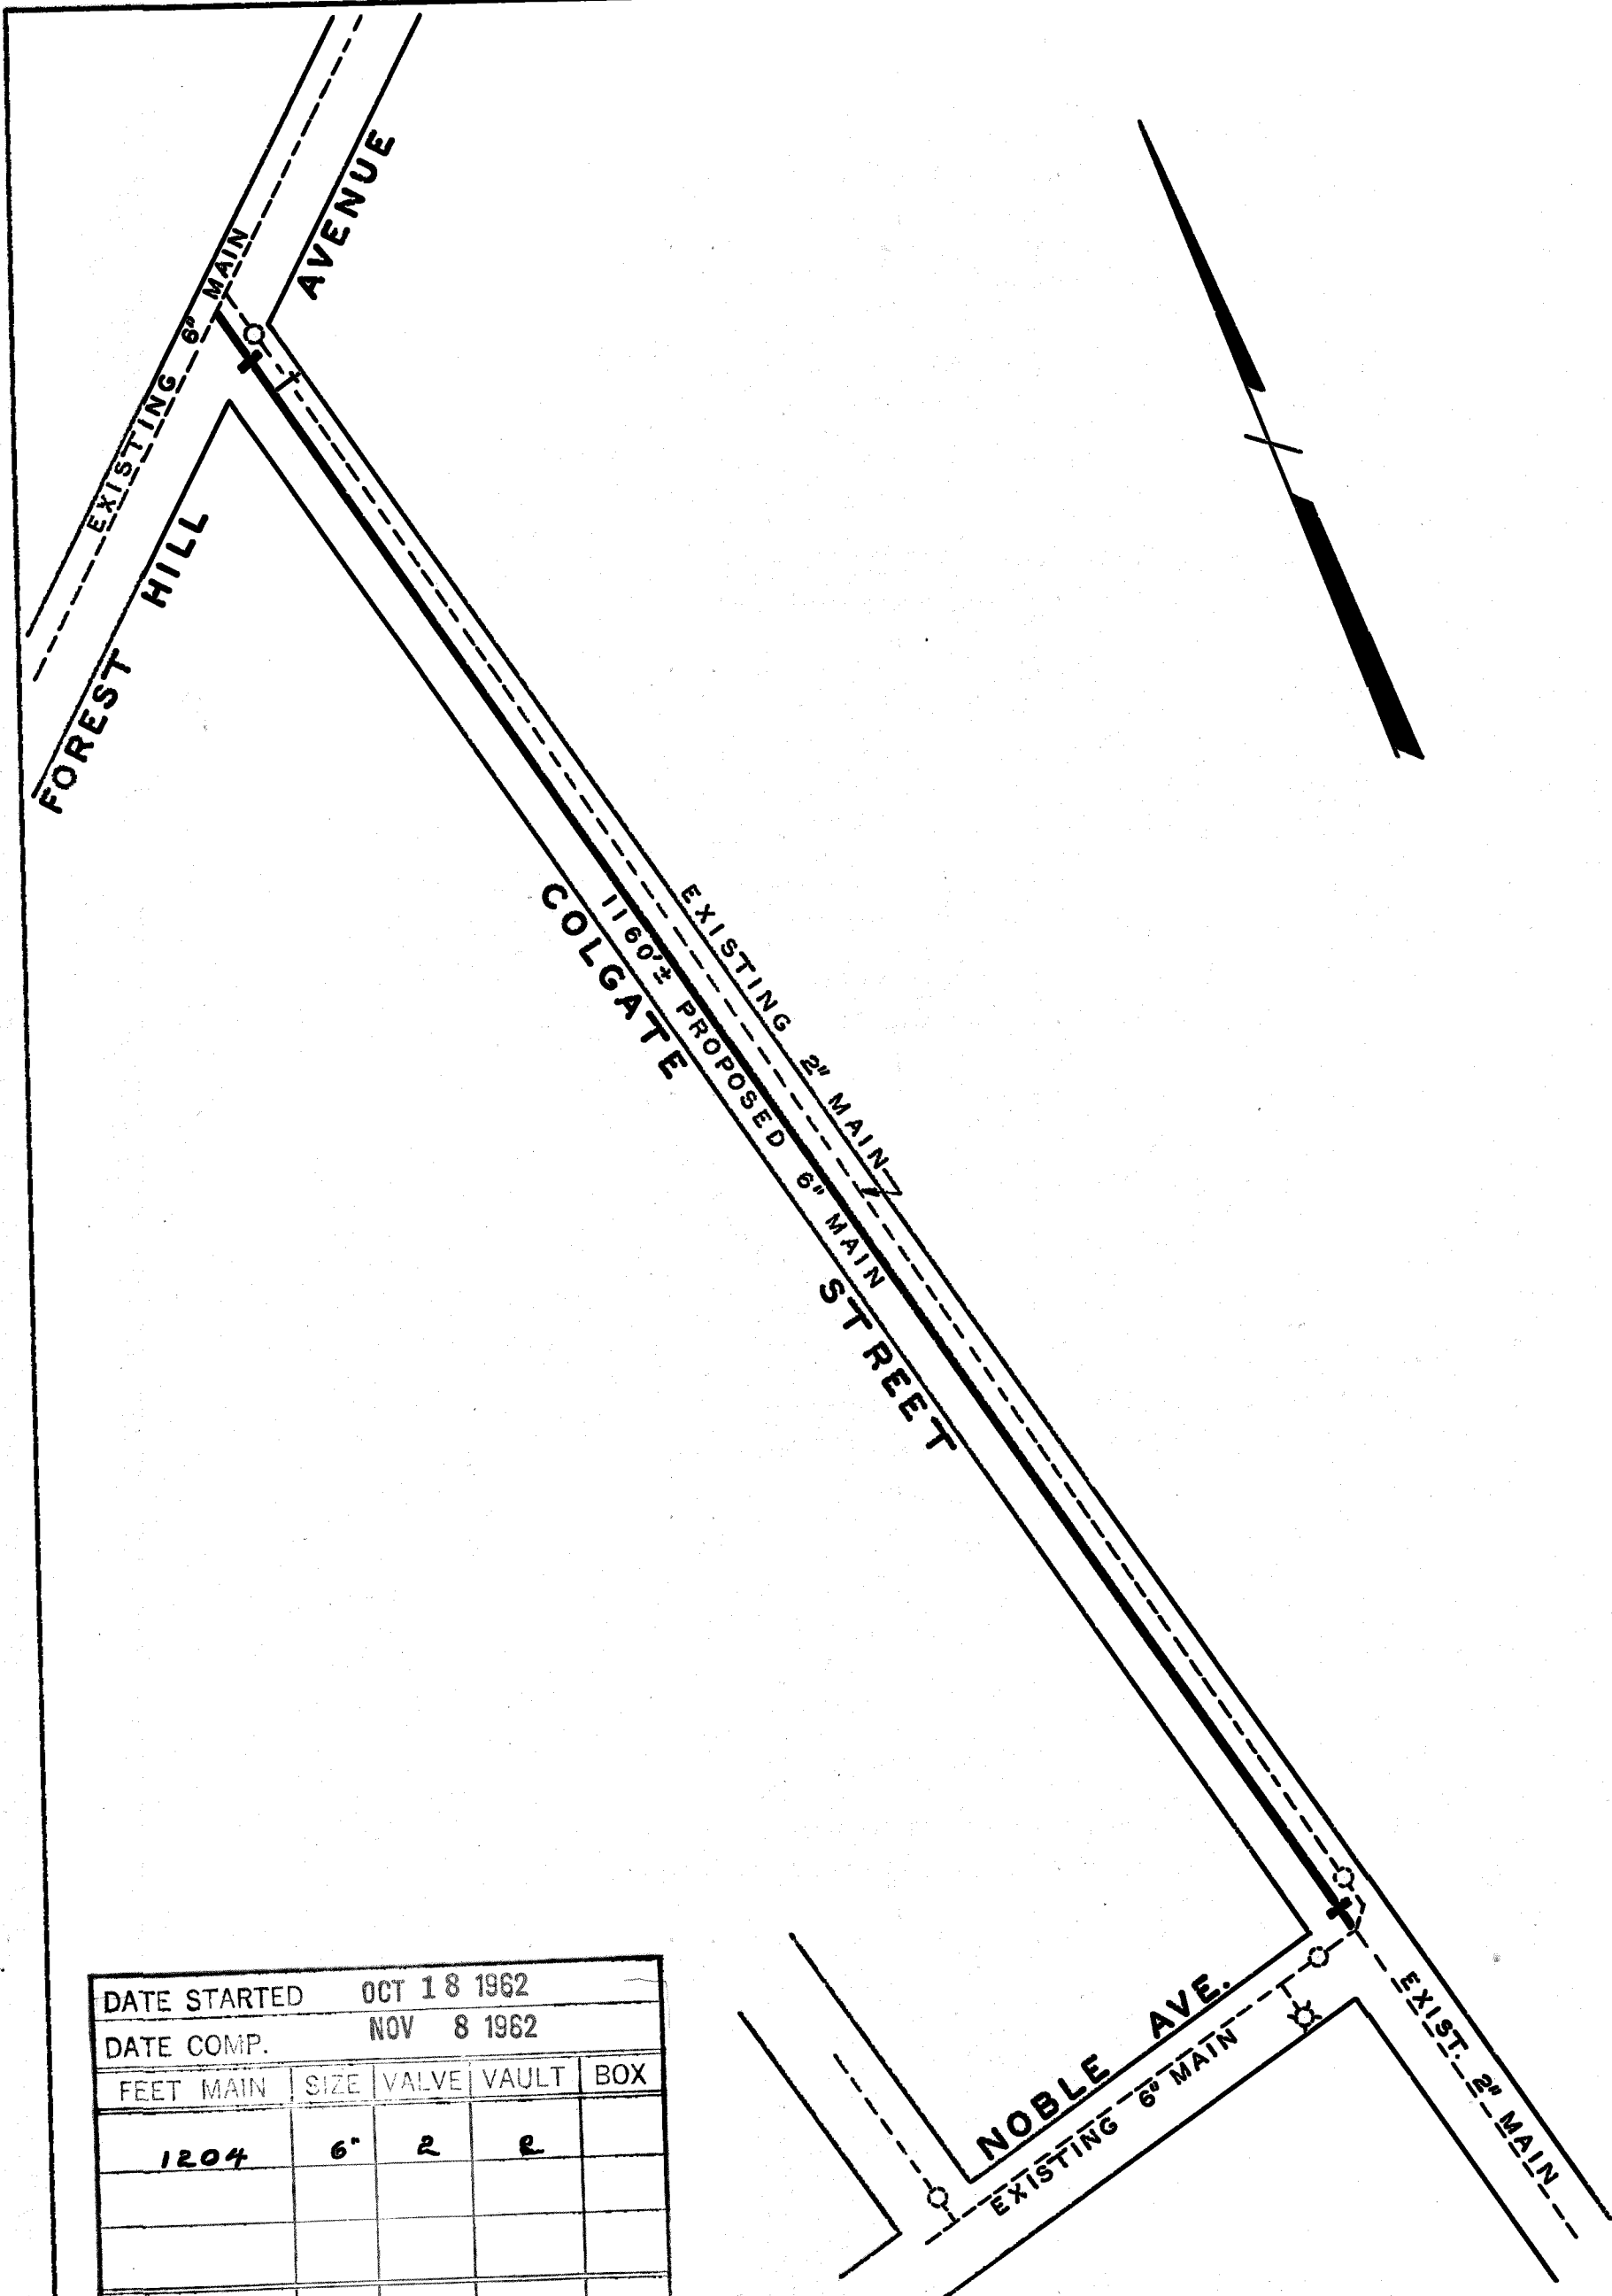

DATE STARTED		OCT 18 1962			
DATE COMP.		NOV 8 1962			
FEET MAIN	SIZE	VALVE	VAULT	BOX	
1204	6"	2	2		
F. H. COMP.					
F. H. STUB ONLY	1	6"	1	1	
SERV. INS. BY:					
MAINS INS. BY: <i>B.R.H.</i>					
NO. 3/4" SERV. INS.					
CITY OR CO. <i>CITY</i>					
DEPT. INSP.					

WATER DEPARTMENT
 CITY OF ROANOKE, VA.
 COLGATE STREET N.E.
 SCALE - 1" = 100'
 DRAWN BY N.H.C. OCT. 17, 1962