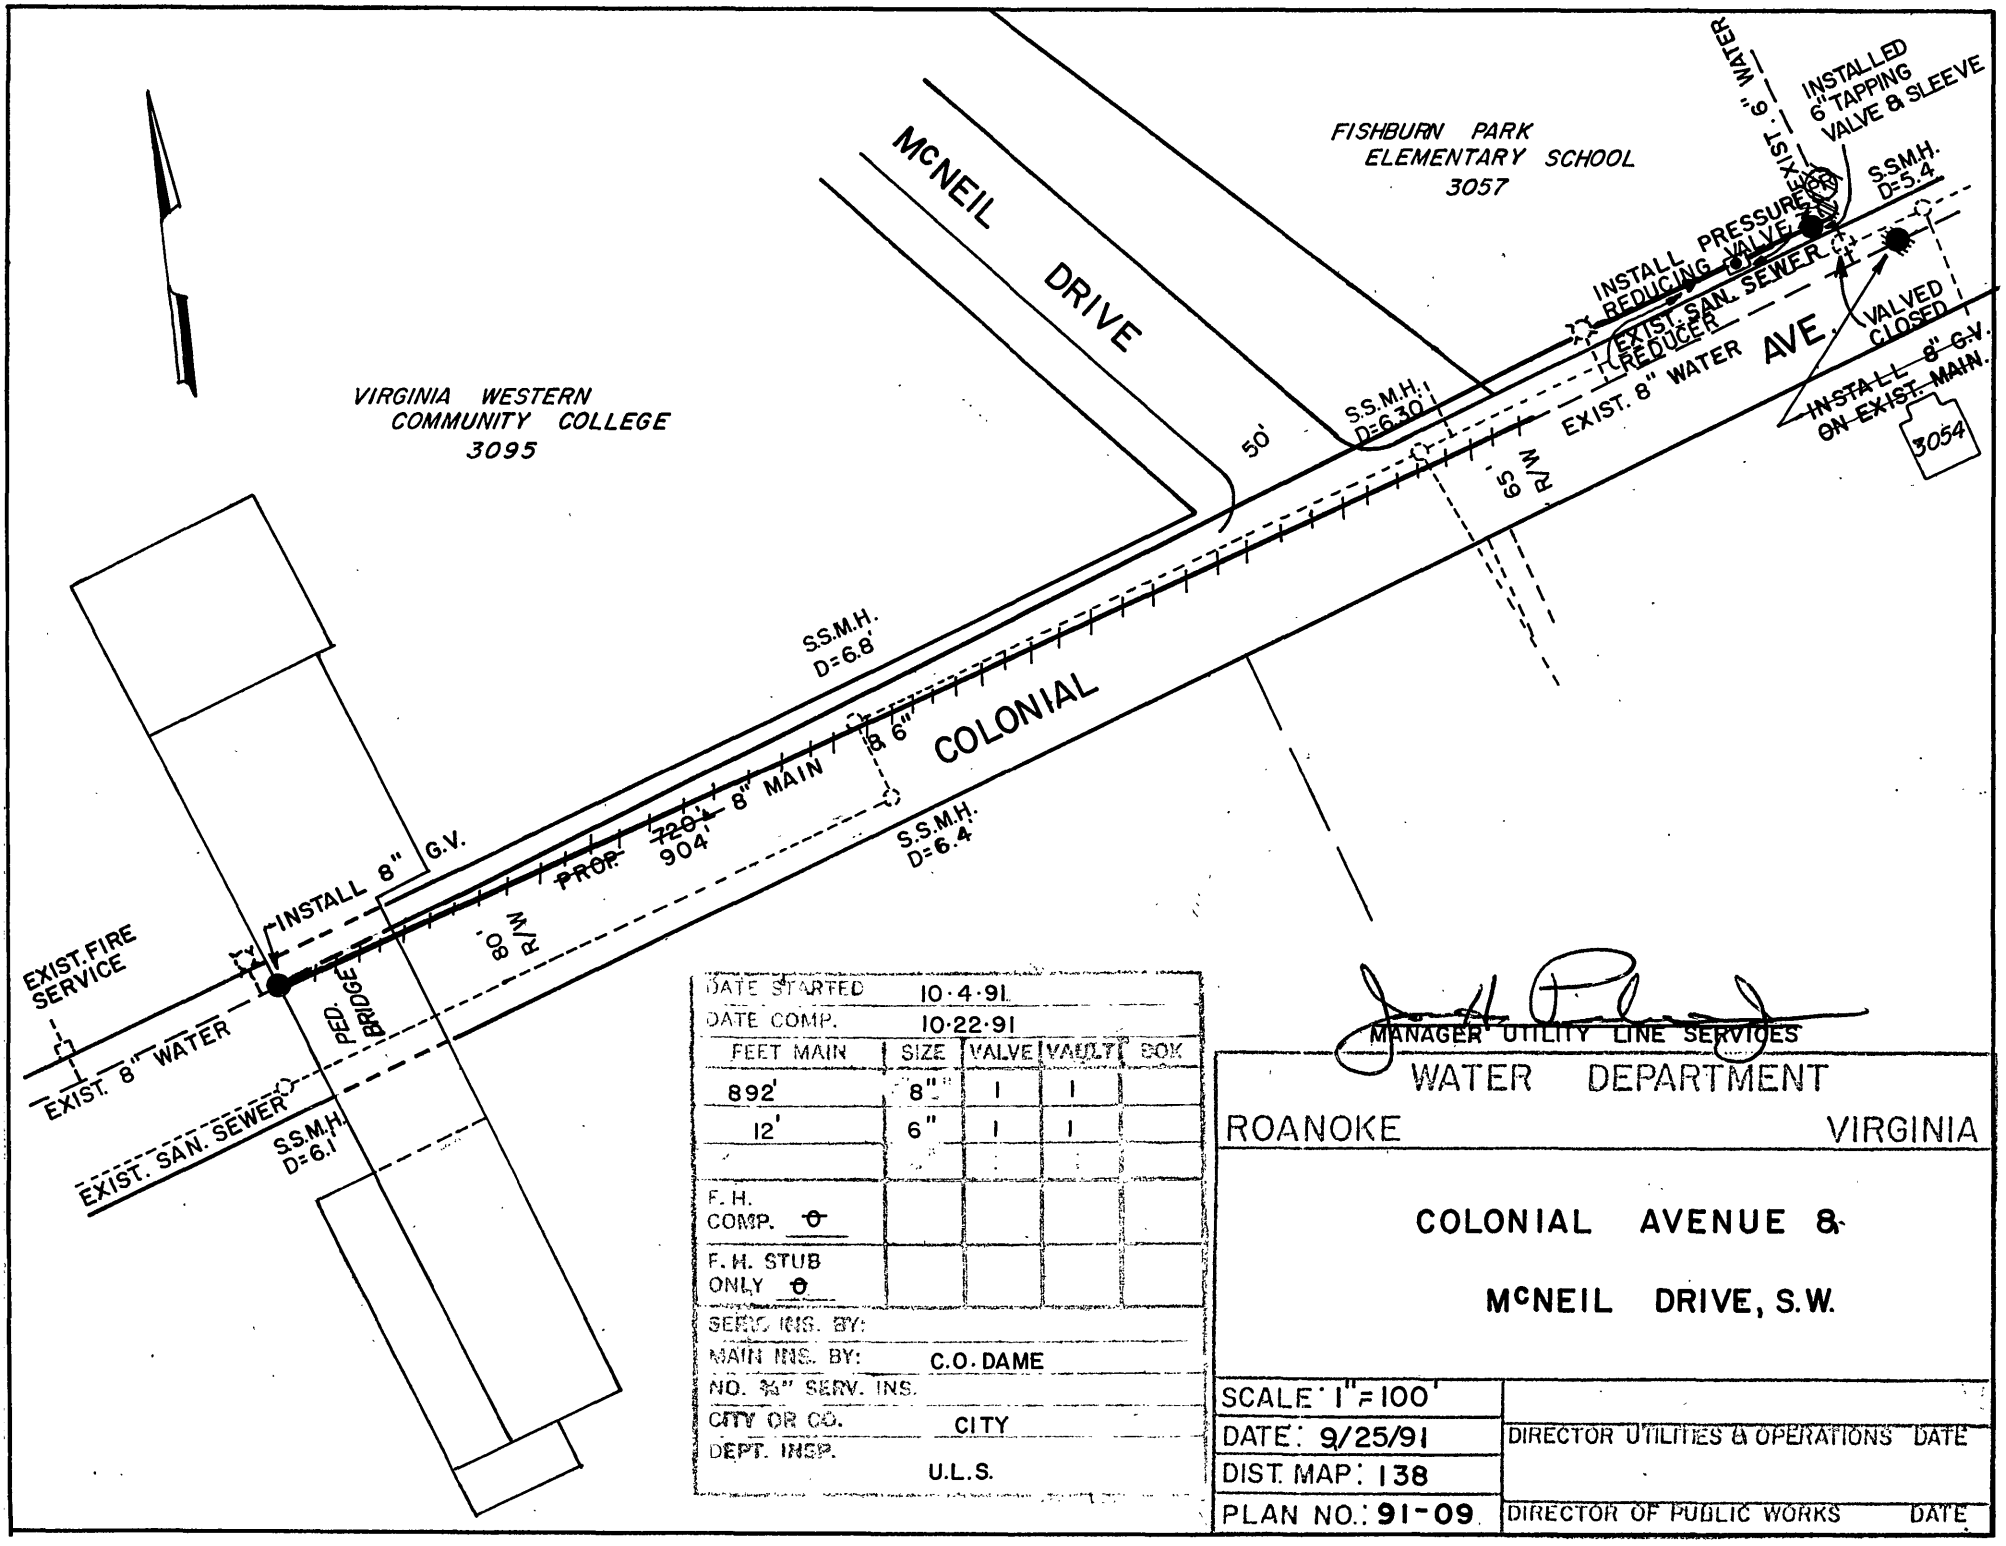

DATE STARTED	10-4-91			
DATE COMP.	10-22-91			
FEET MAIN	SIZE	VALVE	VAULT	BOX
892'	8"	1	1	
12'	6"	1	1	
F. H. COMP.				
F. H. STUB ONLY				

SERV. INS. BY:
MAIN INS. BY: C.O. DAME
NO. ¾" SERV. INS.
CITY OR CO. CITY
DEPT. INSP. U.L.S.

MANAGER UTILITY LINE SERVICES

WATER DEPARTMENT

ROANOKE VIRGINIA

COLONIAL AVENUE & McNEIL DRIVE, S.W.

SCALE: 1" = 100'

DATE: 9/25/91

DIST. MAP: 138

PLAN NO.: 91-09

DIRECTOR UTILITIES & OPERATIONS DATE

DIRECTOR OF PUBLIC WORKS DATE