

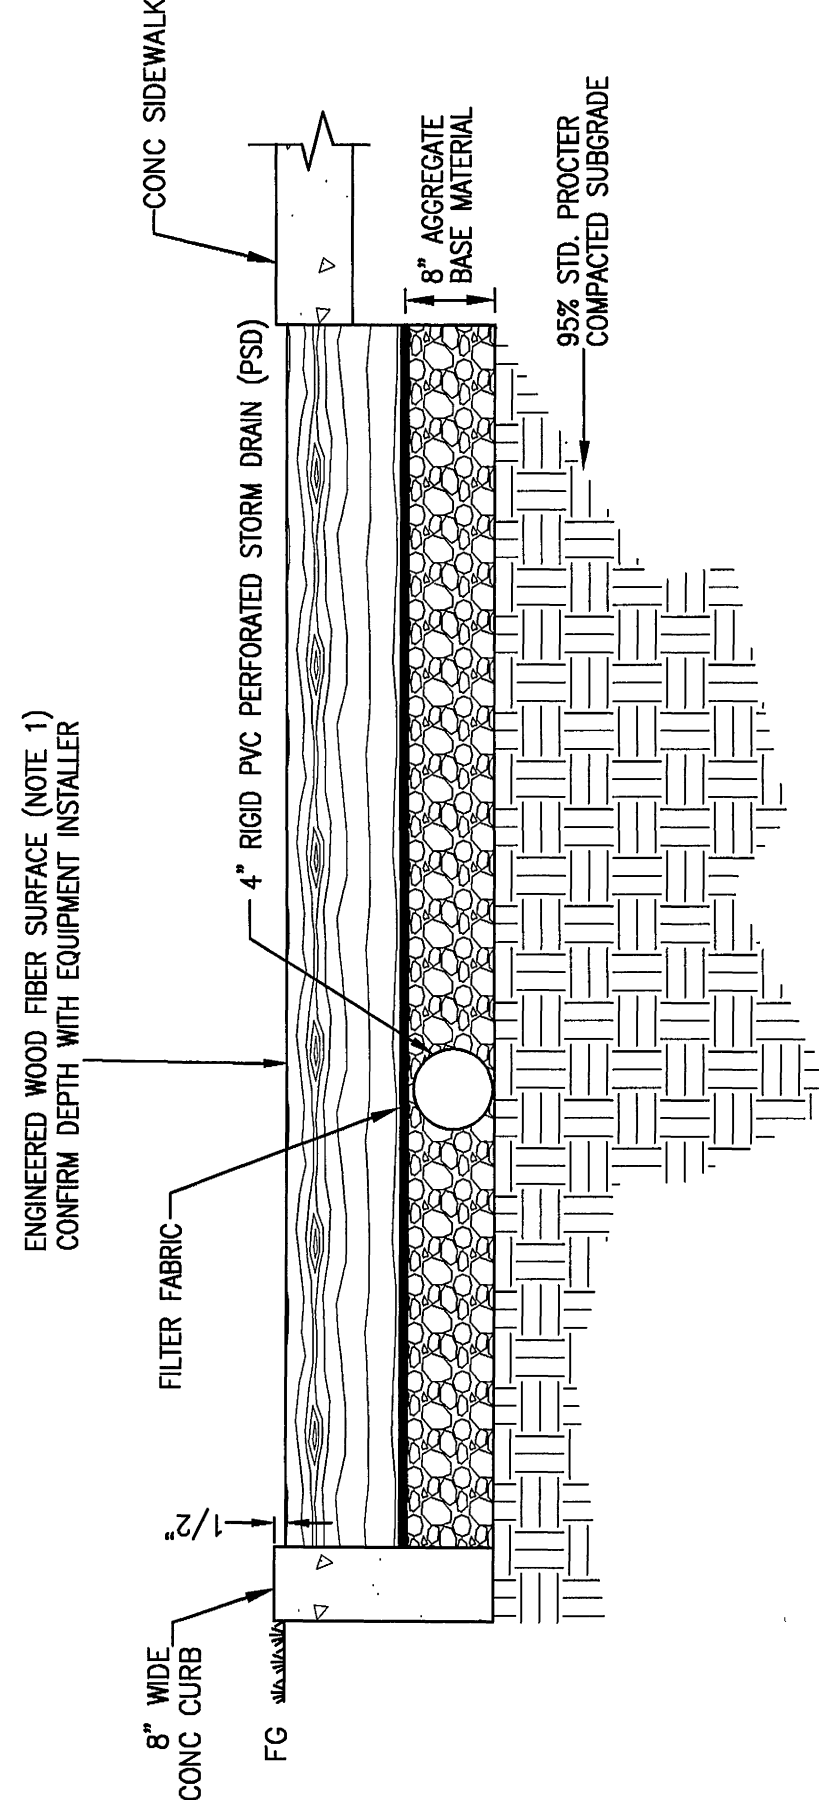
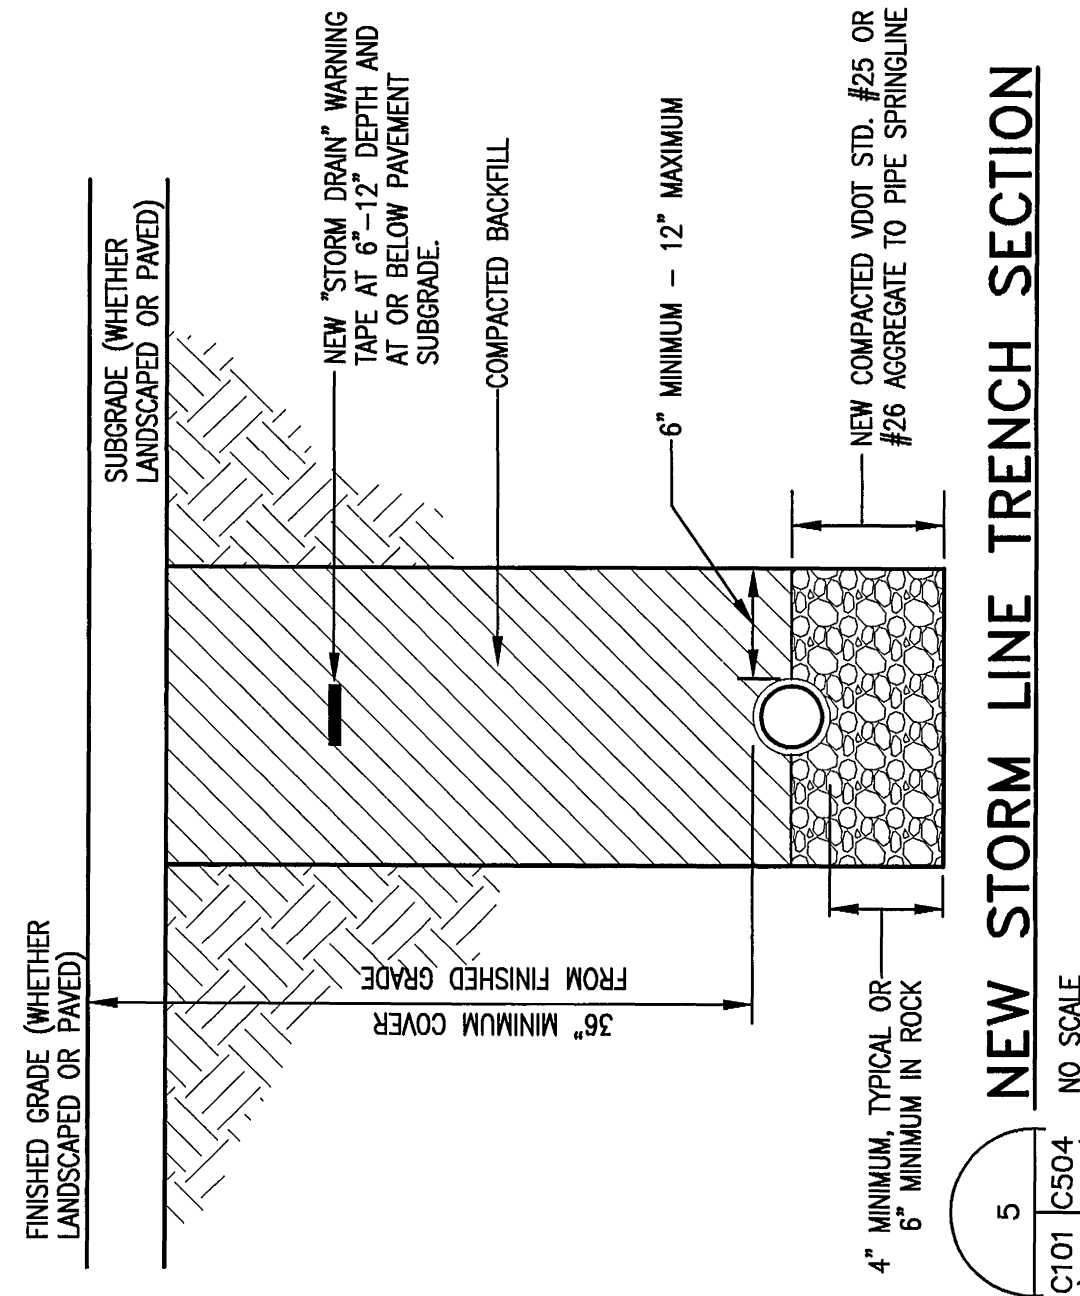
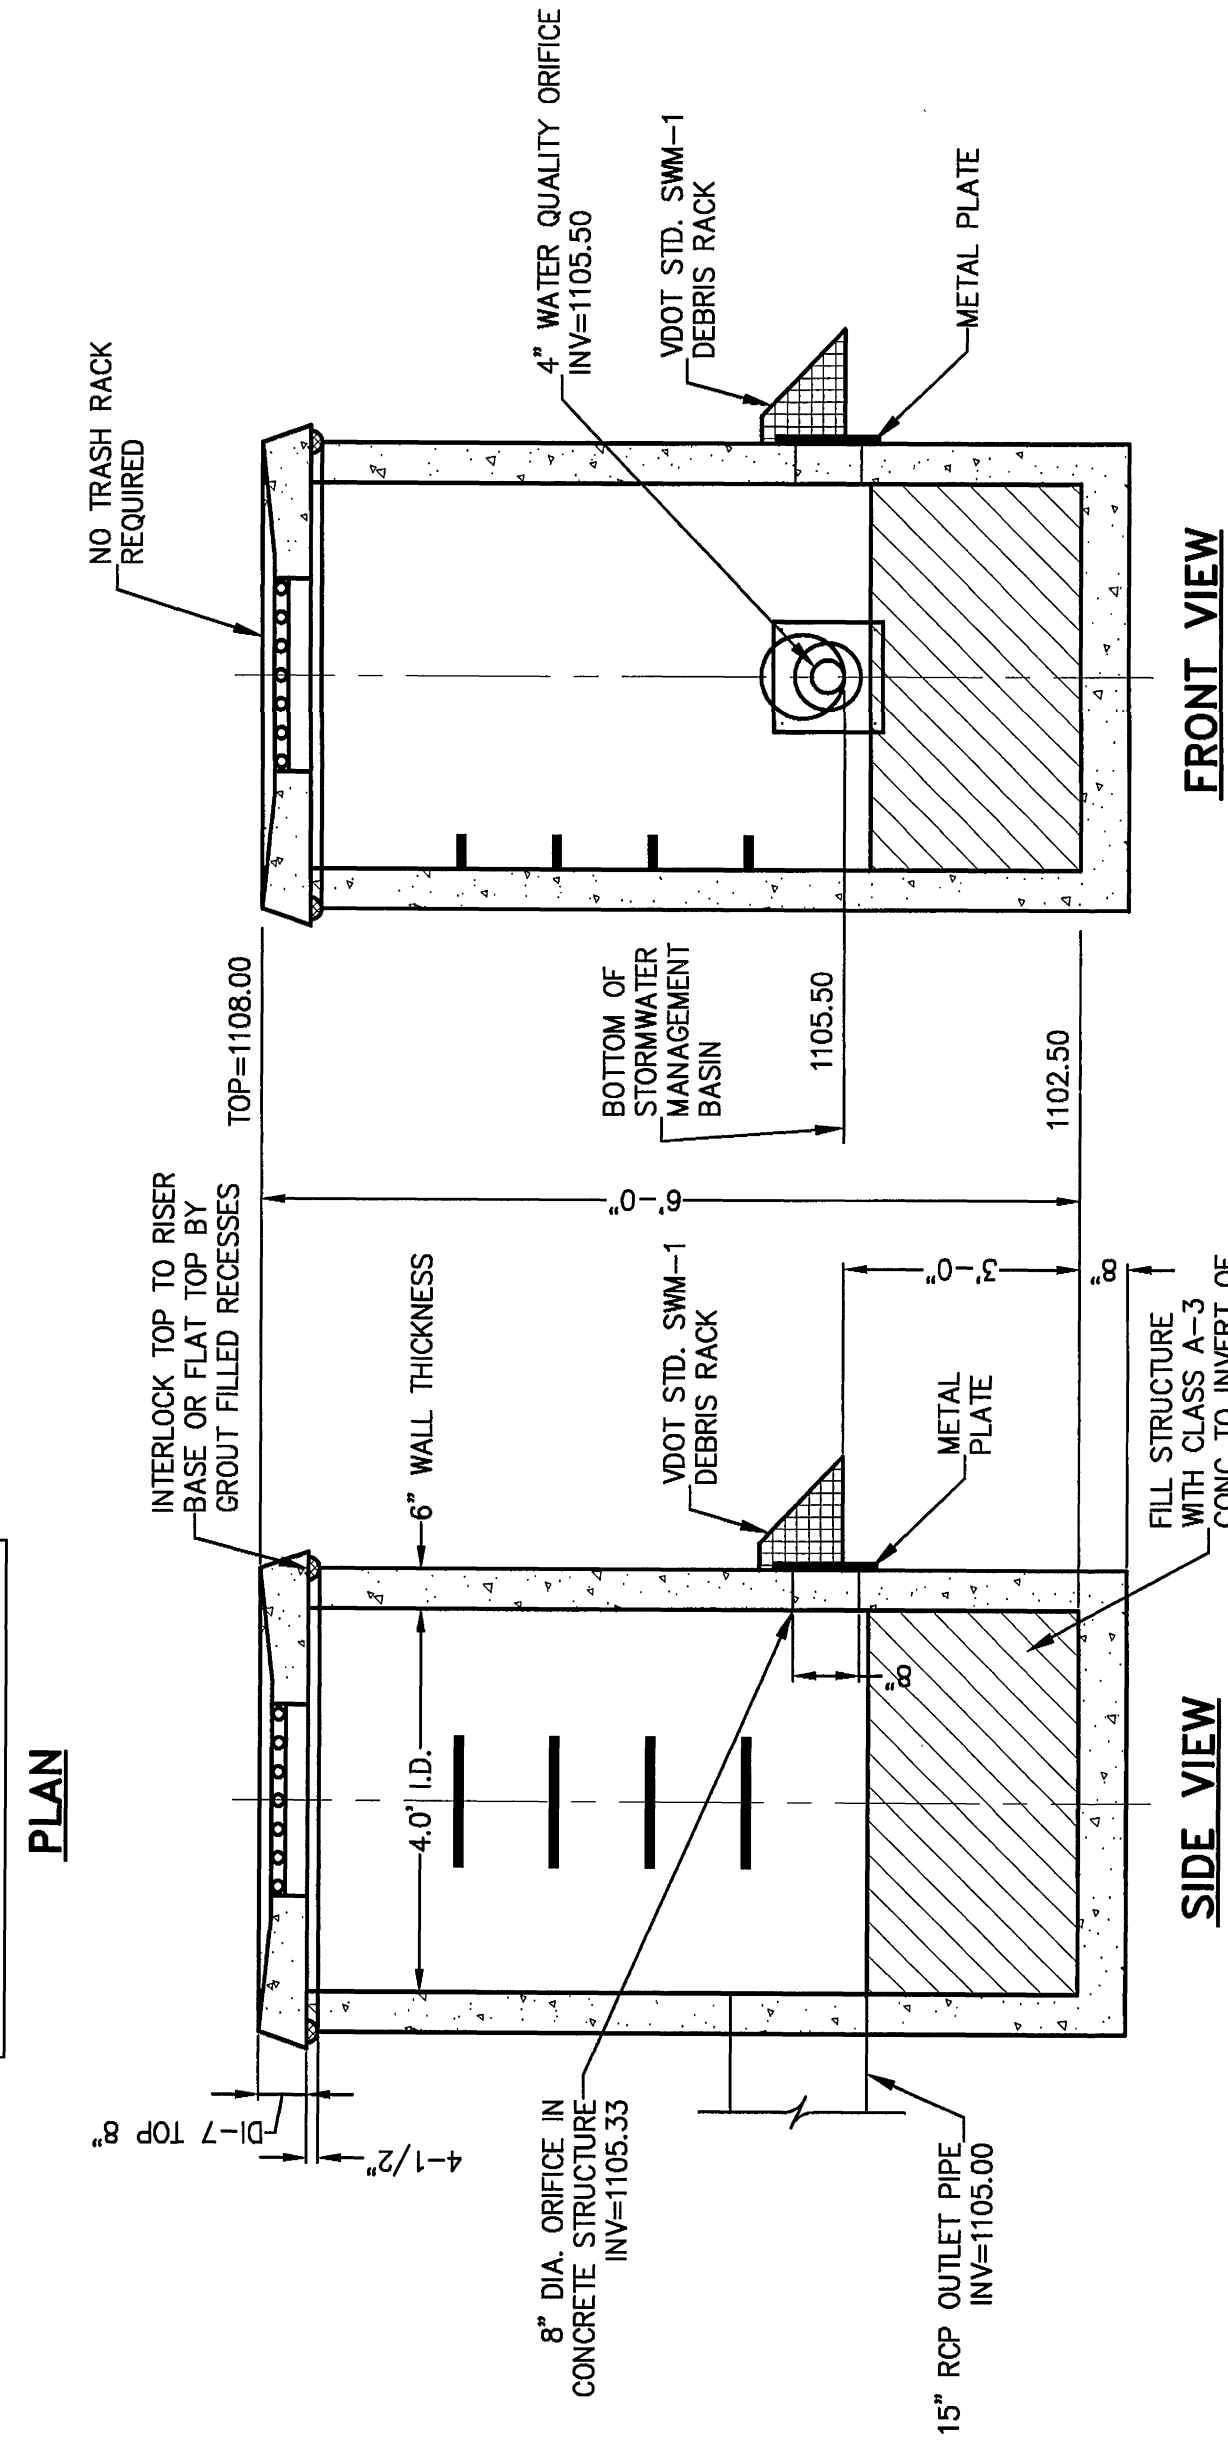


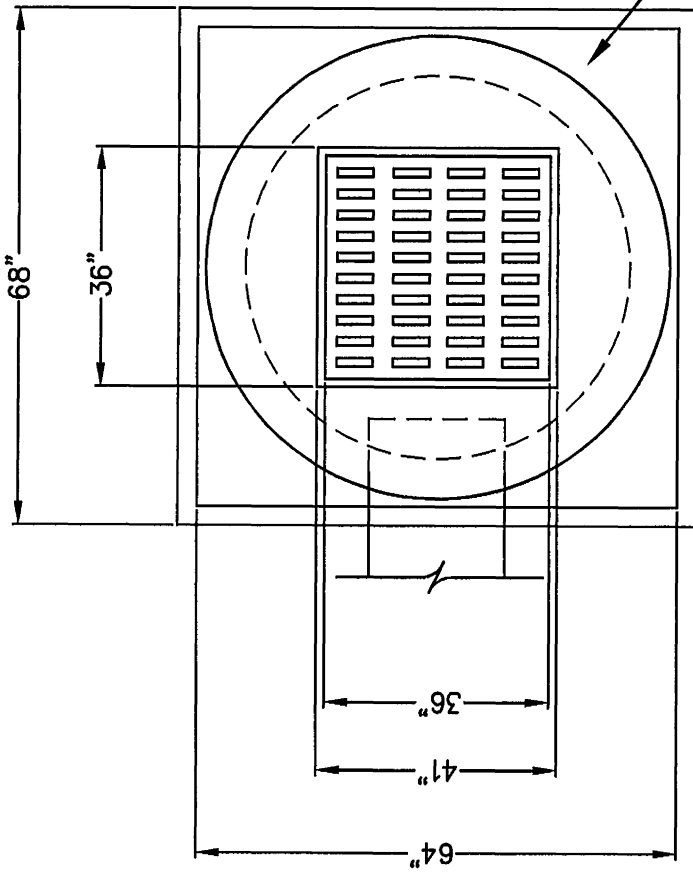





NOTE 1 - EWF SHALL BE PROVIDED AND INSTALLED BY OTHERS.

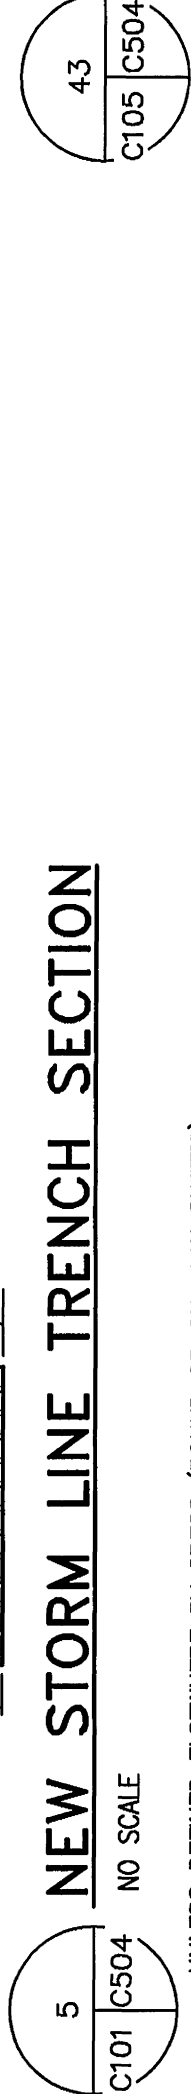


NEW STORM LINE TRENCH SECTION

UNLESS DEFINED ELSEWHERE BY SPECS (BOUND OR ON PLAN SHEETS), BACKFILL AND SELECT BACKFILL SHALL BE AS APPROVED BY THE GEOTECHNICAL ENGINEER.

	SWALE	LEFT SIDE		RIGHT SIDE		DEPTH		CHANNEL SLOPE	
		SLOPE (MAX)	2:1	SLOPE (MAX)	2:1	(MIN)	(MAX)	(MIN)	(MAX)
A		2:1	2:1	2:1	2:1	1.50'	5.0%	2.25%	2.25%
B		2:1	2:1	2:1	2:1	1.50'	5.0%	2.00%	2.00%
C		2:1	2:1	2:1	2:1	2.00'	2.5%	2.00%	2.00%

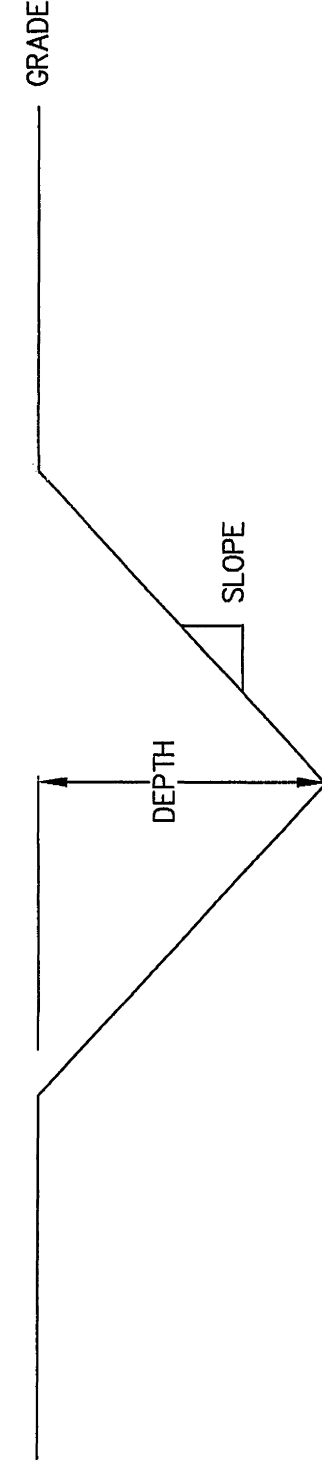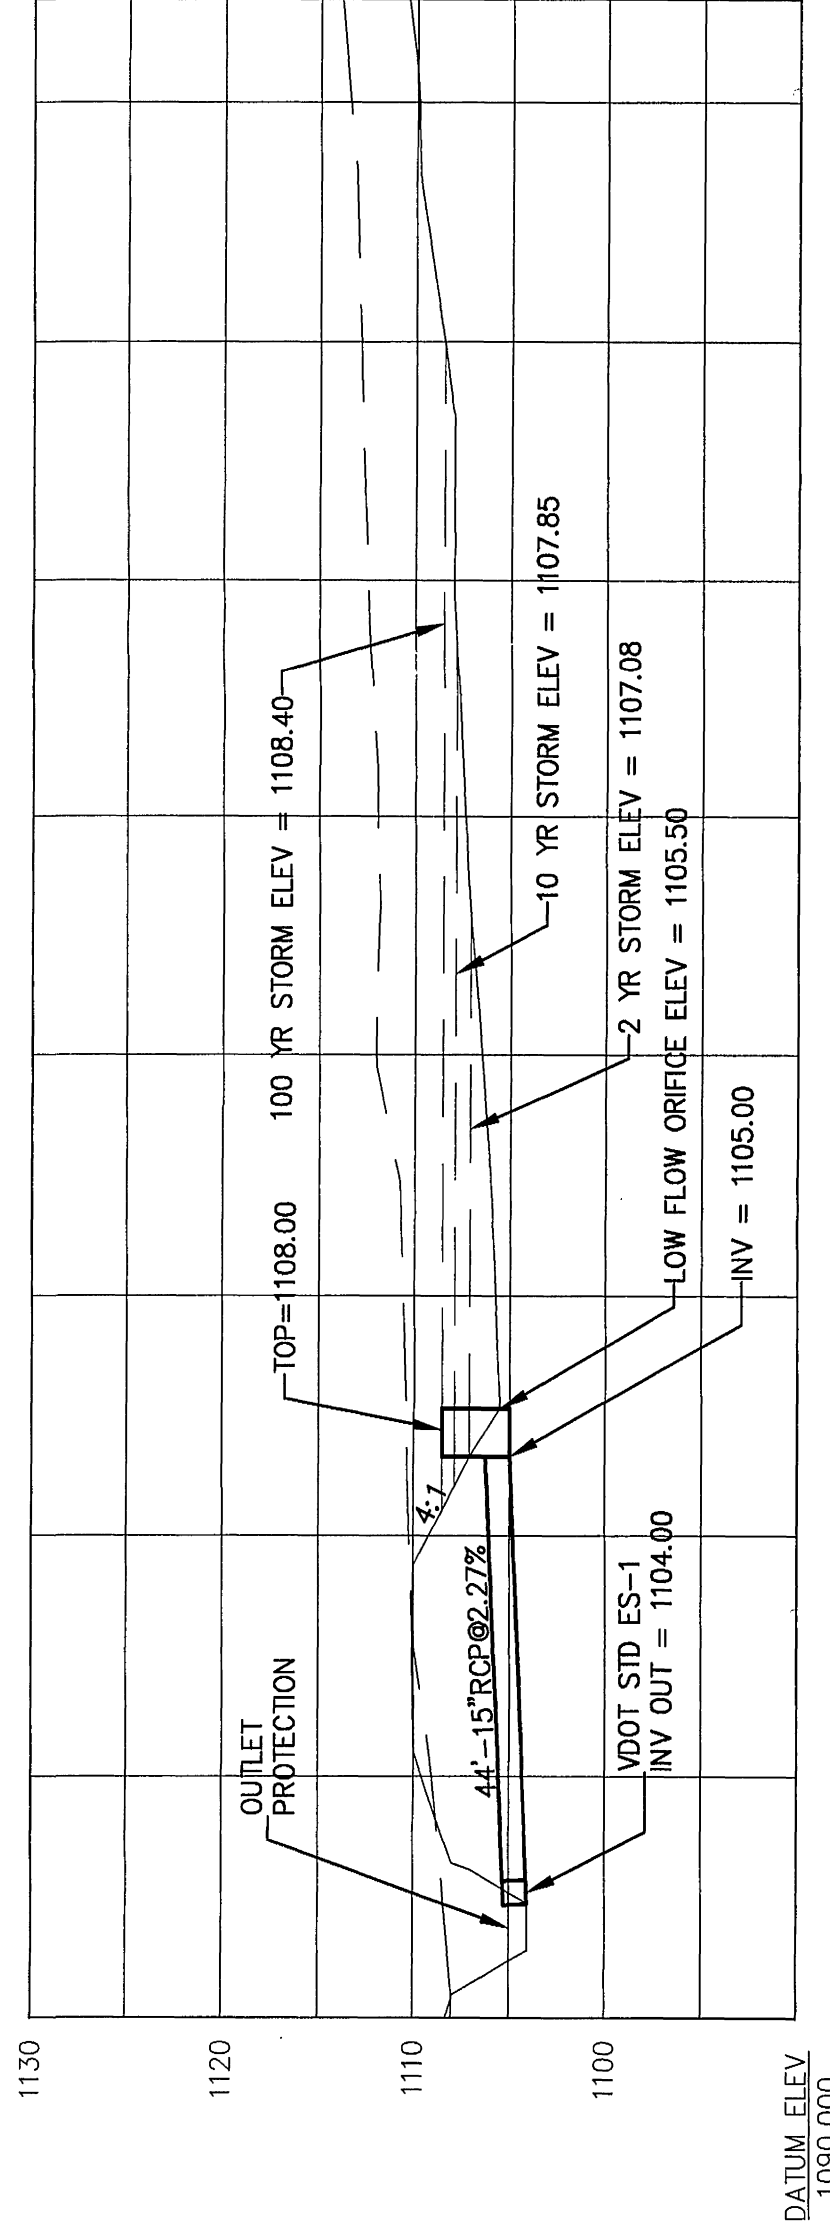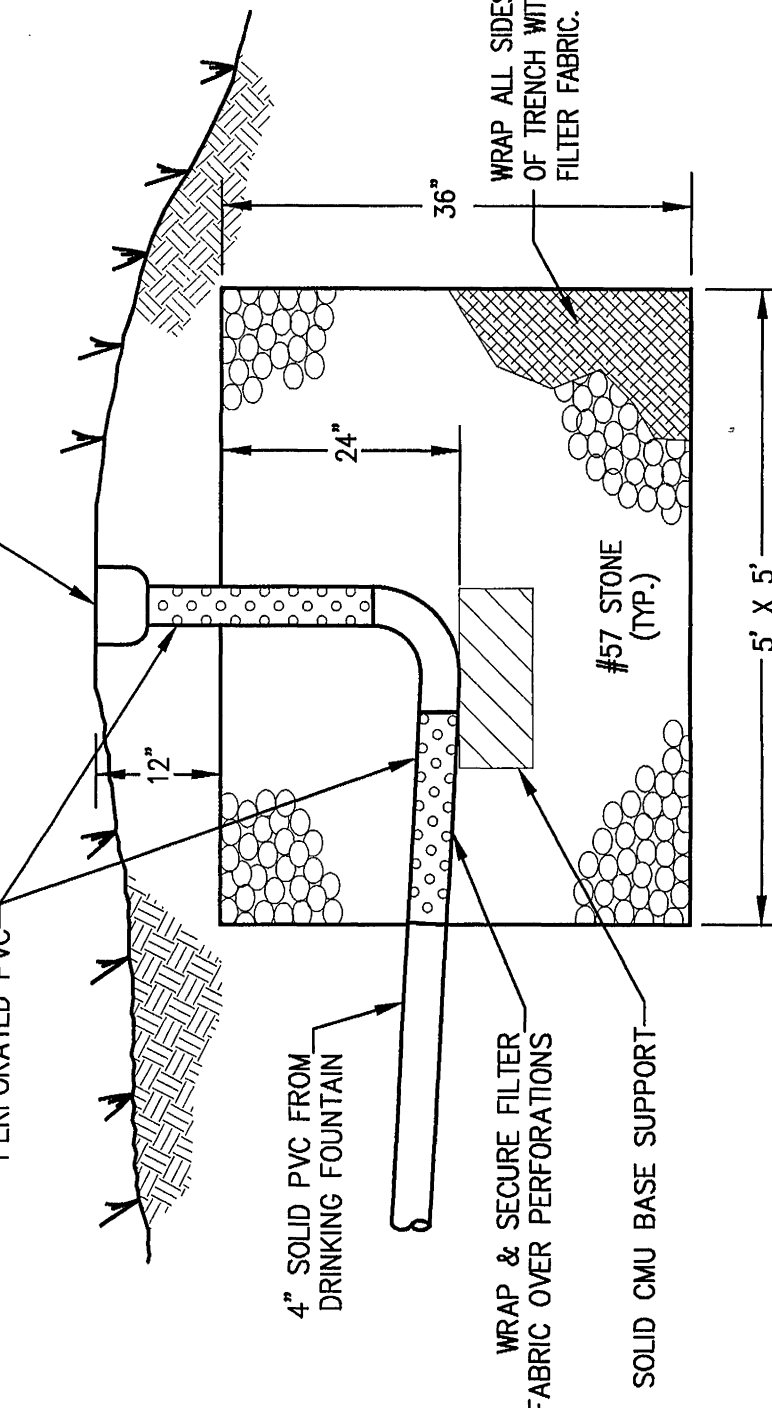

SWALE TYPICAL SECTION

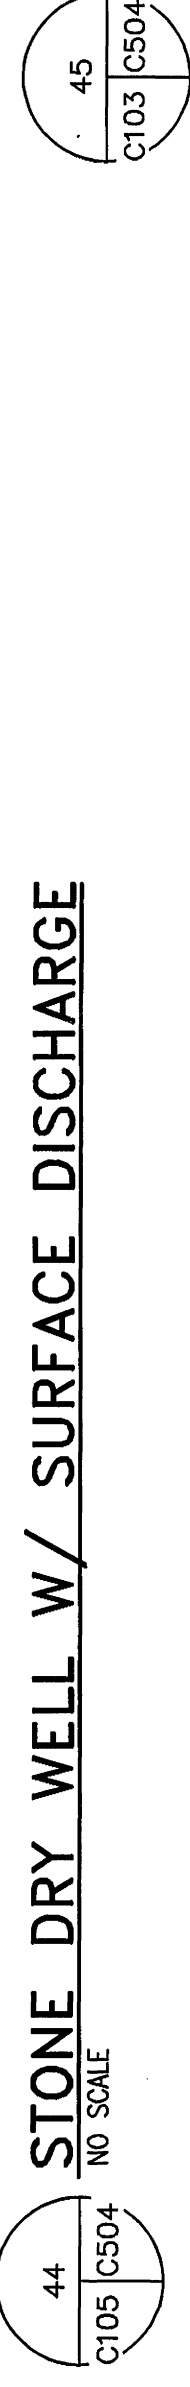

STORMWATER MANAGEMENT FACILITY SECTION (TYP)

