


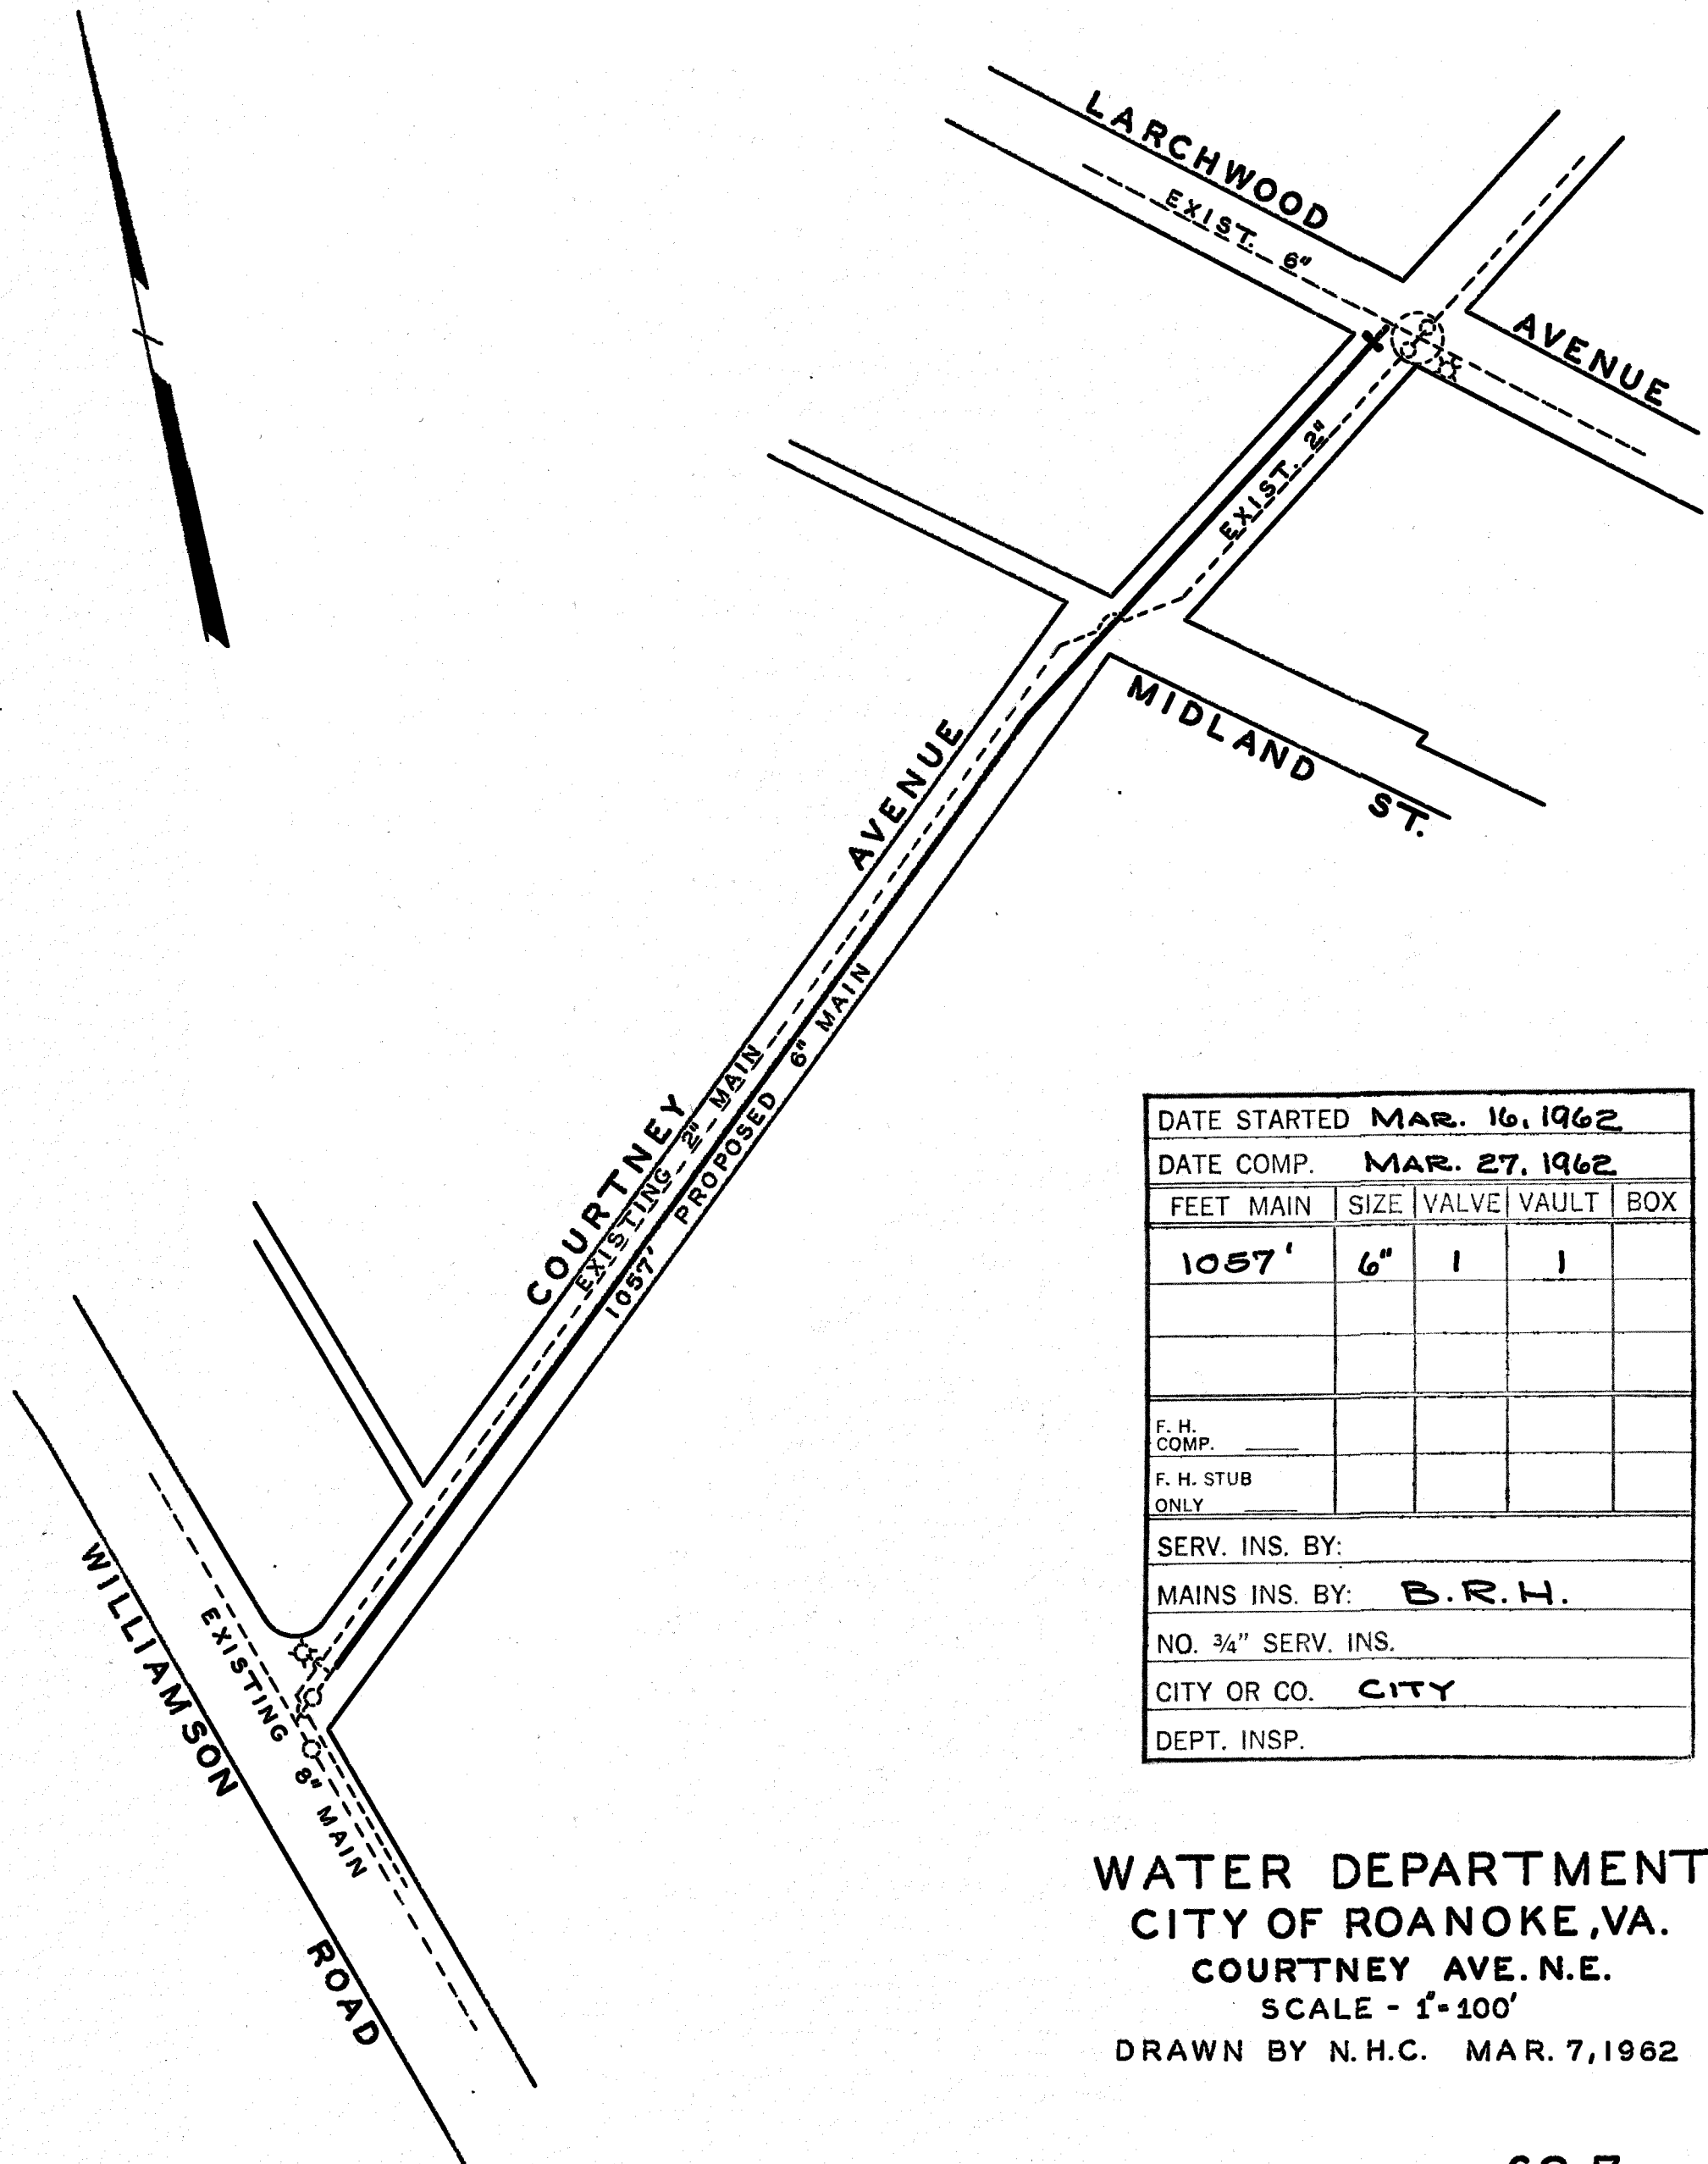

DATE STARTED MAR. 16, 1962				
DATE COMP. MAR. 27, 1962				
FEET MAIN	SIZE	VALVE	VAULT	BOX
1057'	6"	1	1	
F. H. COMP.				
F. H. STUB ONLY				
SERV. INS. BY:				
MAINS INS. BY: B.R.H.				
NO. 3/4" SERV. INS.				
CITY OR CO. CITY				
DEPT. INSP.				

WATER DEPARTMENT
 CITY OF ROANOKE, VA.
 COURTNEY AVE. N.E.
 SCALE - 1"=100'
 DRAWN BY N.H.C. MAR. 7, 1962