


- * NOTES:

1. Meters to be Neptune Protectus III Fire Service Meter Assemblies by Schlumberger Industries. Meter size to be 8-inch main meter and 2-inch disc meter.
2. Valves to be 8-inch flanged, resilient seat gate valves.
3. Vault to be 8' wide x 12' long x 7' high (inside dimensions).
Vault to be Model No. 8127 as manufactured by Penn-Cast Products.
4. Hatch to be Bilco Traffic Type w/ double door entry
Hatch dimensions to be 72"x54".
5. Install valve, pipe and meter supports as required for complete installation.


- * THESE NOTES APPLY ONLY TO VAULT METER #1
(WHICH ADHERE TO COUNTY OF ROANOKE STANDARDS)
SEE SPECIFICATIONS FOR VAULT EQUIPMENT IN
METER VAULTS #2 AND #3.

RECORD DRAWINGS

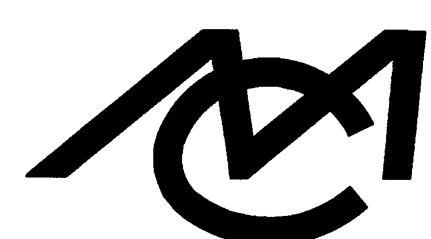

Mattern & Craig
CONSULTING ENGINEERS – SURVEYORS

DESIGNED:	BCC
DRAWN:	FMP
CHECKED:	SWH

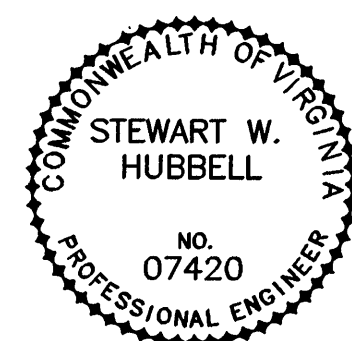[illegible]

DATE
NOVEMBER
1995
COMM. NO.
1417

COYNER SPRINGS WATER LINE
DETAILS
CITY OF ROANOKE, VIRGINIA
SCALE: AS NOTED

SHEET

13

ACAD:1417 :1

PROJECT NO.