


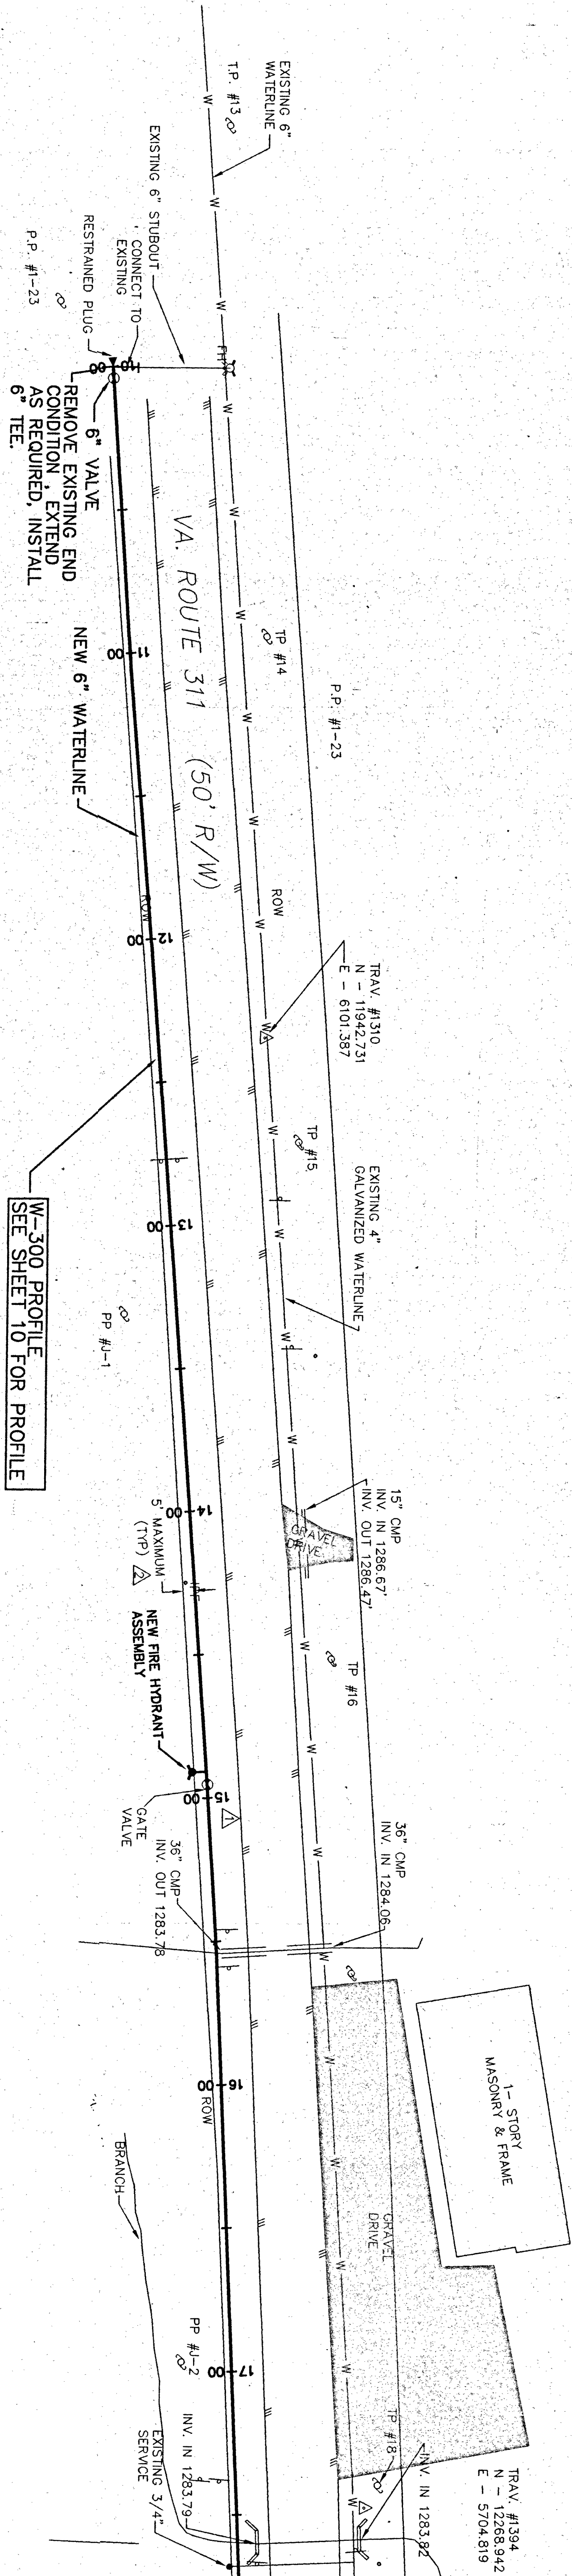


1. ALL VALVE BOX AND BLOW OFF ASSEMBLY
TOPS SHALL BE RECESSED A MINIMUM OF 2"
BELOW GRADE.

MATCHLINE SHEET # 7

CRAIG-NEW CASTLE P.S.A.
WATERLINE EXTENSION &
SANITARY SEWER REHABILITATION
CRAIG COUNTY, VIRGINIA

LMWP.C.
ENGINEERING • ARCHITECTURE • SURVEYING
(540) 345-0675
FAX (540) 342-4456
102 ALBEMARLE AVE., S.E.
ROANOKE, VIRGINIA 24013

DRM	BY	DESCRIPTION	DATE	NO.
DRM		VDH COMMENTS	5-31-00	1
DRM		VDOT COMMENTS	5-31-00	2
DRM		VDH COMMENTS	7-13-00	3
WATERLINE EXTENSION PLAN RTE. 311				

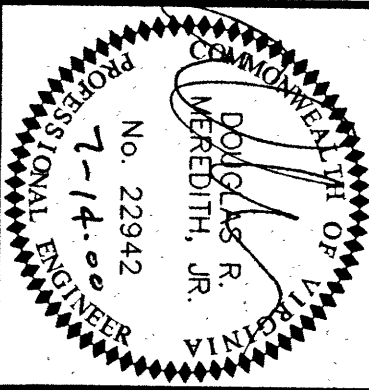

Designed By	DWE/ETH
Drawn By	ETH
Checked By	DRM
Approved By	DRM
Submitted By	DRM
Drawing Title	WATERLINE EXTENSION
Date	6/8/00
Scale	1" = 30'
Commission No.	1563