


1. CONTRACTOR SHALL NOT INTERCONNECT THE EXISTING TRAILER COURT WATER SYSTEM WITH THE NEW WATER SYSTEM. INDIVIDUAL SERVICE SWITCH OVERS SHALL BE ONLY AFTER ENTIRE NEW SYSTEM IS IN SERVICE AND APPROVED FOR USE. THE EXISTING TRAILER COURT SYSTEM SHALL BE ABANDONED IN PLACE.
2. ALL VALVE BOX AND BLOW OFF ASSEMBLY TOPS SHALL BE RECESSED A MINIMUM OF 2" BELOW GRADE.

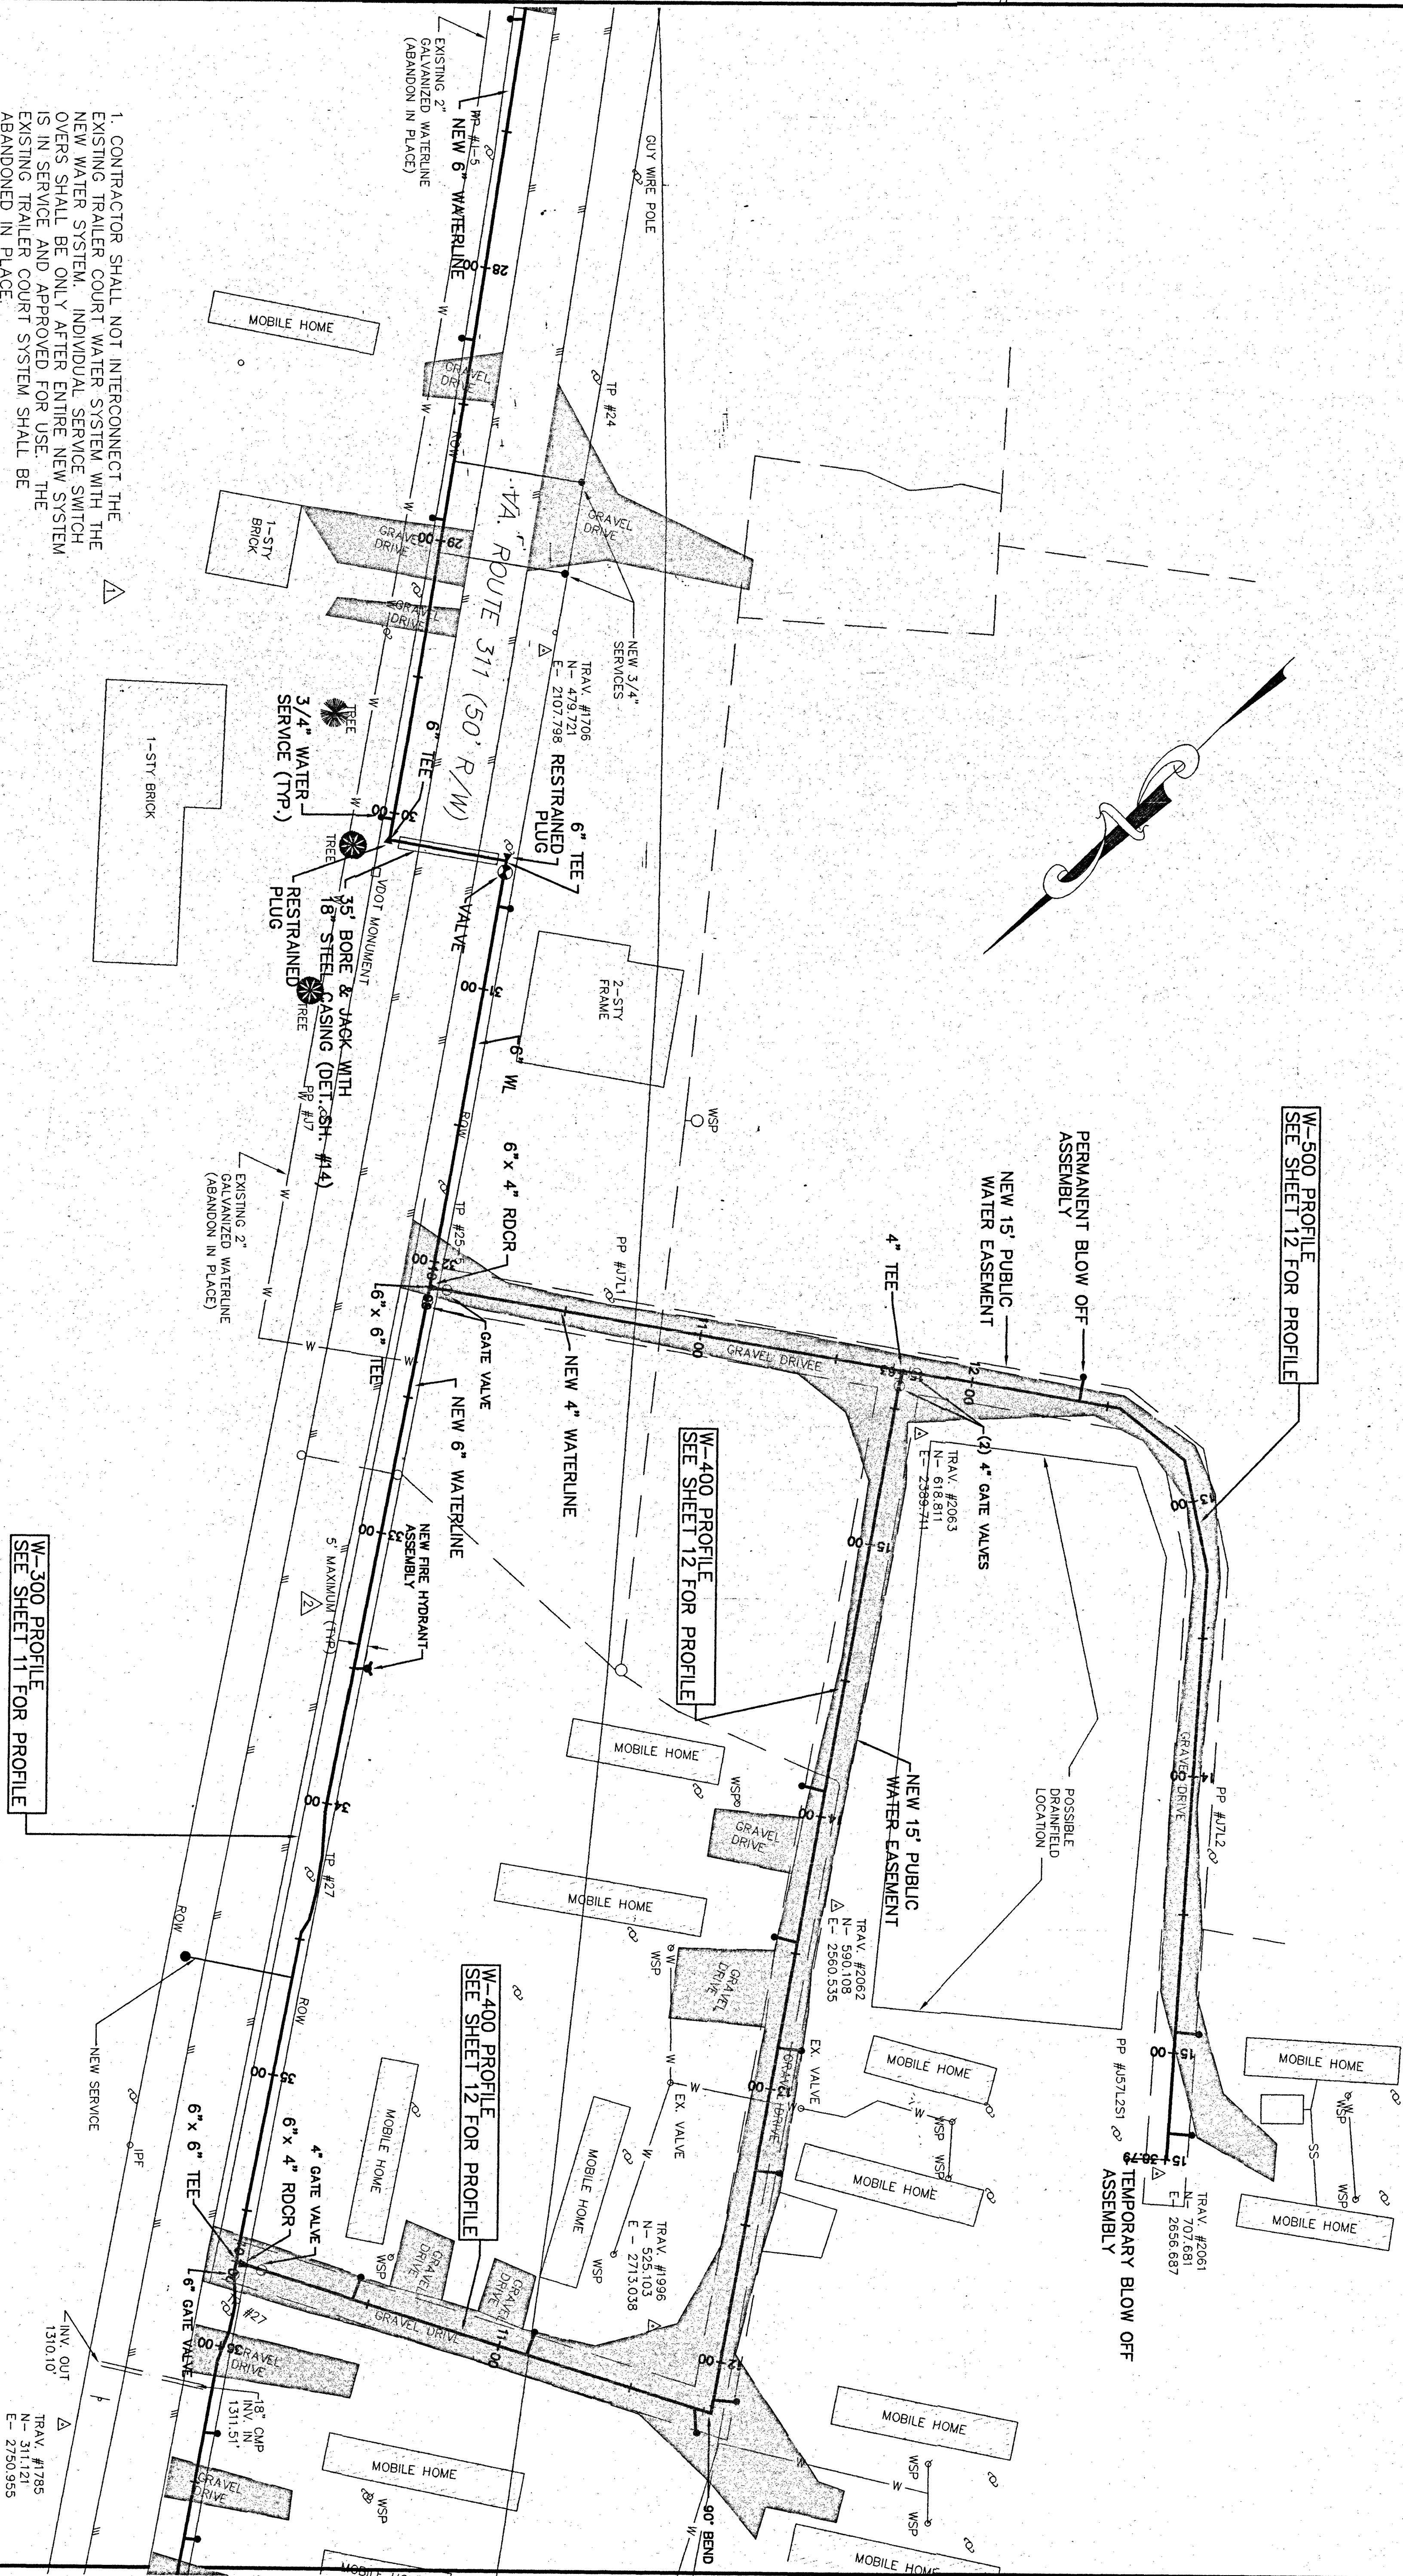

BID ITEM #1

COMMONWEALTH OF VIRGINIA DEPARTMENT OF TRANSPORTATION DIVISION OF HIGHWAYS DESIGNED BY: DME/ETH DRAWN BY: ETH CHECKED BY: DRM APPROVED BY: DRM SUBMITTED BY: DRM DATE: 6/8/00 SCALE: 1"=30' COMMISSION NO. 1563		<table border="1"><tr><th>NO.</th><th>DATE</th><th>DESCRIPTION</th><th>BY</th></tr><tr><td>1</td><td>5-31-00</td><td>VDH COMMENTS</td><td>DRM</td></tr><tr><td>2</td><td>5-31-00</td><td>VDOT COMMENTS</td><td>DRM</td></tr><tr><td>3</td><td>7-13-00</td><td>VDH COMMENTS</td><td>DRM</td></tr></table>		NO.	DATE	DESCRIPTION	BY	1	5-31-00	VDH COMMENTS	DRM	2	5-31-00	VDOT COMMENTS	DRM	3	7-13-00	VDH COMMENTS	DRM	CRAIG-NEW CASTLE P.S.A. WATERLINE EXTENSION & SANITARY SEWER REHABILITATION CRAIG COUNTY, VIRGINIA		LMW P.C. ENGINEERING • ARCHITECTURE • SURVEYING (540) 345-0675 FAX (540) 342-4456 102 ALBEMARLE AVE., S.E. ROANOKE, VIRGINIA 24013	
NO.	DATE	DESCRIPTION	BY																				
1	5-31-00	VDH COMMENTS	DRM																				
2	5-31-00	VDOT COMMENTS	DRM																				
3	7-13-00	VDH COMMENTS	DRM																				