


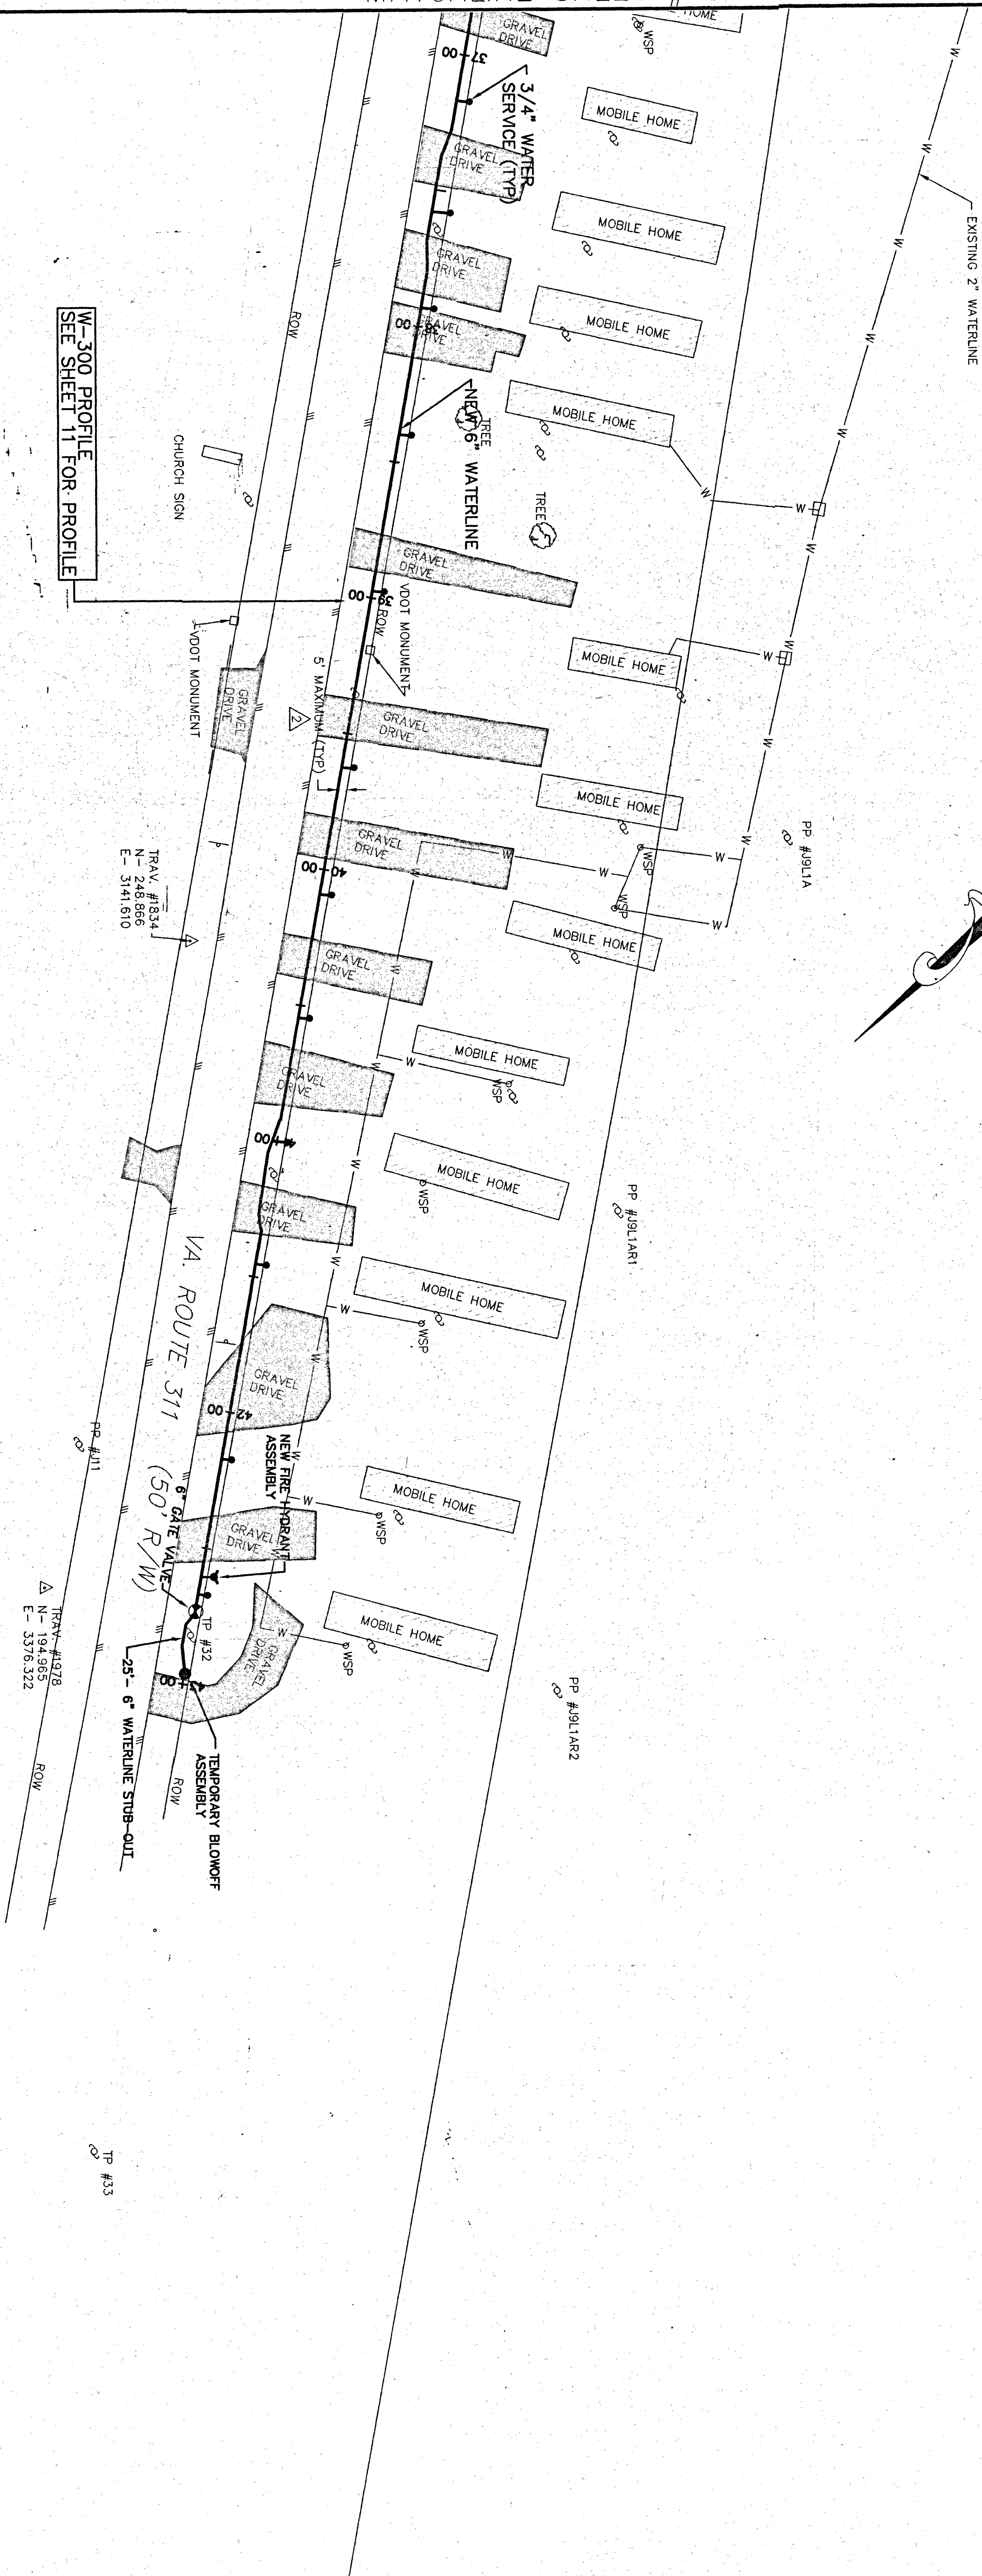


1. CONTRACTOR SHALL NOT INTERCONNECT THE EXISTING TRAILER COURT WATER SYSTEM WITH THE NEW WATER SYSTEM. INDIVIDUAL SERVICE SWITCH OVERS SHALL BE ONLY AFTER ENTIRE NEW SYSTEM IS IN SERVICE AND APPROVED FOR USE. THE EXISTING TRAILER COURT SYSTEM SHALL BE ABANDONED IN PLACE.

2. ALL VALVE BOX AND BLOW OFF ASSEMBLY TOPS SHALL BE RECESSED A MINIMUM OF 2" BELOW GRADE.

W-300 PROFILE
SEE SHEET 11 FOR PROFILE

BID ITEM #1

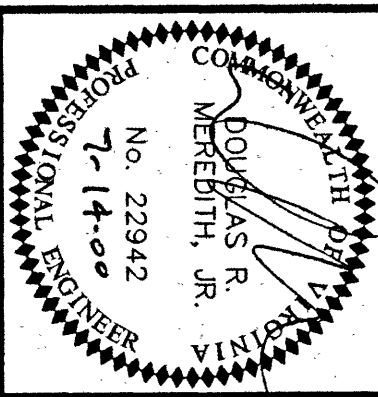

1	5-31-00	VDH COMMENTS	DRM
2	5-31-00	VDOT COMMENTS	DRM
3	7-13-00	VDH COMMENTS	DRM
NO.	DATE	DESCRIPTION	BY
WATERLINE EXTENSION			
PLAN RTE. 311			

CRAIG-NEW CASTLE P.S.A.
WATERLINE EXTENSION &
SANITARY SEWER REHABILITATION
CRAIG COUNTY, VIRGINIA

LMW P.C.
ENGINEERING • ARCHITECTURE • SURVEYING
(540) 345-0675 102 ALBEMARLE AVE., S.E.
FAX (540) 342-4456 ROANOKE, VIRGINIA 24013

Designed By	DME/ETH
Drawn By	ETH
Checked By	DRM
Approved By	DRM
Submitted By	DRM
Drawing 563-WL-MASTER	
Date	6/8/00
Scale	1"=30'
Commission No.	1563
Sheet	9 of 14