


SEWER SERVICE CONNECTIONS & APPROX. ELEVATIONS

MARK	RESIDENT	TANK SIZE	GROUND	INV. OUT	COMMENTS
2-1	TRIPP	E	1303.9	1302.6	(NEW)
2-2	CALDWELL	E	1305.2	1303.1	(EXIST)
2-3	SAUNDERS	E	1305.1	(EXIST)	
2-4	SAUNDERS	E	1305.1	1305.8	(NEW)
2-5	TRIPP	1000	1312.3	1310.0	(EXIST)
2-6	BRIDGER	E	1312.3	1310.0	(EXIST)


E = EXISTING TANK TO BE CONNECTED

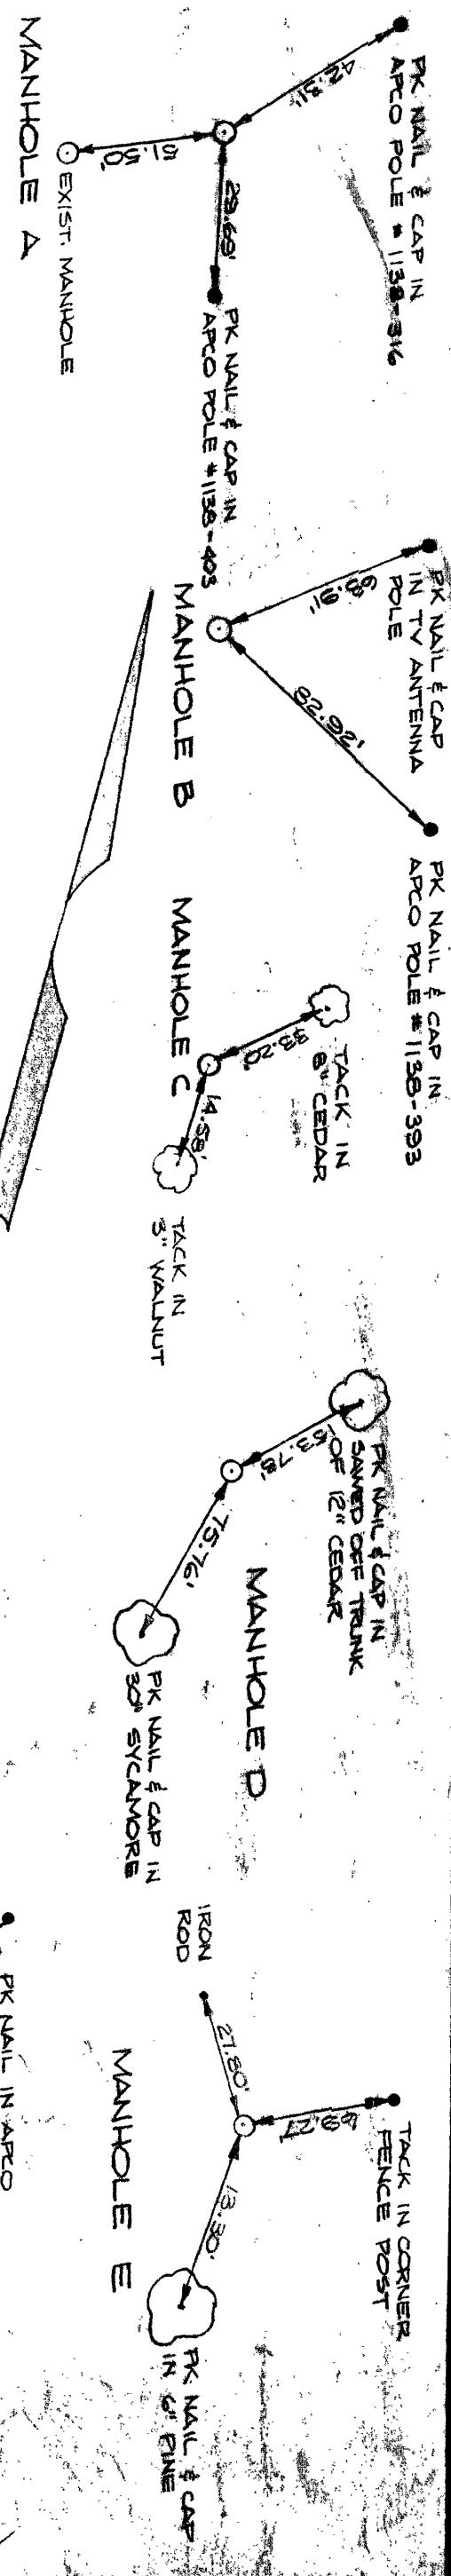

NOTE:
WATER IMPROVEMENTS ON
STREET ABUTMENT
ON SHT 3 OF 3, PAGE 11

- BENCHMARKS**
- THREE NAILS IN APCO POLE 1138-393 ON EAST SIDE OF COURT STREET NEAR GRANFORD OIL CO. ELEV. 1285.12'
 - RR SPIKE IN CURB SURFACE 15' EAST OF STA 21+04 & ELEV. 1290.70'

STA. 10+00.00
CONNECT PROPOSED 4" W
TO EXIST 4" W
1-4" TAPPING SLEEVE & VALVE
CONC. ANCHORS T-0.50'
1-4" REDUCER
STA. 10+23.79
1-6" 8' x 8' x 6" CROSS
1-6" VALVES & BOXES
2-8" M.I. PLUGS
TIE 8" VALVES TO CROSS W/ RODS
STA. 10+60.00
1-6" 8' x 8' x 6" TEE
CONC. ANCHORS T-0.50'
1-6" VALVE & BOX
1-FIRE HYDRANT

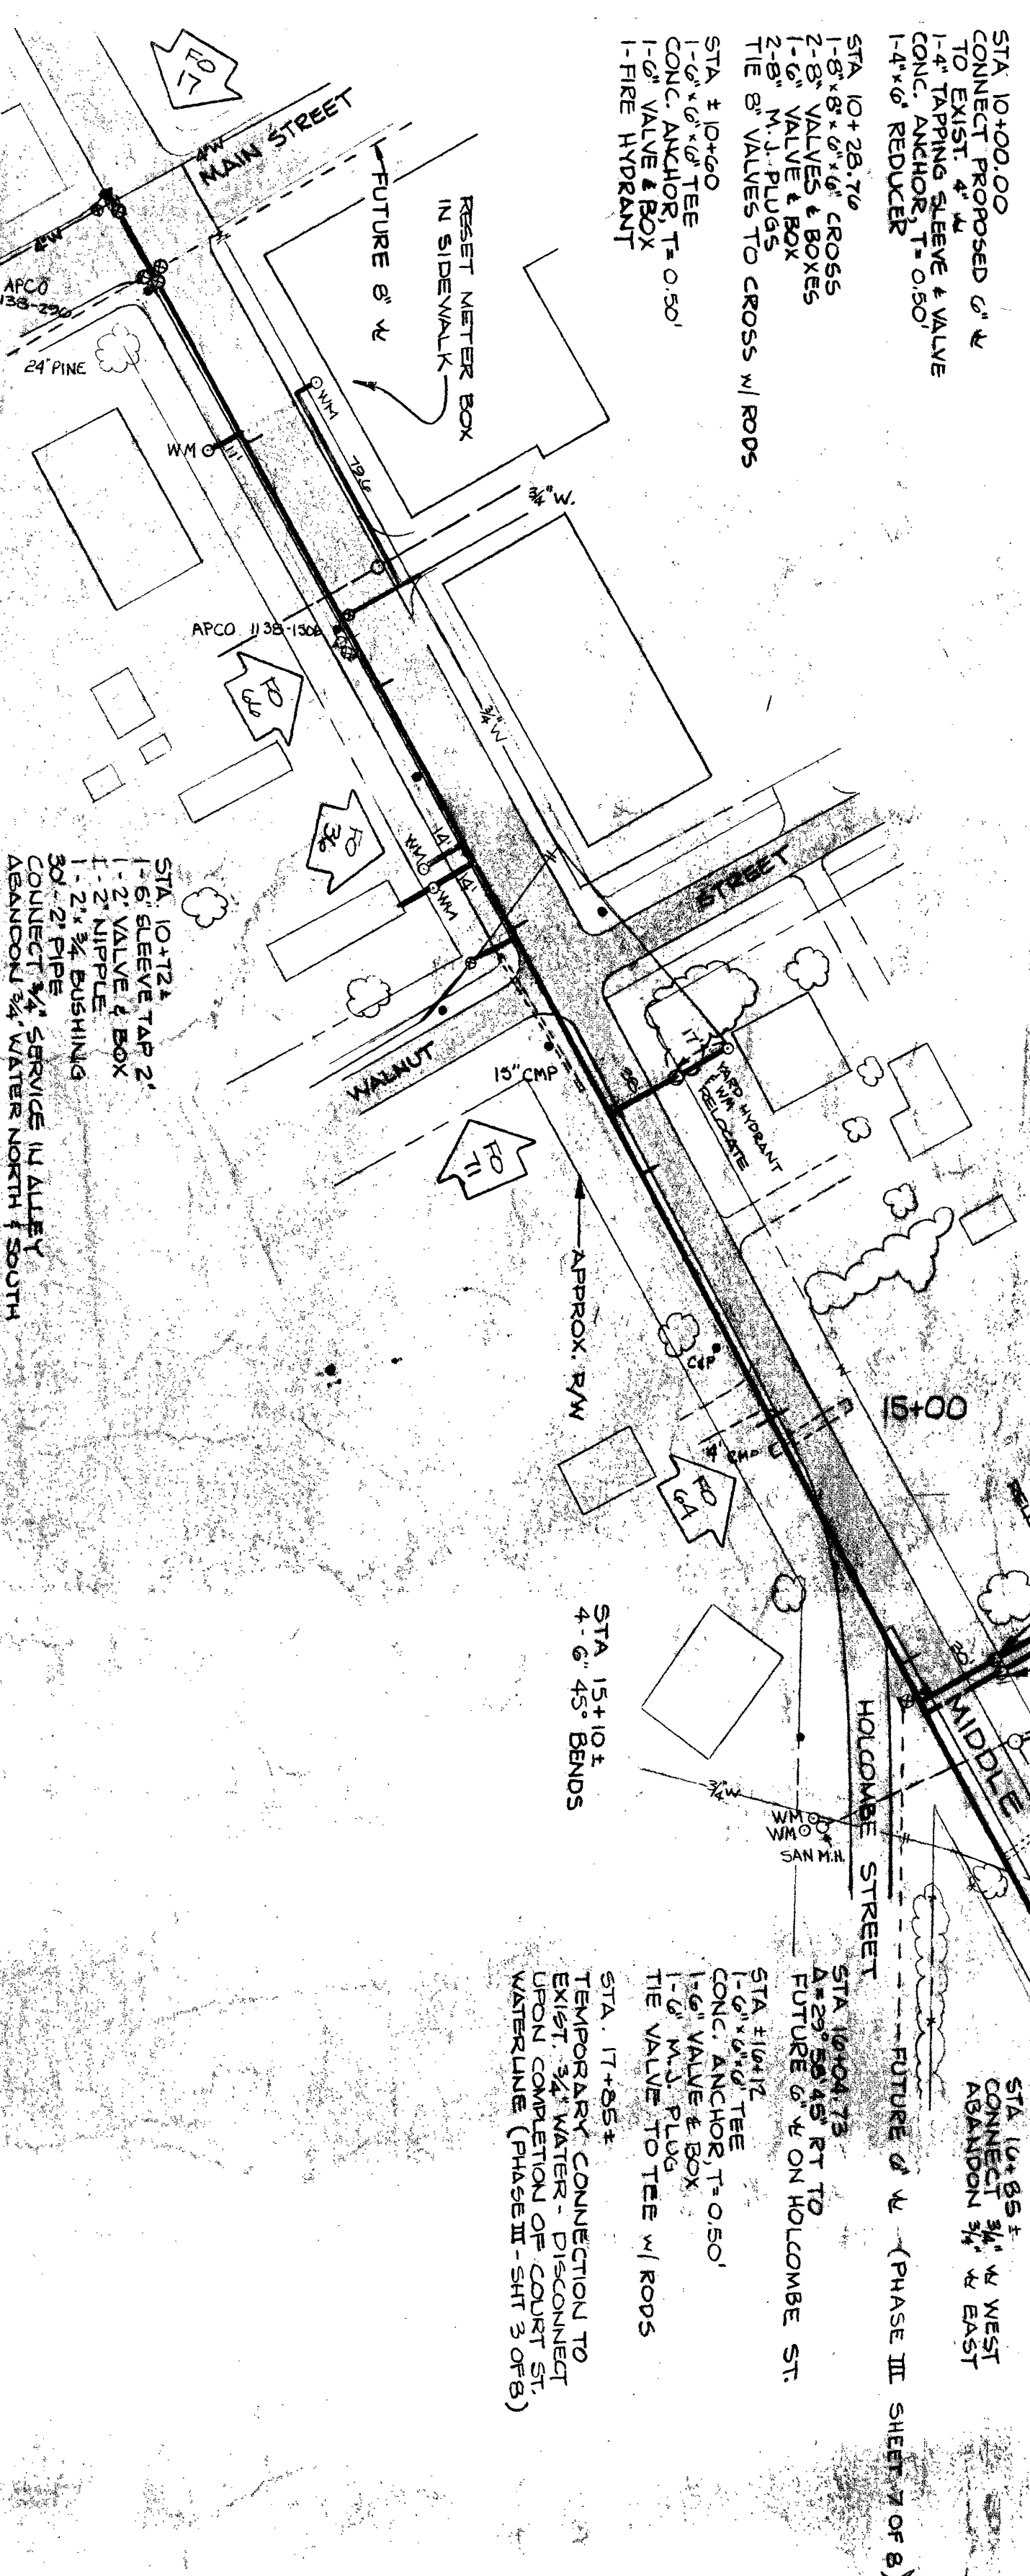

NOTE:
EFFLUENT SEWER SERVING
RESIDENCES 2-5 & 2-6 SHALL
BE CONSTRUCTED USING PRESSURE
PIPE PER SEC. 1.3 OF THE
TECHNICAL SPECIFICATIONS

STA. 23+13.1
1-6" SLEEVE TAPPED 1 1/2"
CONNECT 1 1/2" W/ WEST
REARDOOR 3/4" W/ EAST W/
PLUG & ABANDON 3/4" W/ SOUTH

BORING SCHEDULE

PIPE SIZE	CASING DIA.	MIN. WAIT
8"	16"	0.25"
6"	12"	0.25"
4"	12"	0.25"
2"	4"	SCHED. 40
1" & BELOW	1 1/2"	SCHED. 40

