


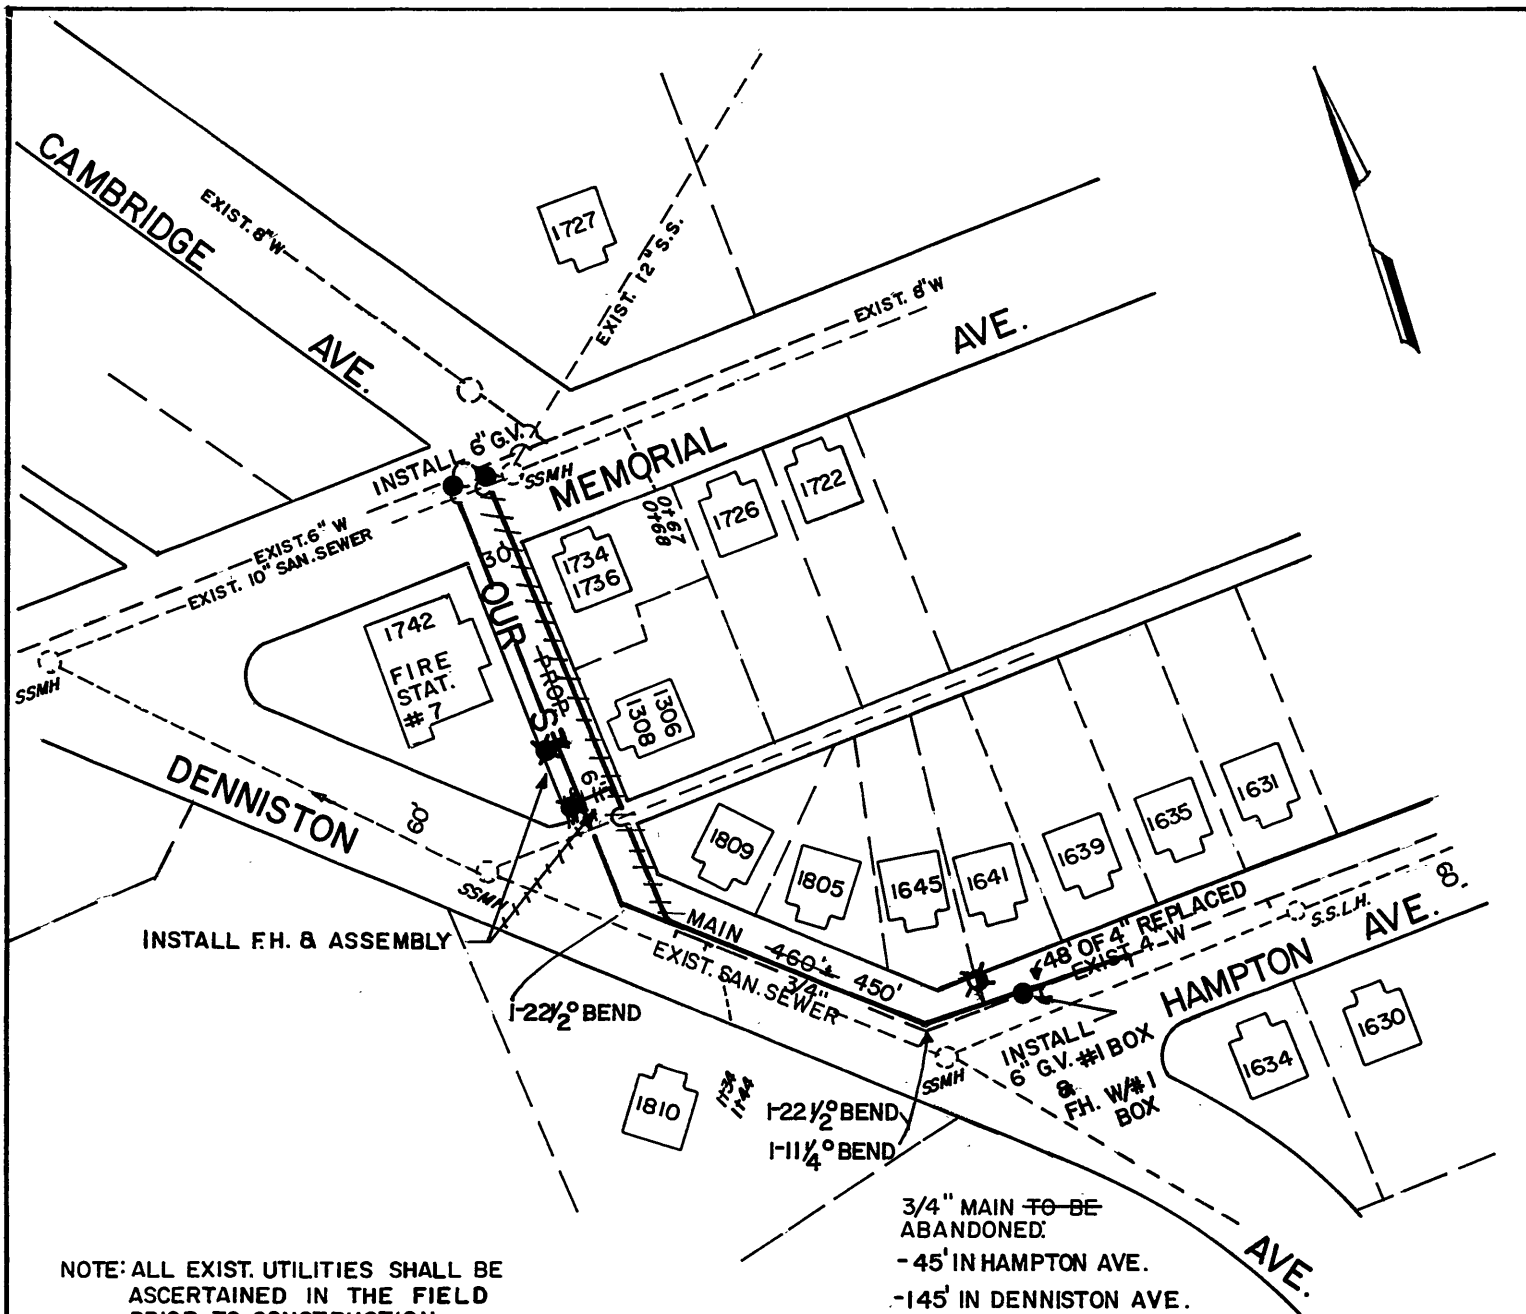

DATE STARTED	1-8-92			
DATE COMP.	2-4-92			
FEET MAIN	SIZE	VALVE	VAULT	BOX
450'	6	2	1	1
48'	4	0	0	0
F.H. COMP.	2	4 1/2	2	1
F.H. STUB ONLY	0			
SERV. INS. BY:	C.O.DAME			
MAIN INS. BY:	"			
NO. 3/4" SERV. INS.	6-REPLACED			
CITY OR CO.	CITY			
DEPT. INSP.	U.S.			

MANAGER UTILITY
LINE SERVICES

WATER DEPARTMENT	
ROANOKE	VIRGINIA
DENNISTON AVENUE, HAMPTON AVENUE, OUR STREET, S.W.	
(REPLACEMENT PROJECT)	
SCALE: 1" = 100'	
DATE: 11/13/91	DIRECTOR UTILITIES & OPERATIONS DATE
DIST. MAP: 133	
PLAN NO.: 91-10	DIRECTOR OF PUBLIC WORKS DATE